SHEET: COW-A1 (05/2005)

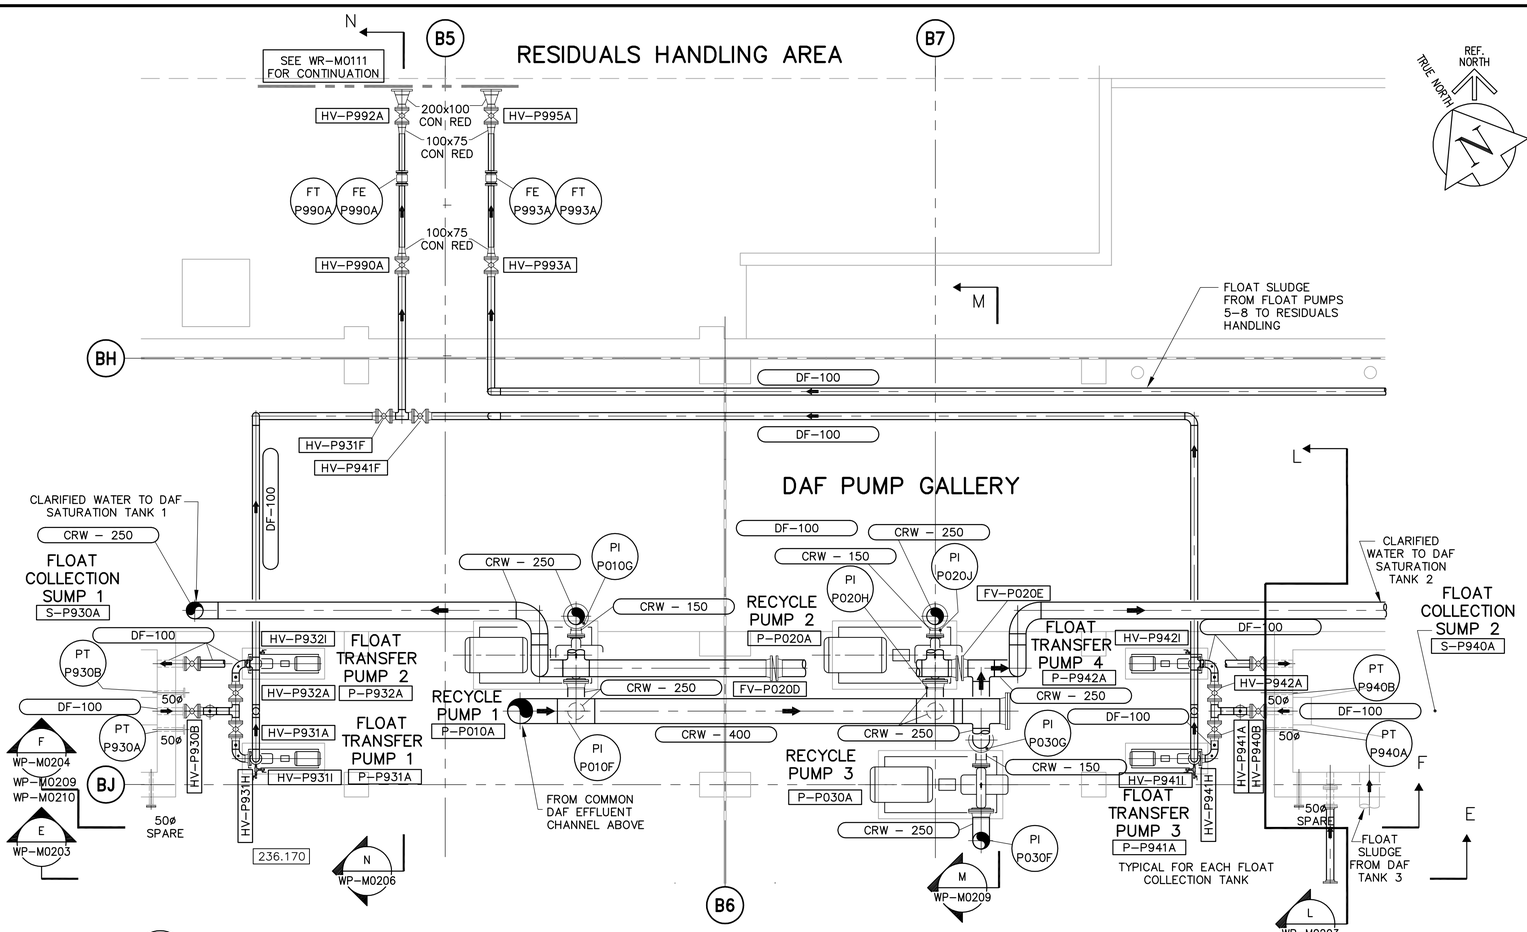

11 PLAN – FLOAT PUMPS 1-4 AND RECYCLE PUMPS 1-3
WP-M0115 1:50

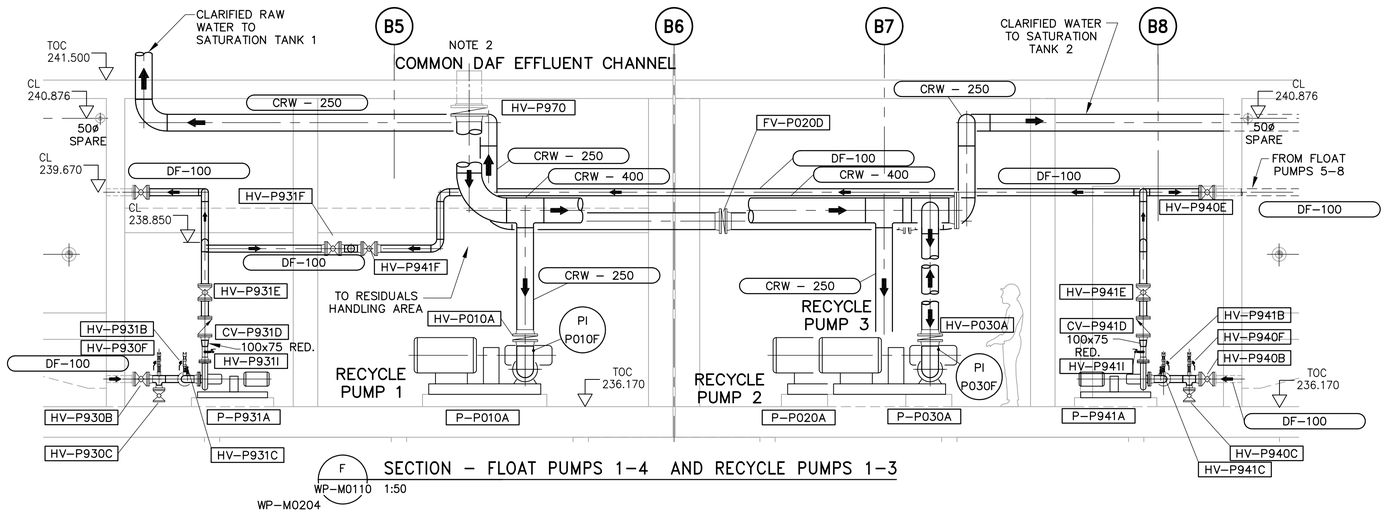

F WP-M0204 — SECTION – FLOAT PUMPS 1-4 AND RECYCLE PUMPS 1-3
WP-M0110 1:50

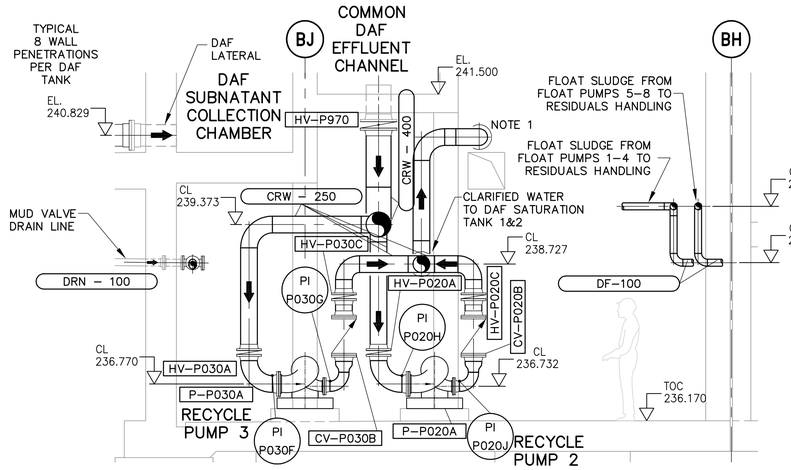

M WP-M0110 1:50 — SECTION – RECYCLE PUMPS 2 & 3
WP-M0115
WP-M0120
WP-M0209

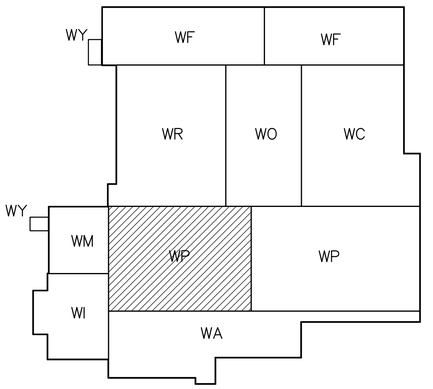

NOTES:

1. ENSURE CRW-250 RUNS ABOVE DUCT.
2. EXTEND 400mm FEED LINE 150mm ABOVE CHANNEL FLOOR. TYPICAL OF 2 LINES.
3. FOR ADDITIONAL INFORMATION ON PIPE EMBEDS, REFER TO SERIES WP-M9000 DRAWINGS.
4. PROVIDE FLEXIBLE COUPLINGS ON THE SUCTION AND DISCHARGE OF ALL PROCESS PUMPS.

APEGM
Certificate of Authorization
Earth Tech Canada Inc.
No. 730 Expiry: April 30, 2006

NO.	REVISIONS	DATE	BY
	B.M. ELEV.		
00	ISSUED FOR TENDER	06/03/29	PL

CH2MHILL Fredericksen Cooper ARCHITECTS — EarthTech A Tyco International Ltd. Company

DESIGNED BY	KAS	CHECKED BY	SMB
DRAWN BY	P.L./LPT/LC	APPROVED BY	AHL
SCALE:	1:50	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
DATE	2005/10/19	DATE	2006/03/29

ENGINEER'S SEAL
ORIGINAL SIGNED BY
S.M. BREESE
2006/03/29

CONSULTANT DRAWING NO.
WP-M0209

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

WATER TREATMENT PLANT
FLOCCULATION AND DAF
MECHANICAL AND ELECTRICAL

CITY FILE NUMBER
SHEET OF

PROCESS MECHANICAL
RECYCLE AND FLOAT PUMPS WEST END

CITY DRAWING NUMBER
1-0601P-A-M0209-001-00D

Last Save: 2006-03-27 3:36 PM

L:\WORK\79000\79538\02A-CAD\WAT\CONTR\WTP_DETAIL DESIGN\DAF\DN_WP-M0209_ET.DWG