SHEET: COW-A1 (05/2005)

SUPPLY CONTRACTOR PACKAGE

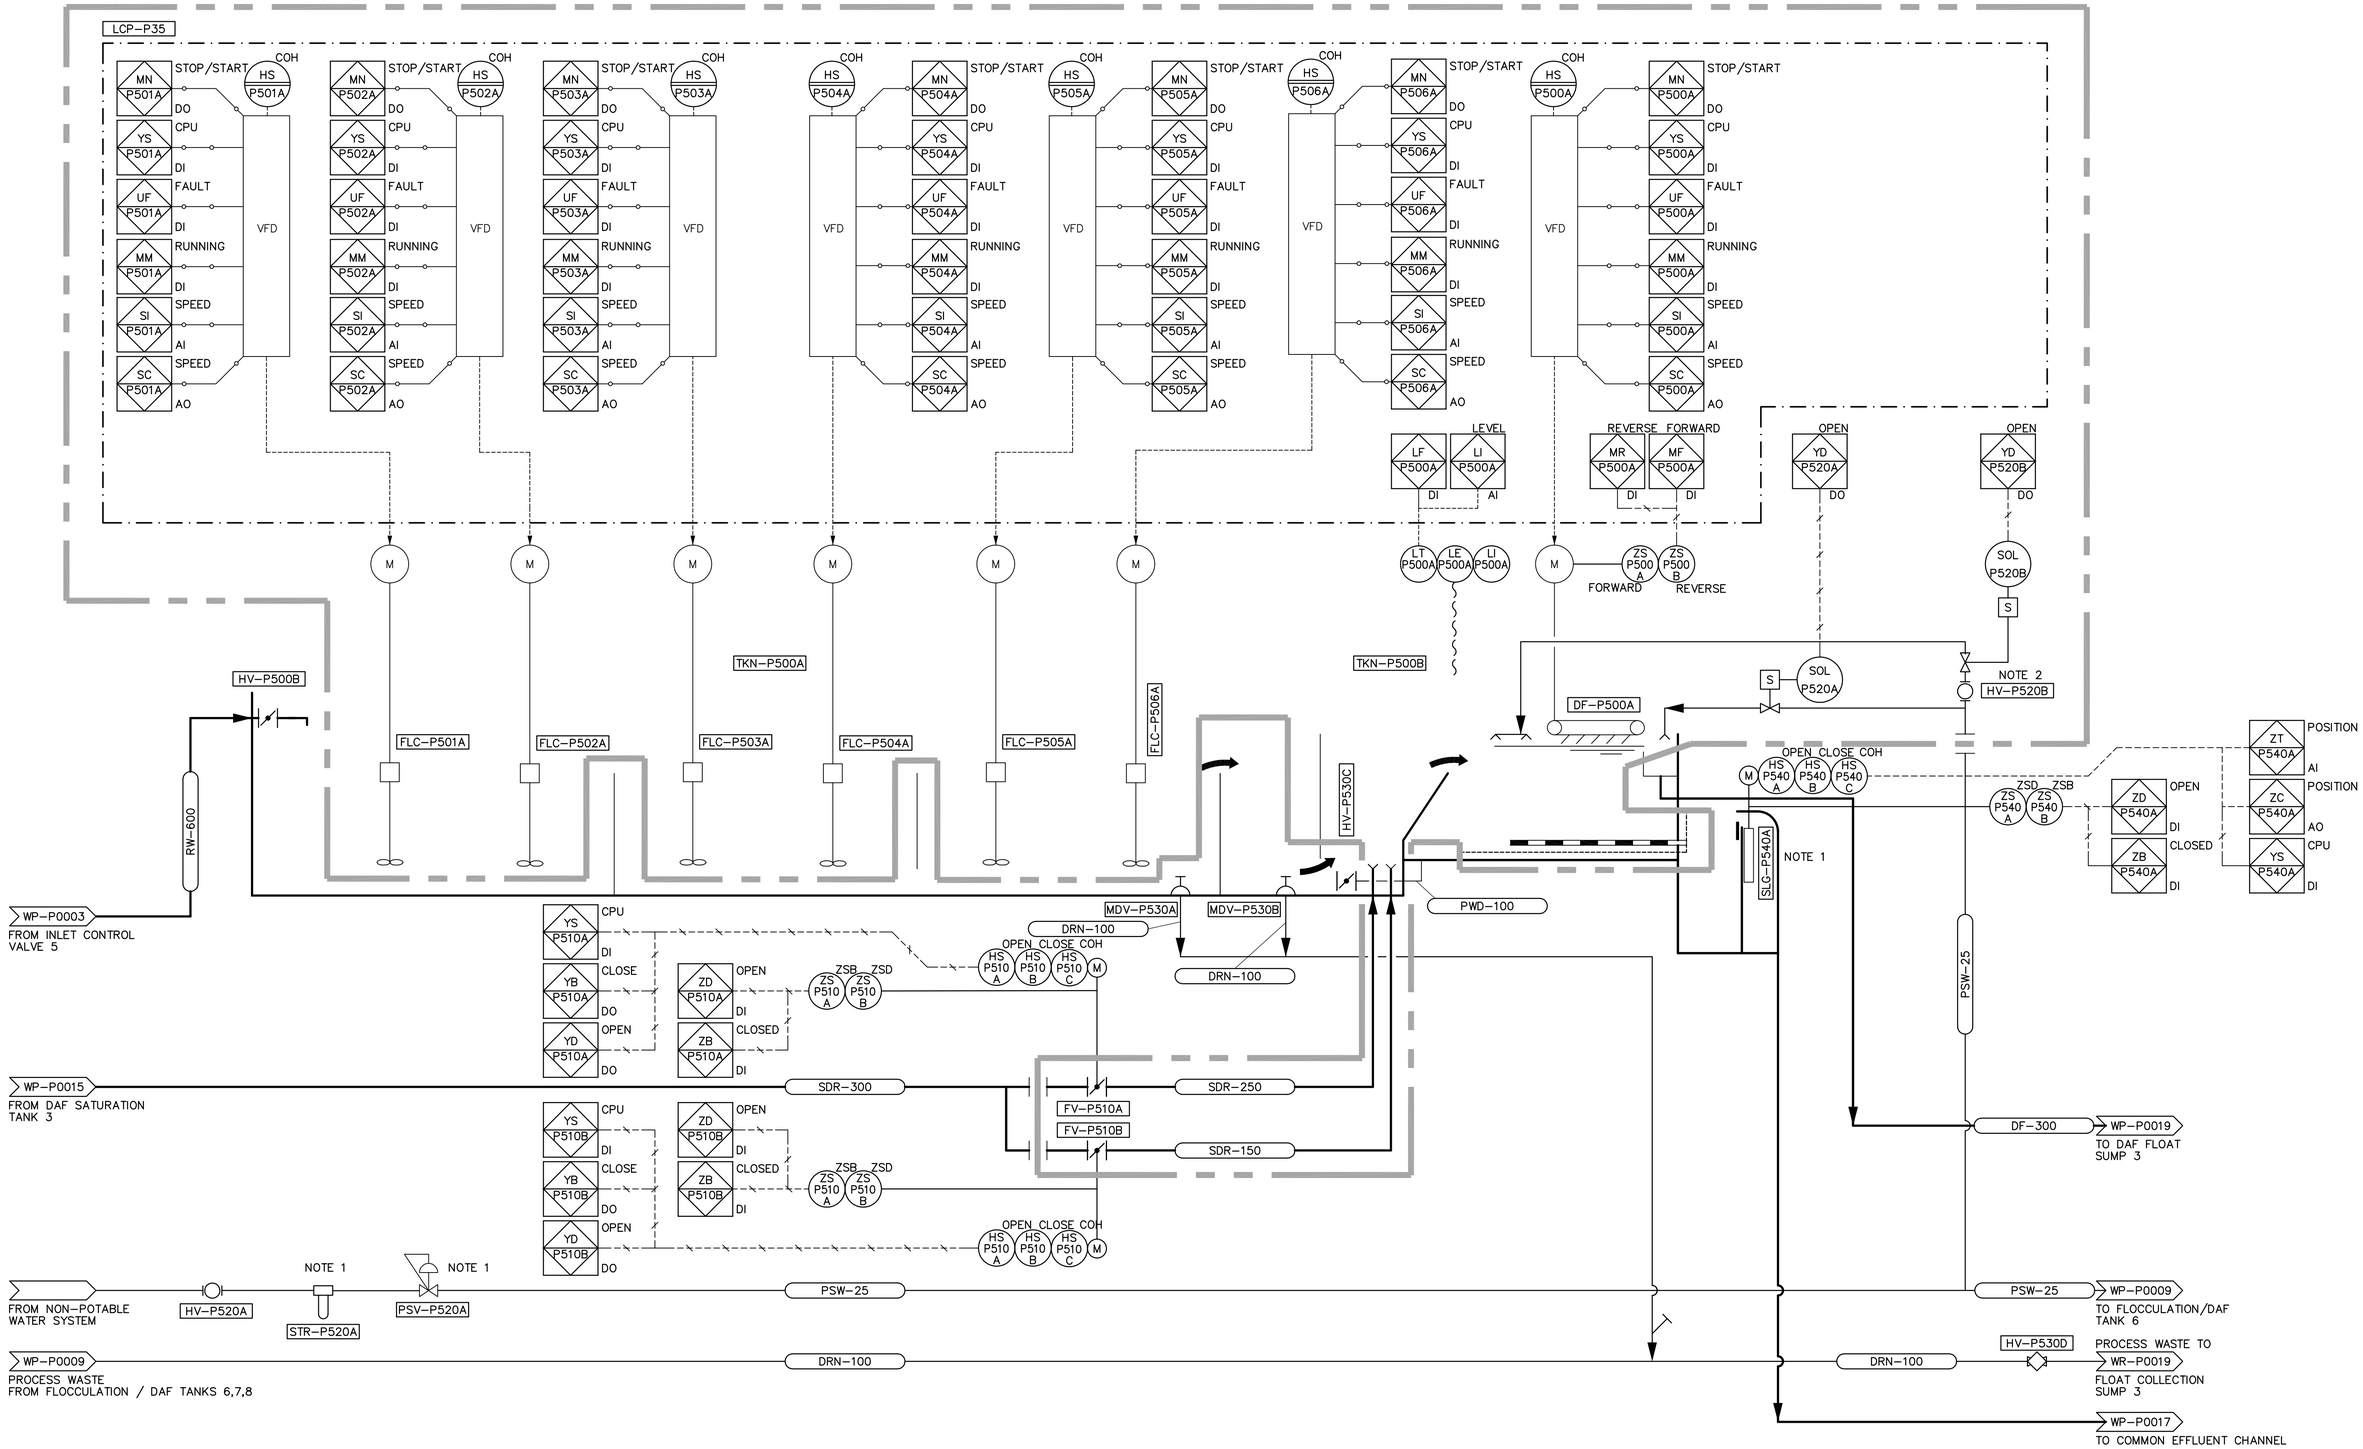

NOTES:

1. GATE, STRAINER, PRESSURE REGULATOR ARE PART OF VENDOR PACKAGE.
2. BALL VALVE NOT PART OF LEOPOLD'S SCOPE OF SUPPLY.

APEGM
Certificate of Authorization
Earth Tech Canada Inc.
No. 730 Expiry: April 30, 2006

NO.	REVISIONS	DATE	BY
00	ISSUED FOR TENDER	06/03/29	LAE

B.M. ELEV.

CH2MHILL / Fredericksen Cooper ARCHITECTS
EarthTech A Tyco International Ltd. Company

DESIGNED BY	KAS	CHECKED BY	SMB
DRAWN BY	LAE	APPROVED BY	AHL
SCALE:	NONE	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
DATE	2005/02/16	DATE	2006/03/29

ENGINEER'S SEAL
ORIGINAL SIGNED BY
S.M. BREESE
2006/03/29

CONSULTANT DRAWING NO.
WP-P0008

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

WATER TREATMENT PLANT
FLOCCULATION AND DAF
MECHANICAL AND ELECTRICAL

PROCESS
FLOCCULATION/DAF TANK 5
PROCESS AND INSTRUMENTATION DIAGRAM

CITY FILE NUMBER
SHEET OF
CITY DRAWING NUMBER
1-0601P-G-P0008-001-00D

Last Save: 2006-03-27 1:51 PM

L:\WORK\79000\79538\02A-CAD\WAT\CONTR\WTP_DETAIL DESIGN\P&IDS\DAF\DN_WP-P0008_ET.DWG