
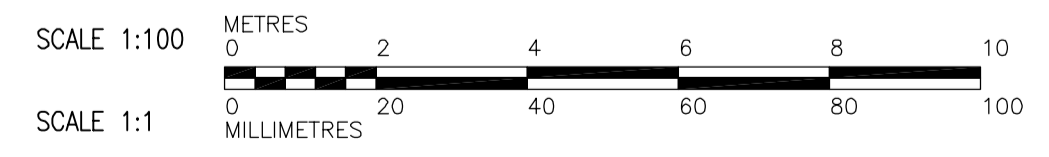


THIRD FLOOR PLAN
1:100

STAIRWELL NO.4

- NOTES:
- REFER TO SCHEMATIC DRAWING WB-H0505 FOR DETAIL OF HYDRONIC PIPING CONNECTION.
 - PROVIDE FIRE DAMPER AT ALL DUCT PENETRATION THRU FLOOR.
 - PROVIDE DRIP LEG ON GAS PIPES AS REQUIRED BY APPLICABLE GAS CODE.

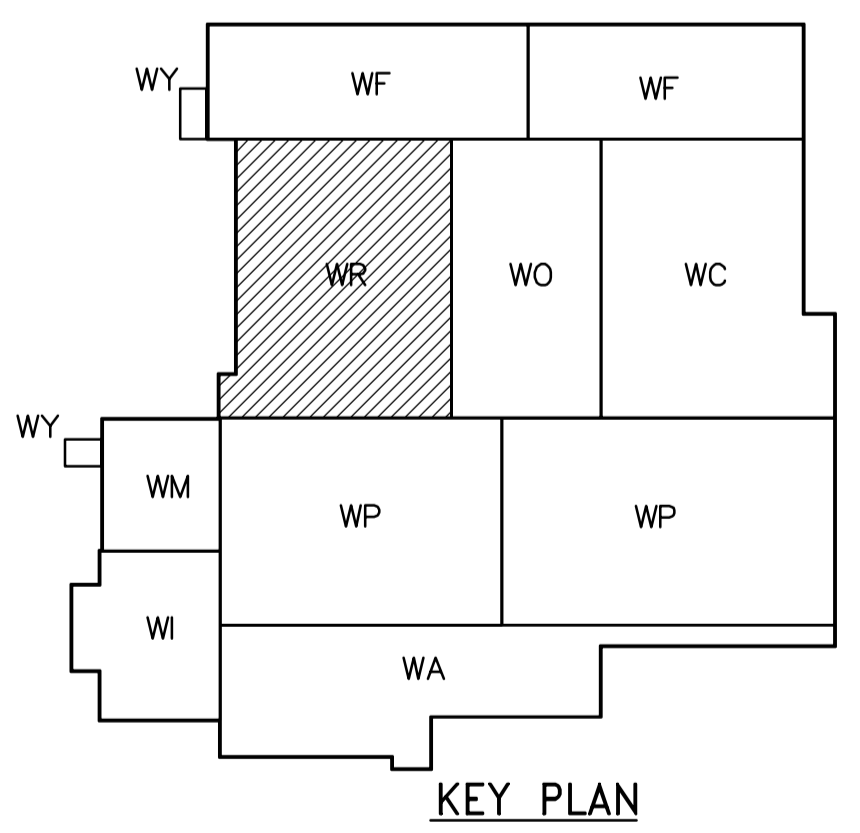

APECA
Certificate of Authorization
CH2M HILL Canada Ltd.
No. 1441 Expiry: April 30, 2006

00	ISSUED FOR TENDER	06/03/29	TT
NO.	REVISIONS	DATE	BY
		2005/07/04	

DESIGNED BY	TT	CHECKED BY	DL
DRAWN BY	AM	APPROVED BY	AHL
SCALE:	1:100	RELEASED FOR CONSTRUCTION BY:	R. SOROKOWSKI
		DATE	2006/03/29

ENGINEER'S SEAL
ORIGINAL SIGNED BY
D.K. CUDDINGTON
2006/03/29
CONSULTANT DRAWING NO.
WR-H0131

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

WATER TREATMENT PLANT
RESIDUALS HANDLING
MECHANICAL AND ELECTRICAL

HVAC
RESIDUALS HANDLING AREA
THIRD FLOOR PLAN

CITY FILE NUMBER
SHEET OF
CITY DRAWING NUMBER
1-0601R-A-H0131-001-000