


PARTIAL PLAN - LOWER LEVEL BIOREACTOR 2
SCALE: 1:100

NOTES:

- EXISTING CONCRETE SURFACE TO BE INTENTIONALLY ROUGHENED TO A FULL AMPLITUDE OF 5mm & TO BE CLEAN, SOUND & FREE OF LAINTANCE. EXISTING CONC. TO BE IN A S.S.D. CONDITION FOR 24 HOURS PRIOR TO CASTING OF CONCRETE INFILL WALLS/BEAMS (SEE SECTION 1 SHEET SS3.03). TYPICAL AT NEW & EXISTING INTERSECTION POINTS FOR: CB-1, CB-2, CB-3, CC-1, SL-1 & CW-6
- MAXIMUM CONSTRUCTION LOAD NOT TO EXCEED A SERVICE LOAD OF 12.0 kPa WITHIN THE GALLERY TUNNELS.

- SUGGESTED CONSTRUCTION ACCESS POINT:**
- T.O. CONSTRUCTION ACCESS POINT AT ELEV. ±239.000.
 - DO NOT CUT EXISTING 25M I.F. HAUNCH REINFORCING STEEL.
 - T.O. HAUNCH REINFORCING AT ELEV.±239.000 (SITE CONFIRM ELEVATION PRIOR TO CONSTRUCTION).
 - PROVIDE FULL TENSION LAP SPLICES TO REINFORCING STEEL REQUIRED TO BE CUT FOR CONSTRUCTION ACCESS POINT.
 - SHORE EXISTING ROOF STRUCTURE AS REQUIRED.
 - WATER STOP & CHIP A MINIMUM 38x140 CONTINUOUS KEY AROUND OPENING.
 - IN FILL TO BE WATER TIGHT.
 - REVIEW SIZE LOCATION OF ACCESS OPENING WITH CONTRACT ADMINISTRATOR PRIOR TO CUTTING CONCRETE.

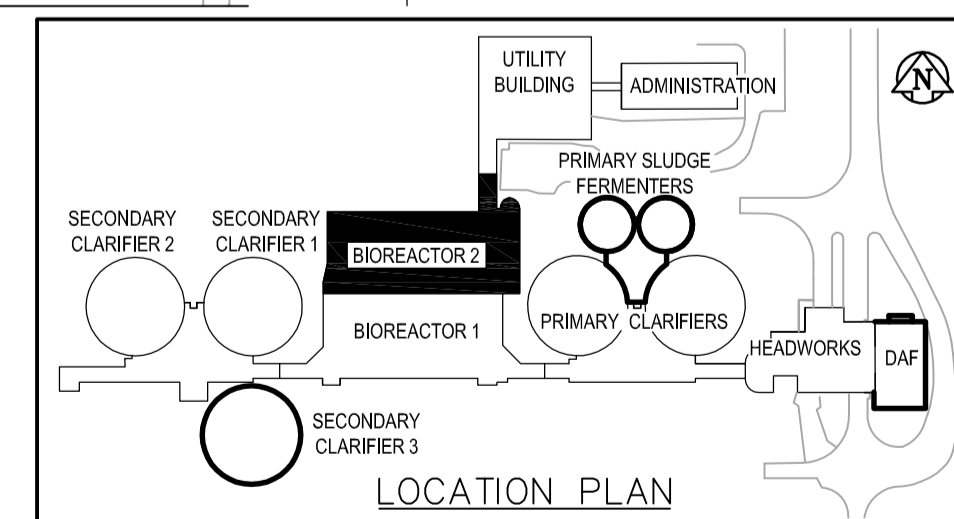

<p>A Tyco International Ltd. Company</p>		ENGINEER'S SEAL ORIGINAL SIGNED BY J. BETKE 2006/04/26 CONSULTANT DRAWING NO. SS2.02
DESIGNED BY: AA/JB	CHECKED BY: AA/JB	CITY FILE NUMBER SHEET OF CITY DRAWING NUMBER
DRAWN BY: WDB/KK	APPROVED BY: JEH	
HOR. SCALE: AS NOTED	RELEASED FOR CONSTRUCTION BY: J. VEILLEUX	
VERTICAL SCALE:	DATE: 2006/04/26	
NO. REVISIONS	DATE	