


File Name: F:\Projects\2006\06-0107-08\Elect\Drawings\06-0107-08E04.dwg - Tab: E4 Plotted By: BÖige 06/29/2006 [Thu 4:14pm]
 24x36 / PLOT SCALE: 1"=1'

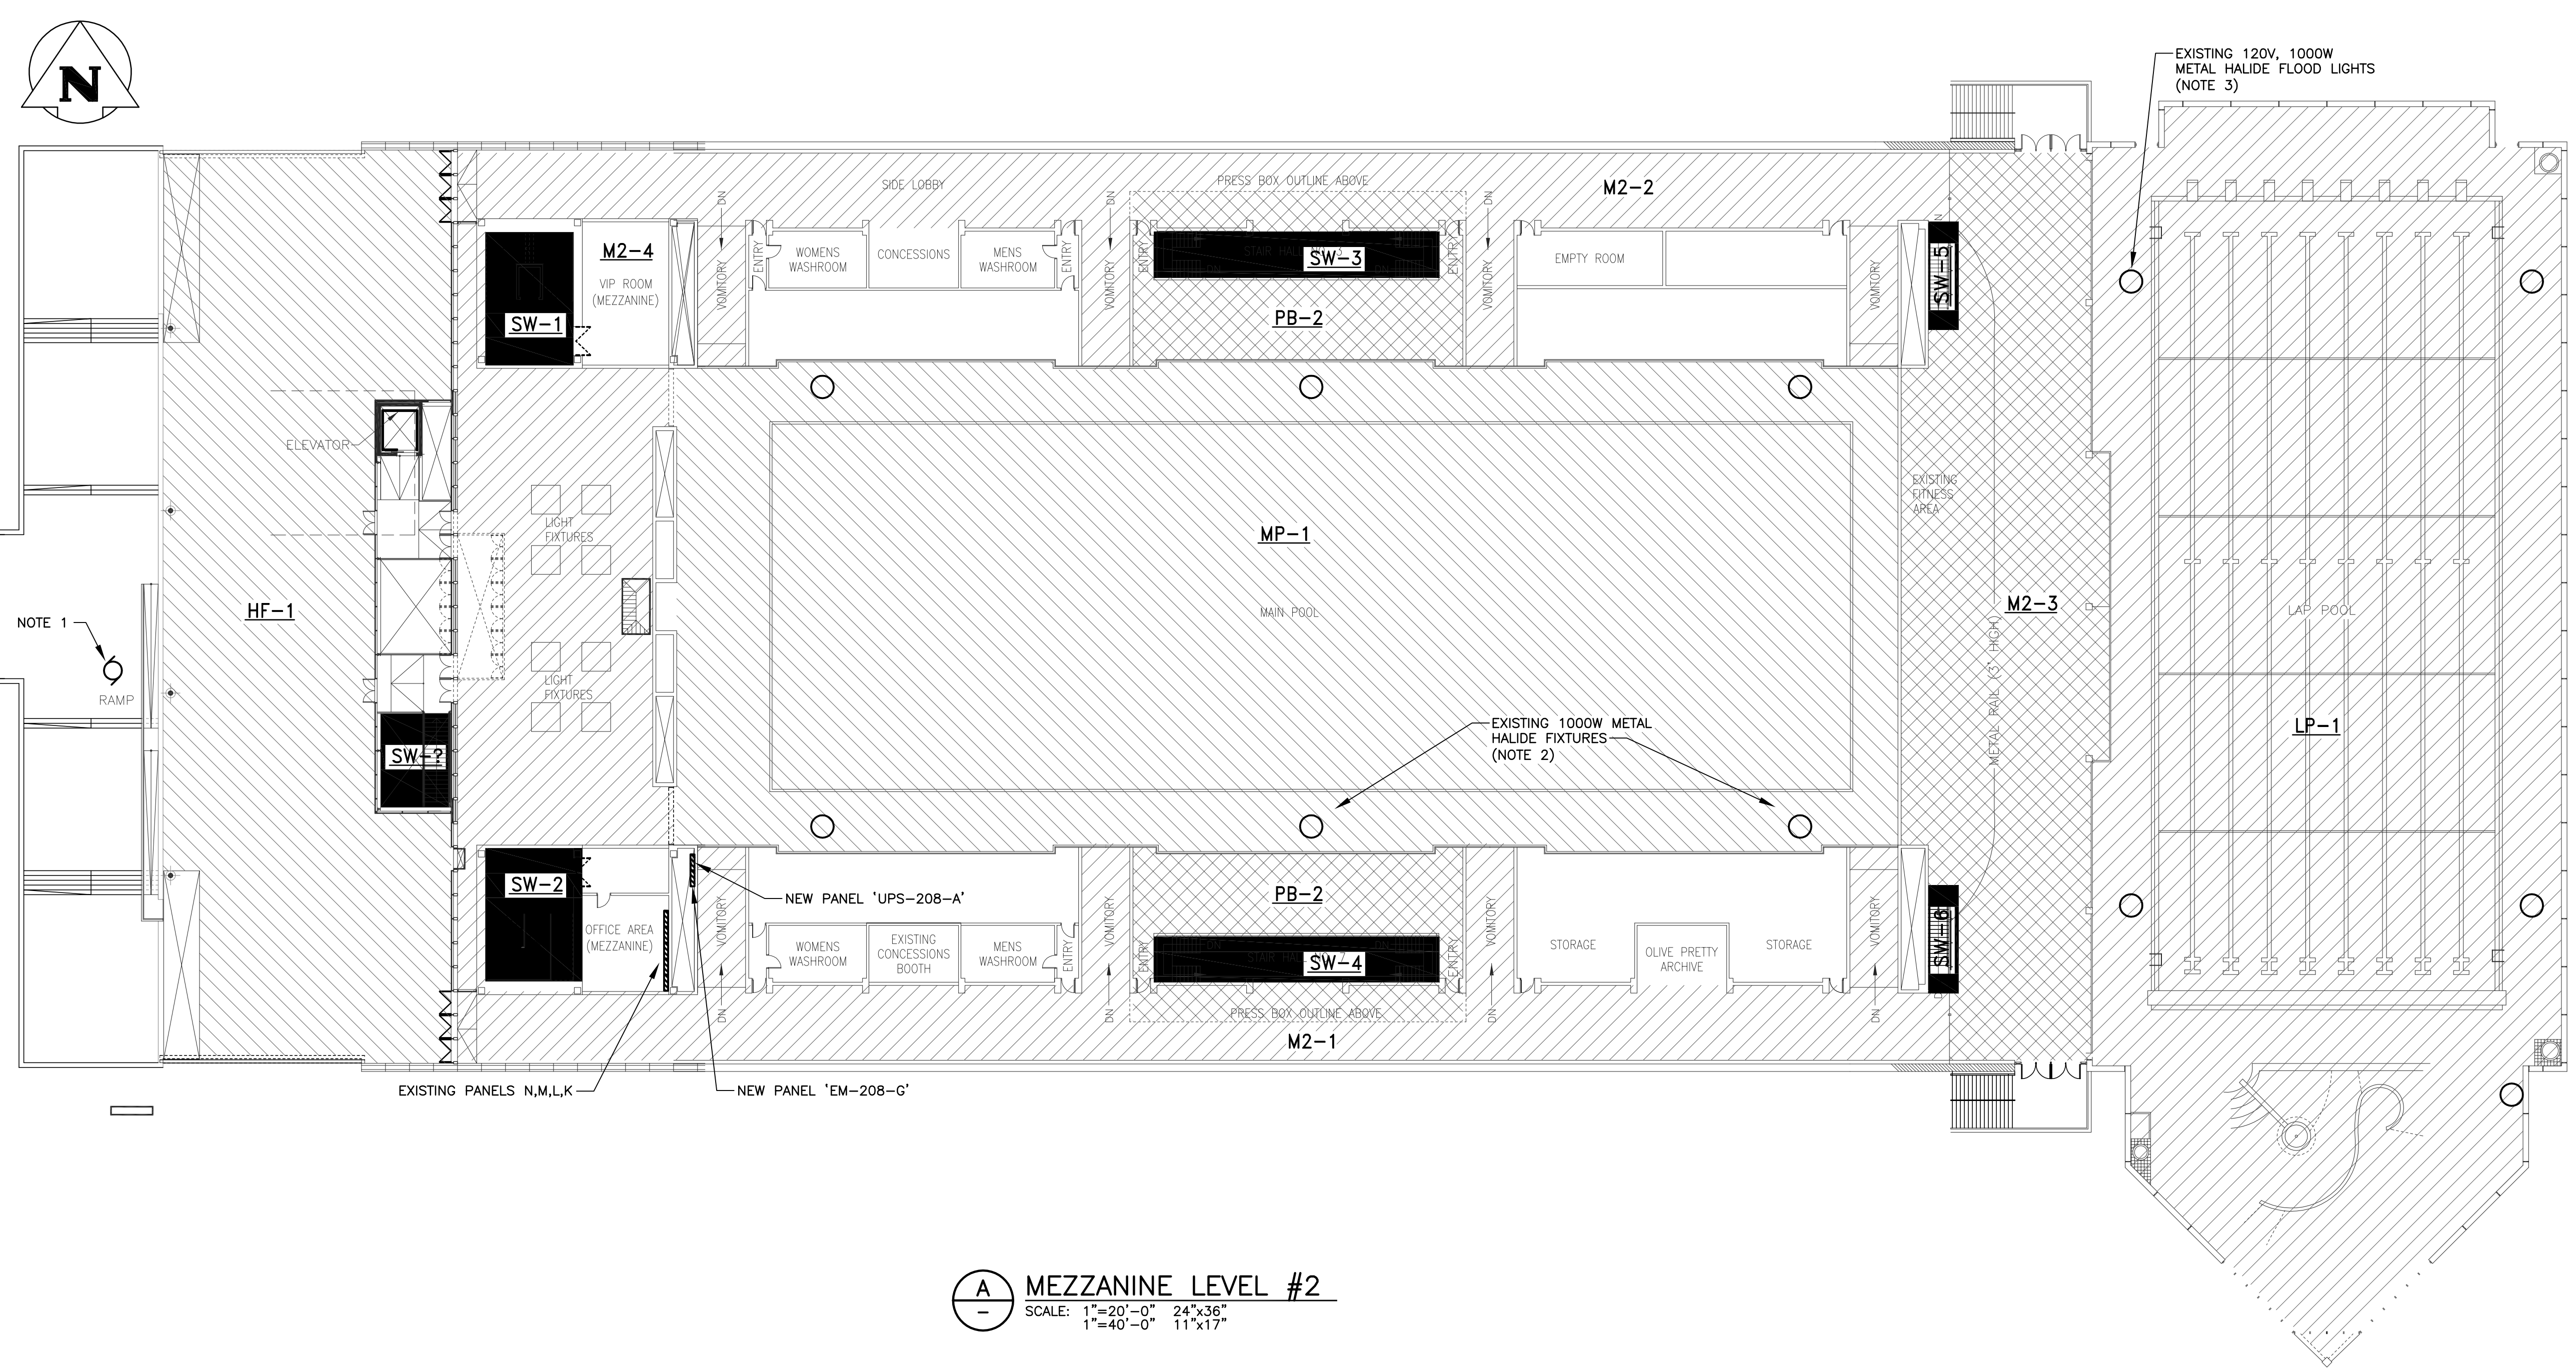

- NOTES:**
1. PROVIDE NEW 15A CIRCUIT FOR EXISTING LIFT, PANEL EM-208-F.
 2. EXISTING 1000W, 208V MANITOBA HYDRO FIXTURES. PROVIDE 208V CIRCUITS FROM NEW UPS PANEL UPS-208-A. BALLASTS ARE REMOVED ONTO CATWALK NEAR FIXTURES. MARK ALL EMERGENCY FIXTURES WITH RED LAMACOIDS TO BE VISIBLE FROM POOL DECK LEVEL.
 3. EXISTING 1000W MANITOBA HYDRO FLOOD LIGHTS. PROVIDE ONE CIRCUIT EACH FOR NINE FIXTURES SHOWN FROM NEW PANEL UPS-208-B. MARK ALL EMERGENCY FIXTURES WITH RED LAMACOIDS TO BE VISIBLE FROM POOL DECK LEVEL.

A MEZZANINE LEVEL #2
 SCALE: 1"=20'-0" 24"x36"
 1"=40'-0" 11"x17"

SEE NOTE 7 ON DRAWING E2

| AREA No. | DESCRIPTION | FIXTURES / CIRCUITS | EM PANEL | NO. OF CIRCUITS |
|----------|--------------------------------------|--|-----------|-----------------|
| HF-1 | HALL OF FAME | 2 CIRCUITS | EM-208-G | 2 |
| LP-1 | LAP POOL | 5 FIXTURES | UPS-208-B | 5 |
| PB-1 | SOUTH PRESS BOX | ONE LIGHTING CIRCUIT | EM-208-G | 1 |
| PB-2 | NORTH PRESS BOX | ONE LIGHTING CIRCUIT | EM-208-G | 1 |
| M2-1 | MEZZANINE LEVEL 2 - SOUTH SIDE LOBBY | 2x2x4 (2 LAMPS EACH) | EM-208-G | 3 |
| M2-2 | MEZZANINE LEVEL 2 - NORTH SIDE LOBBY | 2x2x4 (2 LAMPS EACH) | EM-208-G | 3 |
| M2-3 | MEZZANINE LEVEL 2 - FITNESS AREA | ONE CIRCUIT FOR WEIGHT RM., 3 FOR CORR. LTG. | EM-208-G | 4 |
| M2-4 | STAIRWELL No.n (VIP) | EXISTING - CORRIDOR LIGHTING | EM-208-G | 1 |
| MP-1 | MAIN POOL AREA | 3 HID PER SIDE | UPS-208-A | 6 (208V) |
| SW-1 | STAIRWELL No.1 (NORTHWEST) | SEE NOTE 2, DRAWING E3 | EM-208-G | 1 |
| SW-2 | STAIRWELL No.2 (SOUTHWEST) | SEE NOTE 2, DRAWING E3 | EM-208-G | 1 |
| SW-3 | STAIRWELL No.3 (NORTH CENTRAL) | ALL FIXTURES | EM-208-G | 1 |
| SW-4 | STAIRWELL No.4 (SOUTH CENTRAL) | ALL FIXTURES | EM-208-G | 1 |
| SW-5 | STAIRWELL No.5 (NORTHEAST) | ALL FIXTURES | EM-208-G | 1 |
| SW-6 | STAIRWELL No.6 (SOUTHEAST) | ALL FIXTURES | EM-208-G | 1 |

| | | | |
|---|-----------|--|----|
| 0 | 30/06/06 | ISSUED FOR TENDER | |
| NO. | D / M / Y | DESCRIPTION | BY |
| REVISIONS / ISSUE | | | |
| A | | A. SECTION LETTER OR DETAIL NUMBER IS DRAWN | A |
| B | | B. DRAWING WHERE SECTION OR DETAIL WAS INDICATED | - |
| - SECTION OR DETAIL SHOWN ON SAME DRAWING | | | |

KGS GROUP CONSULTING ENGINEERS & PROJECT MANAGERS
 WINNIPEG (204) 896-1209
 THUNDER BAY (807) 345-2233

CLIENT: CITY OF WINNIPEG
 PUBLIC WORKS DEPARTMENT

PROJECT: INSTALLATION OF EMERGENCY GENERATOR AT PAN-AM POOL - 25 POSEIDON BAY
 TENDER No. 404-2006

DWG. DESCRIPTION: ELECTRICAL MEZZANINE LEVEL #2

| | | |
|-------------------------|-----------------|---------------|
| ENG. STAMP: | DESIGNED BY: AP | DRAWN BY: GCN |
| APPROVED: | CHECKED: | CHECKED: |
| SCALE: AS NOTED | DATE: JUN/2006 | |
| KGS DWG. NO. 06-0107-08 | E4 | |
| CLIENT DWG. NO. | REV: 0 | |

APEGM
 Certificate of Authorization
 KGS Group
 No. 245 Expiry: April 30, 2007