


- Type "B" vent materials must be used outdoors.
 - An insulating thimble is required to pass through combustible structures.

1 VENTING DETAIL
 M2.2 SCALE: N.T.S.

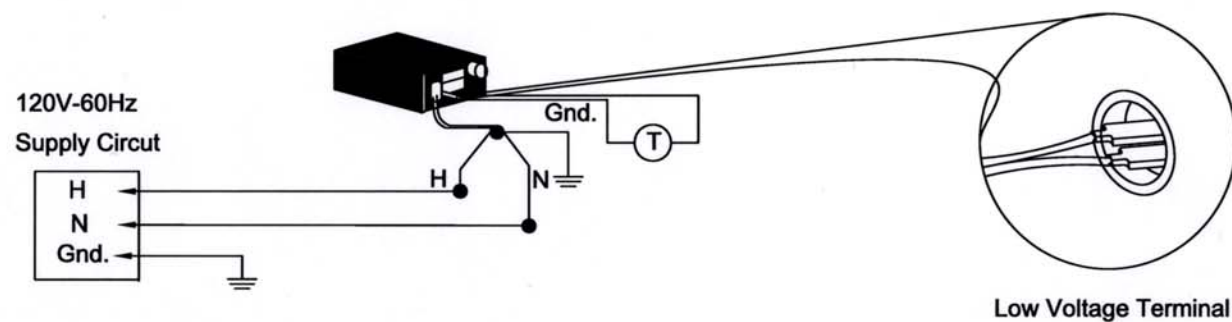

2 LOW VOLTAGE THERMOSTAT WIRING
 M2.2 SCALE: N.T.S.

HVAC SYMBOLS

	MANUAL BALANCING DAMPER
	FIRE DAMPER & ACCESS DOOR
	MOTORIZED DAMPER, BLADES PARALLEL W/ FLOOR UNLESS NOTED OTHERWISE
	TURNING VANES
	THERMAL INSULATION
	FLEXIBLE DUCT CONNECTION
	DIFFUSER TAG / GRILLE TAG
	EQUIPMENT TAG
	GENERAL NOTE
	THERMOSTAT
	DOOR GRILLE
	SQUARE DIFFUSER
	ROUND DIFFUSER
	TRANSFER GRILLE
	DRAWING HEADER



epp siepman engineering inc.
 mechanical engineers
 303-100 Osborne St. South Winnipeg, MB R3L 1Y5
 p 204.453.1080 f 204.453.1335 ese@eppsiepman.com

