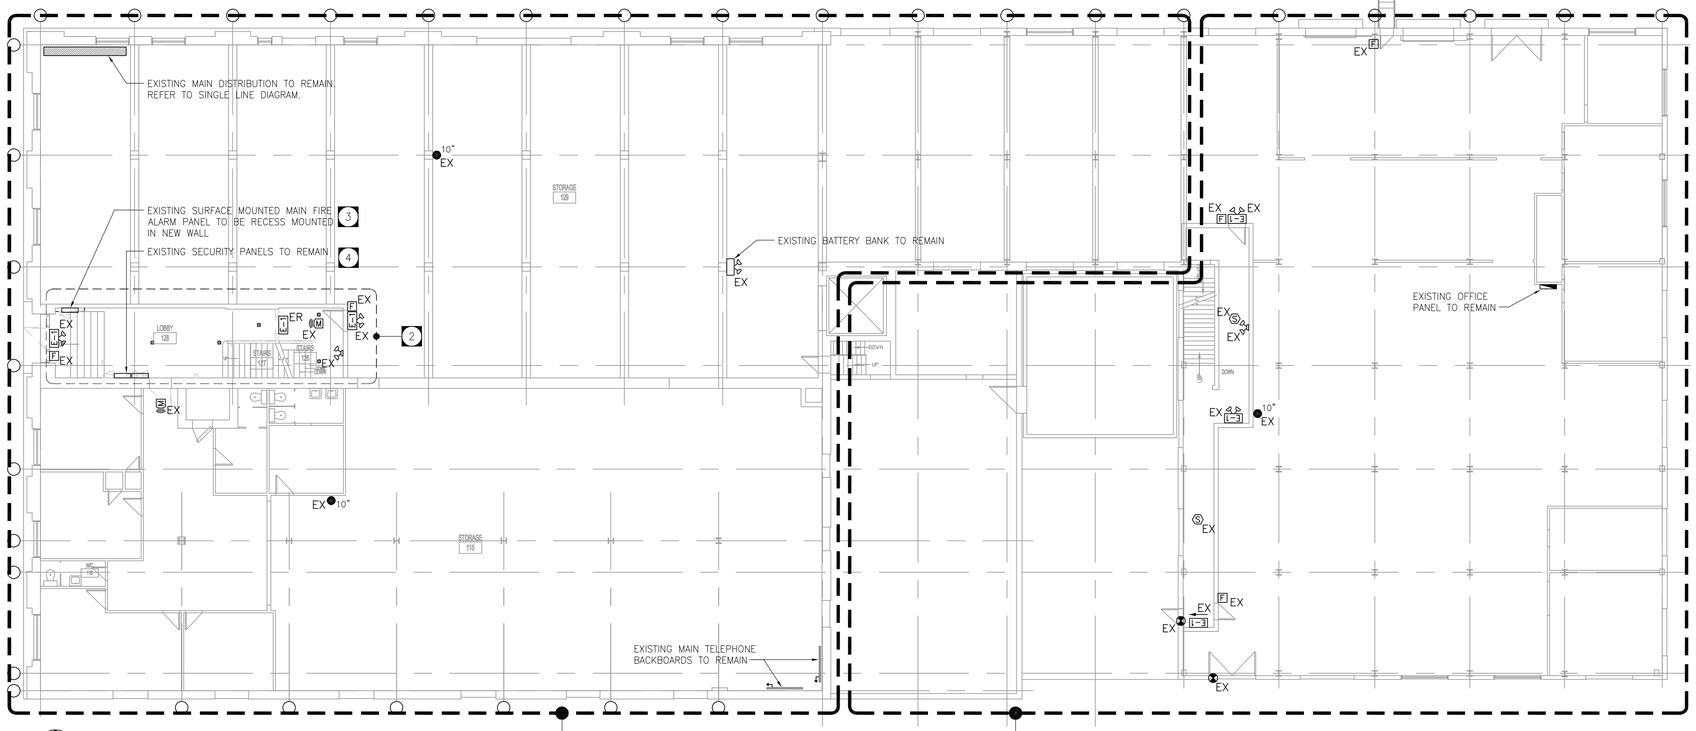

DEMOLITION PLAN - MAIN FLOOR

SCALE: 3/32"=1'-0"

N.I.C. (NOT IN CONTRACT)

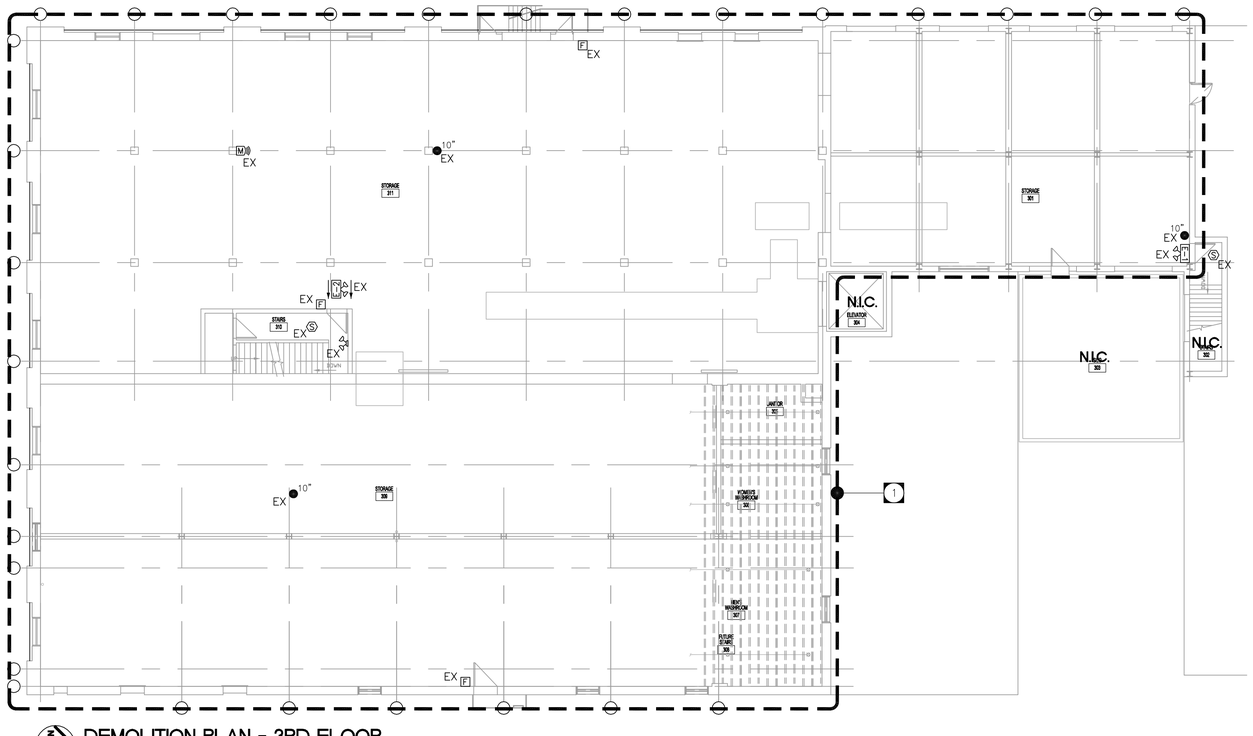

DEMOLITION PLAN - 3RD FLOOR

SCALE: 3/32"=1'-0"

DRAWING NOTES:

1. REFER TO ARCHITECTURAL DRAWINGS AND SPECS FOR OVERALL SCOPE OF WORK. THIS AREA TO BE RENOVATED. RELOCATE ALL EXISTING DEVICES/OUTLETS AND EQUIPMENT WHEREVER POSSIBLE FOR NEW CONSTRUCTION, OTHERWISE PROVIDE NEW AS SHOWN OR INDICATED. DISCONNECT AND REMOVE ALL UNUSED LIGHTING, DEVICES, OUTLETS, CONDUITS AND ALL ASSOCIATED WIRING BACK TO RESPECTIVE PANELS UNLESS OTHERWISE NOTED. REFER TO ELECTRICAL DRAWINGS E-2.0 THROUGH E-5.0 FOR NEW/RELOCATED LOCATIONS OF EXISTING OUTLETS/DEVICES. THIS DRAWING DOES NOT INDICATE EVERY EXISTING DEVICE.
2. MAKE ALL PROVISIONS TO RELOCATE/RE-ROUTE OR REMOVE ALL EXISTING SURFACE MOUNTED ELECTRICAL WIRING, CABLES, CONDUITS AND JUNCTION BOXES AND RECESS IN WALLS AND ABOVE CEILING SPACE. ENSURE ALL EXISTING AND NEW WIRING AT THIS AREA TO BE INSTALLED IN A NEAT & UNCLUTTERED MANNER. DO NOT EXPOSED WIRING ON WALL AND CEILING. REMOVE ALL UNUSED ELECTRICAL DEVICES AND ASSOCIATED WIRING BACK TO RESPECTIVE PANEL.
3. MAKE ALL PROVISIONS TO RE-INSTALL THE EXISTING SURFACE MOUNTED MAIN FIRE ALARM PANEL TO RECESS MOUNT AT THE SAME LOCATION. COORDINATE ALL WORKS WITH CONTRACT ADMINISTRATOR ON SITE. REFER TO DETAIL 1/E0.0 THIS SHEET.
4. MAKE ALL PROVISIONS TO RELOCATE THE EXISTING SECURITY PANELS & ASSOCIATED HARDWARE/DEVICES (IF REQUIRED) TO SUIT NEW MILLWORK INTENDED TO CONCEAL SECURITY EQUIPMENT. COORDINATE ALL WORK WITH CONTRACT ADMINISTRATOR ON SITE. REFER TO DETAIL 1/E-0.0 THIS SHEET.

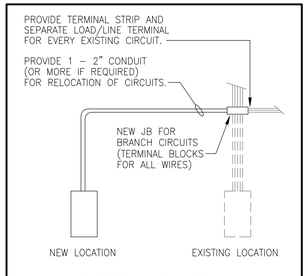

1 / E0.0 **TYPICAL PANEL RELOCATION DETAIL**

NTS

DRAWING LIST

E-0.0	ELECTRICAL DEMOLITION PLAN
E-1.0	ELECTRICAL LIGHTING LAYOUT – MAIN FLOOR PLAN
E-1.1	ELECTRICAL LIGHTING LAYOUT – THIRD FLOOR PLAN
E-2.0	ELECTRICAL POWER & SYSTEM LAYOUT – MAIN FLOOR PLAN
E-2.1	ELECTRICAL POWER & SYSTEM LAYOUT – THIRD FLOOR PLAN
E-3.0	ELECTRICAL SCHEDULES
E-4.0	ELECTRICAL SINGLE LINE DIAGRAM
E-5.0	ELECTRICAL SPECIFICATIONS

LEGEND

A	STRIP FLUORESCENT LIGHT (A DENOTES TYPE)
B	1'x4' FLUORESCENT LIGHT (B DENOTES TYPE)
F	H.I.D. OR INCANDESCENT FIXTURE (F DENOTES TYPE)
NL	LIGHT FIXTURE ON NIGHT LIGHT CIRCUIT
	EMERGENCY LIGHT (REMOTE – 2 HEADS)
E-1	EXIT LIGHT C/W DIRECTIONAL ARROWS AS SHOWN
	EMERGENCY BATTERY BANK UNIT C/W HEAD LIGHTS
$3	SINGLE POLE SWITCH (3 DENOTE 3 WAY SWITCH)
	DUPLEX RECEPTACLE
	DIRECT CONNECT
	POWER PANELBOARD – SURFACE MOUNT/FLUSH MOUNT
	SYSTEM PANELBOARD – SURFACE MOUNT/FLUSH MOUNT
	TELEPHONE OUTLET
	TELEPHONE BACKBOARD
	MOTOR CONNECTION
	DISCONNECT SWITCH
B1000	BASEBOARD HEATER (1000 DENOTES 1000 WATTS)
	FORCE FLOW HEATER
	UNIT HEATER
T	THERMOSTAT
JB	JUNCTION BOX (CEILING OR WALL MOUNTED)
S	SMOKE DETECTOR (ADDRESSABLE)
H	HEAT DETECTOR (COMBINATION)
F	MANUAL PULL STATION
10"	FIRE ALARM BELL (10")
	DOOR CONTACT (FLUSH IN FRAME)
M	MOTION DETECTOR (SECURITY)
EX	EXISTING TO REMAIN
ER	EXISTING TO BE REMOVED/RELOCATED
R	RELOCATED EXISTING (SHOWN IN NEW LOCATION)

ORIGINAL STAMPED BY: T. TONTHAT, P. ENG.
DATE: 2006.11.30

NO.	REVISION/DESCRIPTION	DATE	BY
1	ISSUED FOR TENDER	11/30/06	TT
0	ISSUED FOR REVIEW	11/28/06	TT

DRAWN BY LAN | CHECKED BY TT | APPROVED BY TT

CONSULTANT

These design documents are prepared solely for the use by the party with whom the design professional has entered into a contract and there are no representations of any kind made by the design professional to any party with whom the design professional has not entered into a contract. Any use of the drawing, disk or electronic data without the expressed written permission of Tower Engineering Group is strictly prohibited.
The contractor is responsible to verify all dimensions with conditions on the site and report discrepancies to Tower Engineering for adjustment.
All prints to be returned.

TOWER PROJECT NO. :6179

TOWER ENGINEERING GROUP
208 – 897 CORYDON AVE. WINNIPEG, MB R3M 0W7
TEL: (204) 925-1150 FAX: (204) 925-1155
EMAIL: towereng@towereng.ca WEB: www.towereng.ca

DATE YEAR.MM.DD USER APPROVAL

CITY OF WINNIPEG
PLANNING, PROPERTY & DEVELOPMENT DEPARTMENT
CIVIC ACCOMMODATIONS DIVISION
300 – 65 GARRY ST. R3C 4K4

PROJECT
City of Winnipeg Surplus Storage Facility

311 ROSS AVENUE

SEALS

APEGM Certificate of Authorization
Tower Engineering Group
No. 1918 Expiry: April 30, 2007

SHEET TITLE
ELECTRICAL DEMOLITION PLAN

SCALE	PROJECT NO.	SHEET NO.
AS SHOWN	6179	E-0.0

DRAWING SHEET SIZE: A1 (841mm x 594mm) PLOT 1:1

FILE NAME: DATE: DESCRIPTION: PROJECT No: ADDRESS: