


B SIZE - 279mm x 432mm

LAST SAVE: 2012/02/24 - 7:46am
 PATH: M:\508042\4ENG\48&C\DD - General DWG\1-0164L-A0046-001-00.dwg

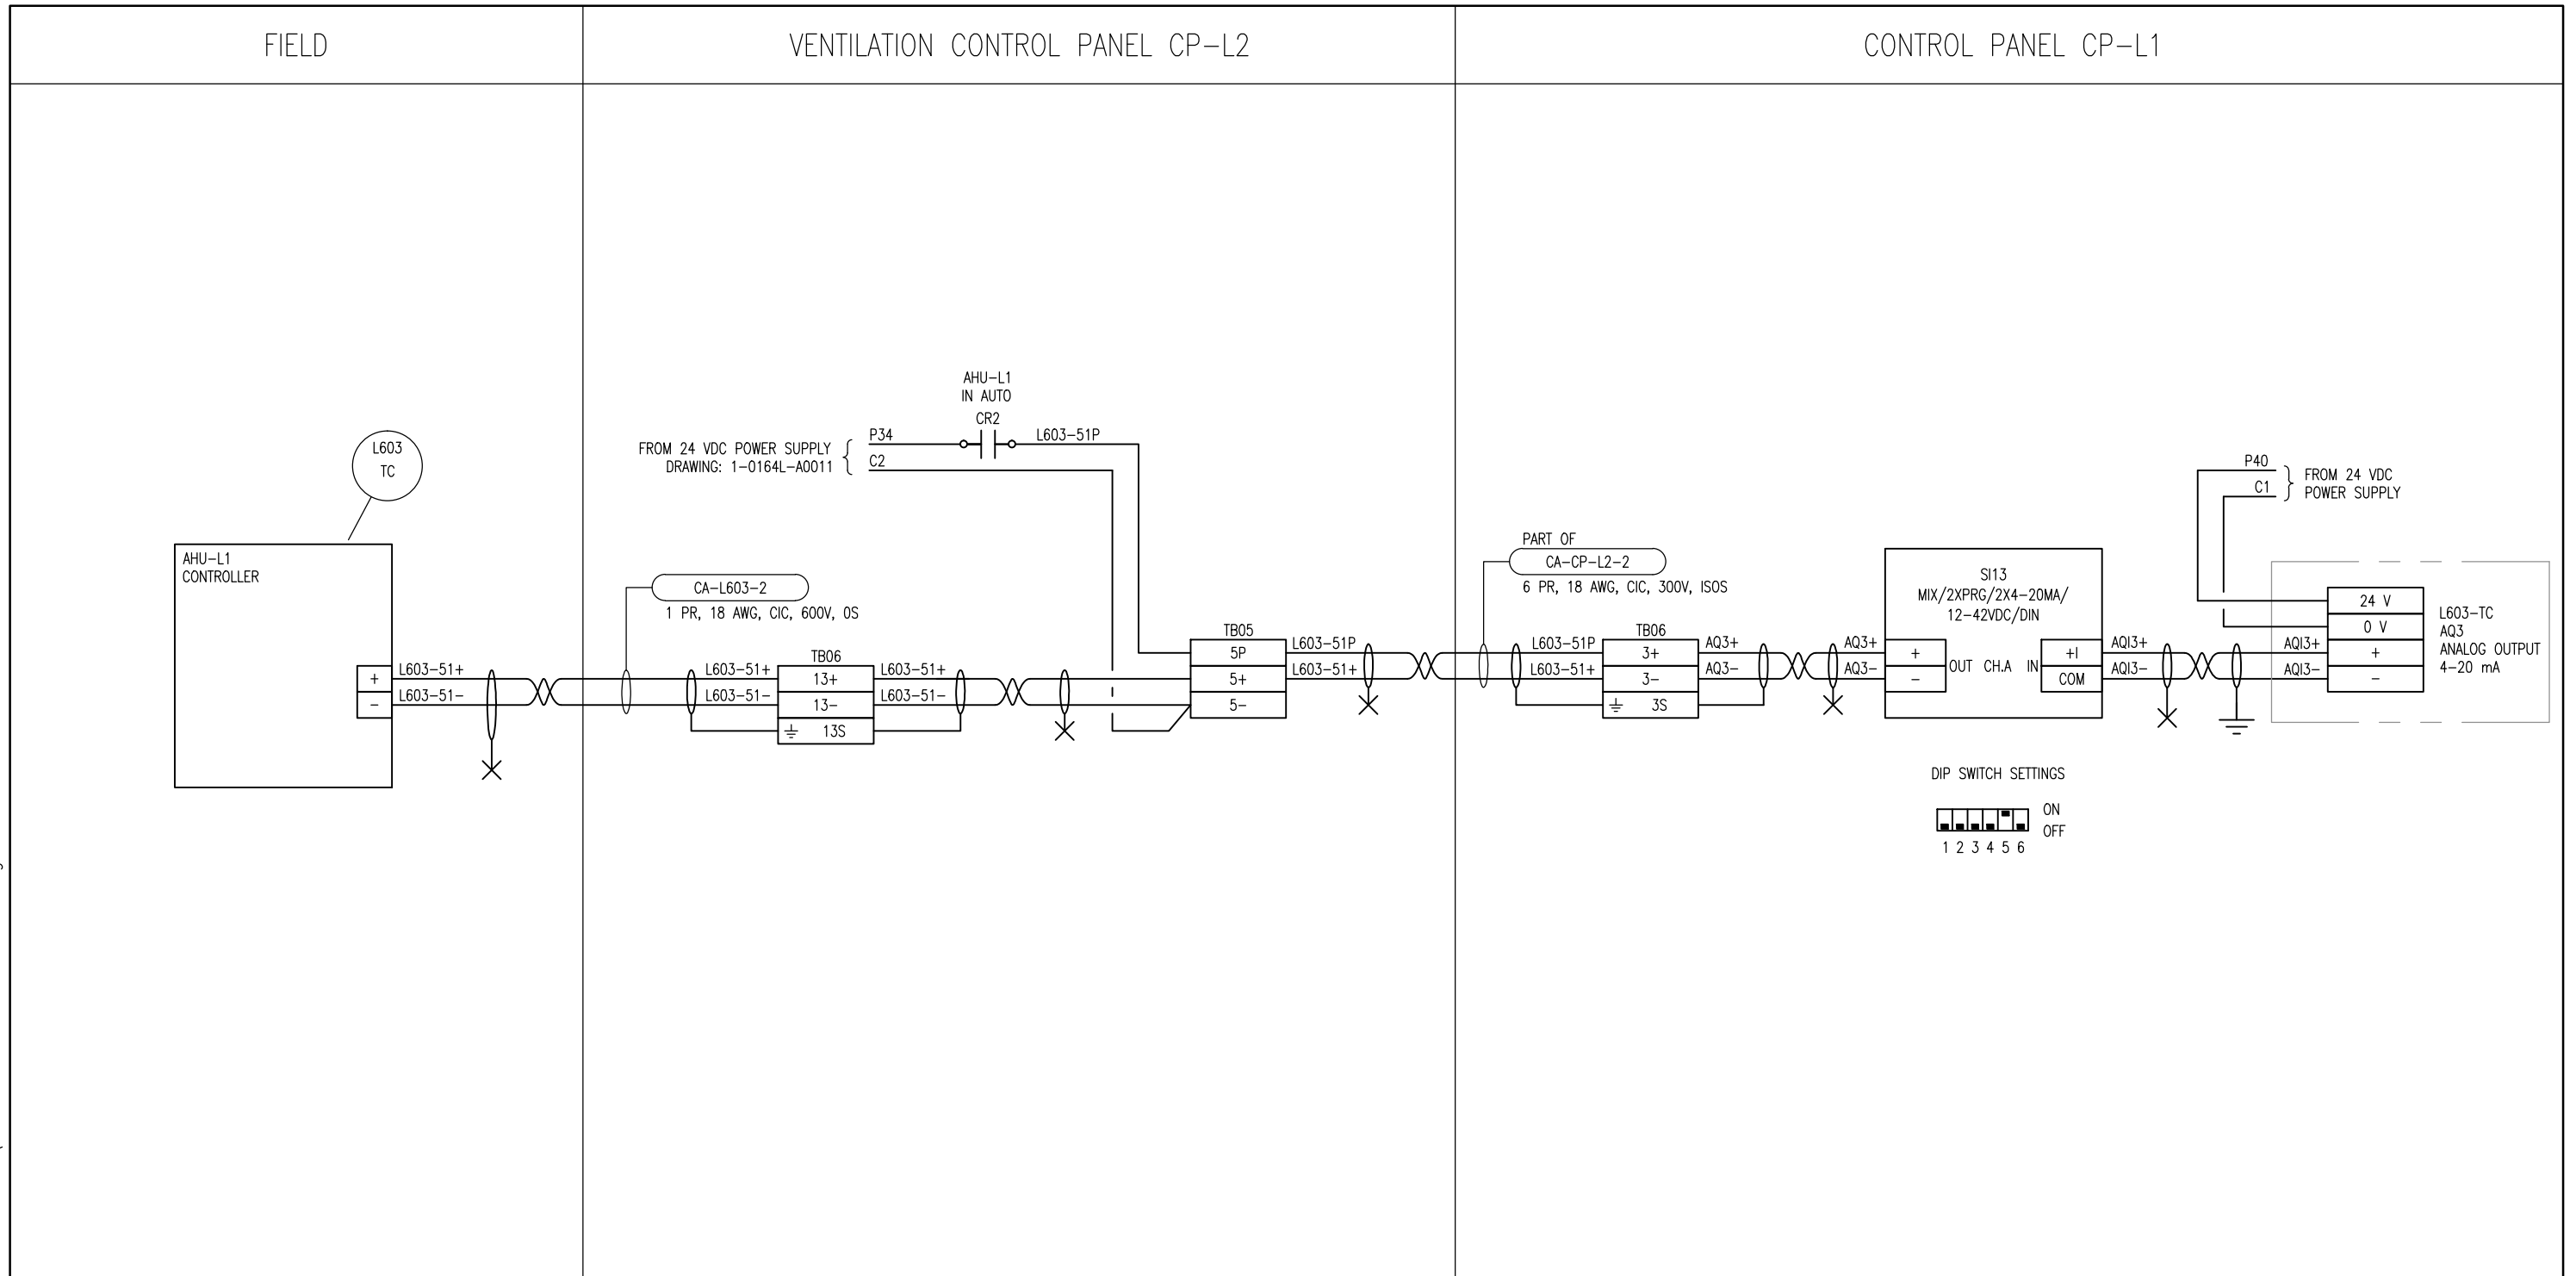

NOTES

- SEE DRAWING: 1-0164L-A0045.
- THE AHU-L1 INPUT IS BY DEFAULT A 500 OHM LOAD.

APECM
 Certificate of Authorization
 SNC-Lavalin Inc.
 No. 4489

SNC-LAVALIN				
00	ISSUED FOR TENDER, BID OPP. 907-2011	2011/11/04	BC	CJR
NO.	REVISIONS	DATE	DESIGN	CHECK

SNC-LAVALIN INC.
 148 Nature Park Way
 Winnipeg, MB, Canada R3P 0X7
 204-786-8080

DESIGNED BY: **B. CLEVEN**
 CHECKED BY: **C. REIMER**

DRAWN BY: **S. FUNK**
 APPROVED BY: **C. REIMER**

SCALE: **NTS**
 DATE: **2011/08/31**

RELEASED FOR CONSTRUCTION
 BY: **K. R. ZUREK** DATE: **2012/02/23**

CONSULTANT NO.: **508042-0000-48DD-0046**

ENGINEER'S SEAL

ORIGINAL DRAWING
 SEALED BY:
C. J. REIMER
 SNC-LAVALIN
 MEMBER # 21968
 2012/02/23
 REV. 00

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

MONTCALM WASTEWATER PUMPING STATION
 2011 UPGRADES
 LOOP DIAGRAM
 AHU-L1 DISCHARGE TEMPERATURE SETPOINT
 L603-TC

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0164L-A0046	001	00	B