



Pipes - Steel pipe not less than 0.3125 inches thick, except piece ① which is spiral welded not less than 0.5 inches thick. See specifications.
 Pipe coating - See specifications.
 4 spare welding flanges 24"

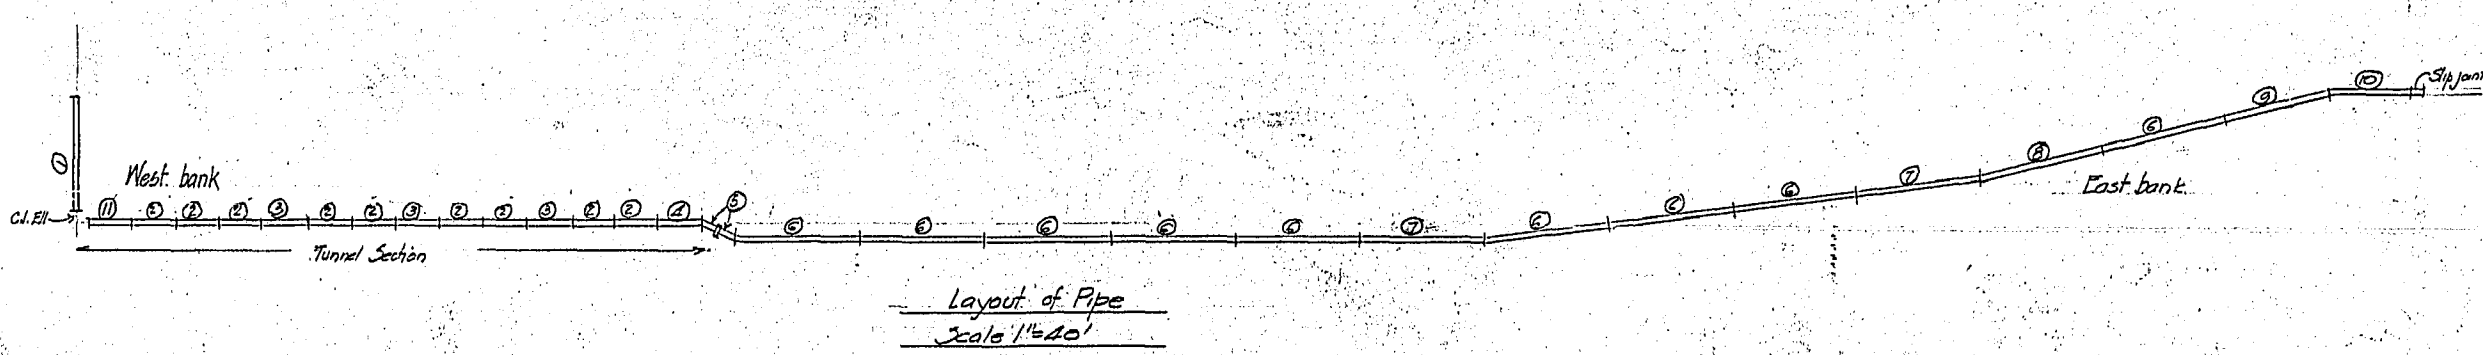

Water Main Crossing of Red River
 Redwood Avenue
 Steel Pipe Details

CITY OF WINNIPEG ENGINEERING DEPARTMENT		DRAWN BY	DATE	SCALE
W. D. HURST, CITY ENGINEER		TRACED BY		14'-1/8"
A. J. S. TAUNTON, DEPUTY CITY ENGINEER		CHECKED BY		DRAWING NO.
		APPROVED		12530