REF. or DRAWING No. 288 file # CS 10025

DETAILS

NOTE:
CONTRACTOR TO BE RESPONSIBLE FOR DIVERTING FLOW OF SEWAGE & PLUGGING STATION INLET DURING CONSTRUCTION. G.W.S.D. TO REMOVE STOP LOGS ON WEIR.

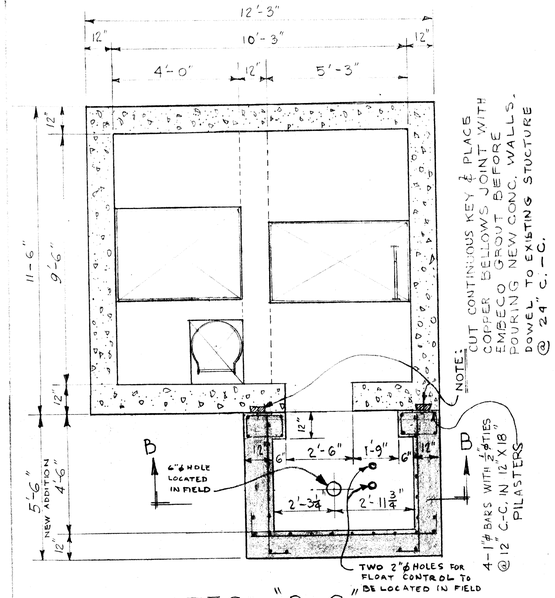

SEC "C-C"

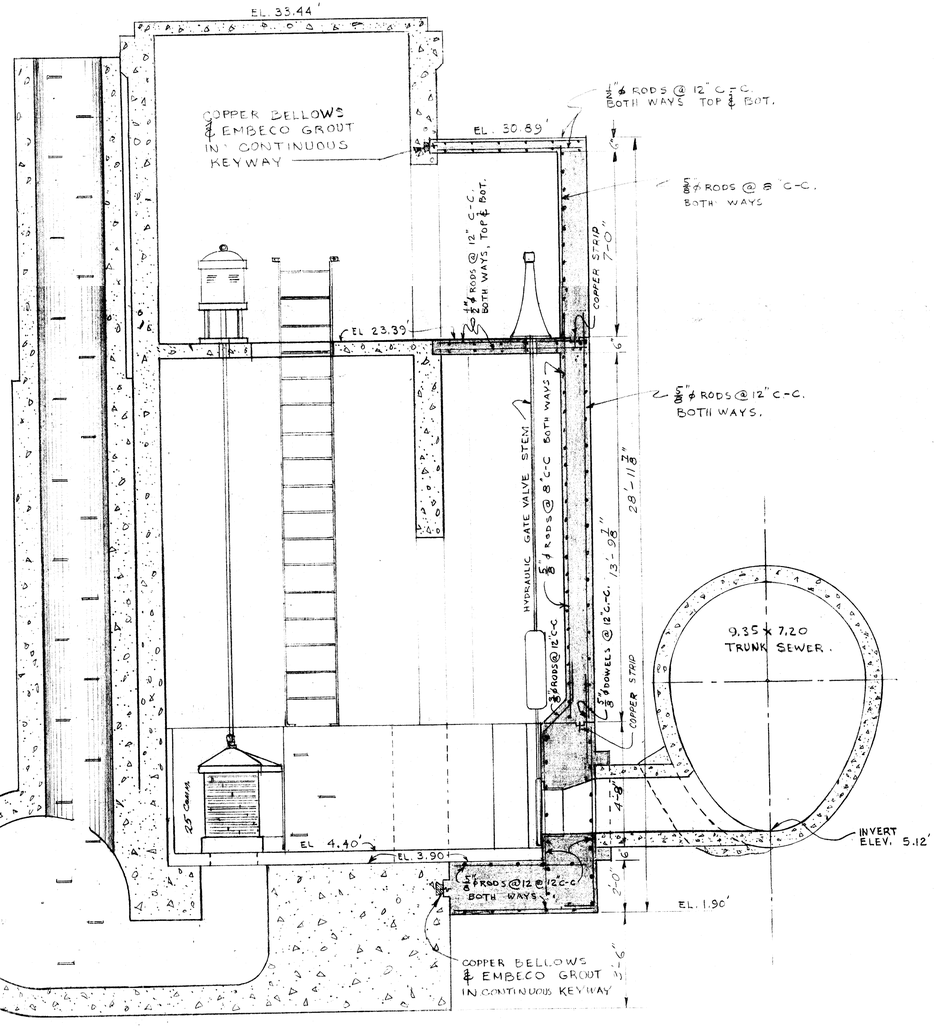

SEC. "A-A"

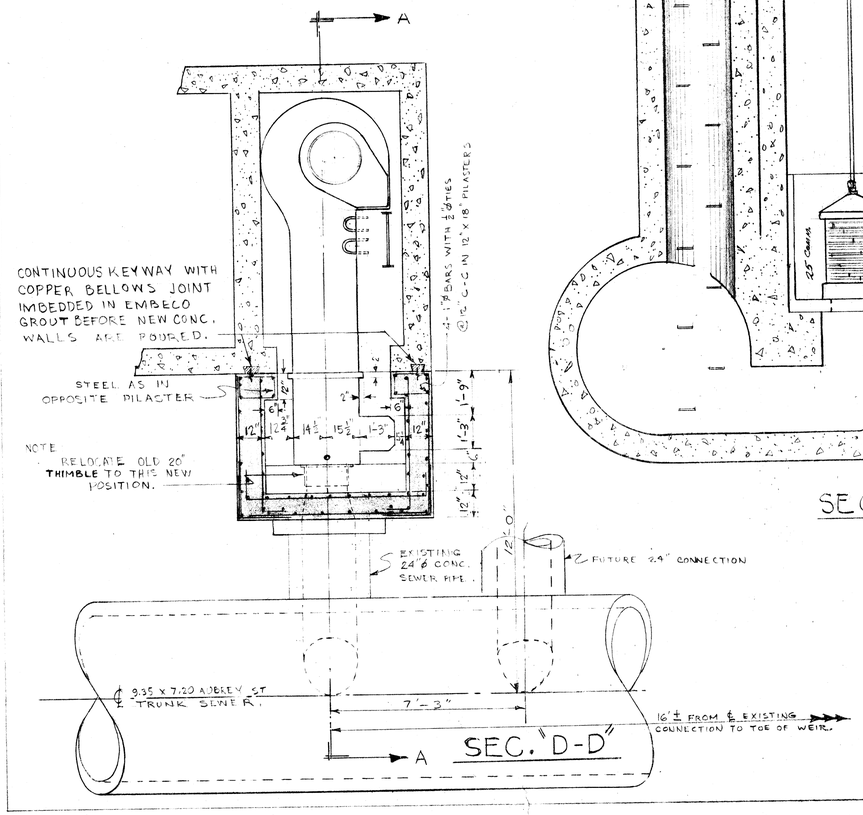

SEC. "D-D"

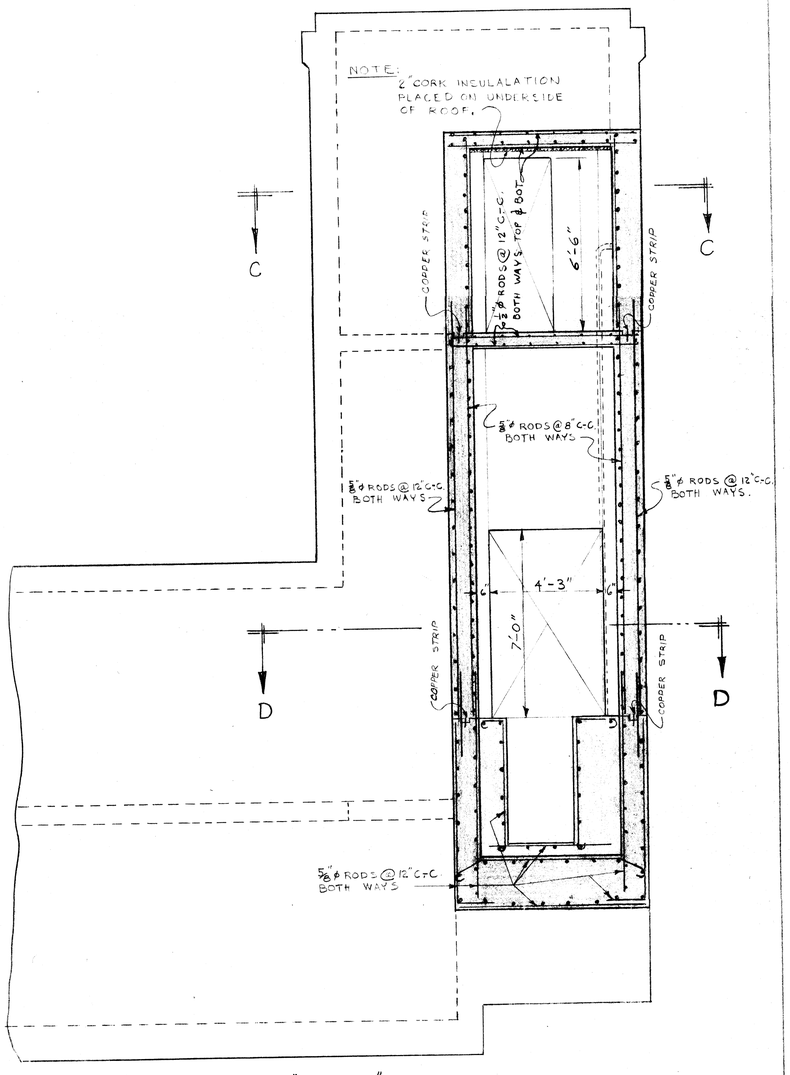

SEC. "B-B"

NOTE:
ADDITION TO STATION TO BE KEYED & DOWELED TO EXISTING STRUCTURE. WATER SEALS TO BE PROVIDED. DOWELS TO BE 5/8" ϕ BARS & ARE TO CONFORM TO REINFORCING PATTERN. MINIMUM COVER OF STEEL TO BE 2".

STRUCTURAL CONC. = 3,000 P.S.I. KALICRETE.
REINFORCING STEEL = 20,000 P.S.I. INTERMEDIATE GRADE, DEFORMED BARS.

PROVINCE OF MANITOBA
R. C. SOMMERVILLE
REGISTERED ENGINEER

Micro-Filmed 1965

GREATER WINNIPEG SANITARY DISTRICT

DRAWN HB DATE 6 JAN 56
TRACED CHECKED K.L.M.
APPROVED

SUPT.
GEN. MGR.

TITLE: EXTENSION TO AUBREY ST. COMM. STATION

SCALE 3/8" = 1'-0" | 288

288