




GROUND LEVEL

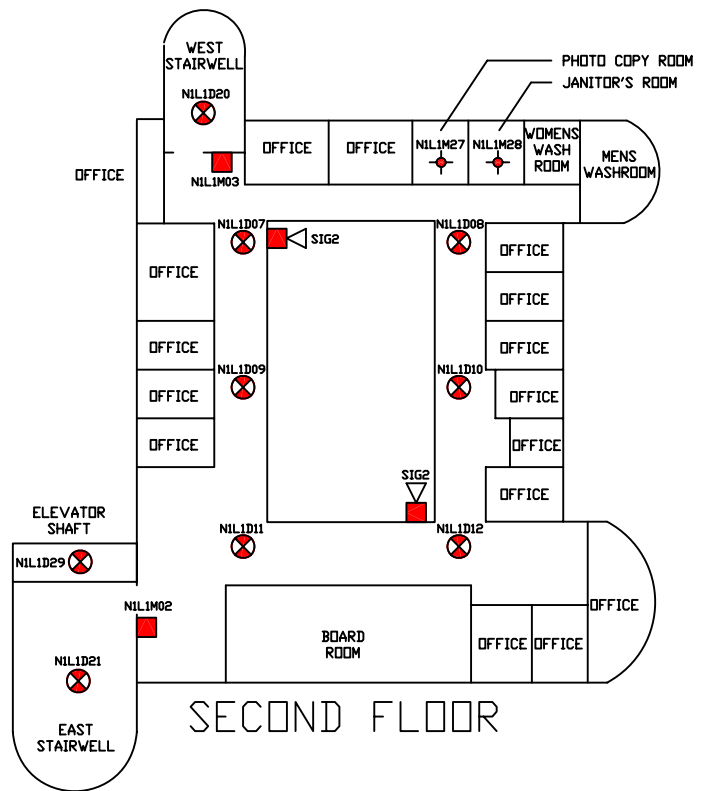

SECOND FLOOR

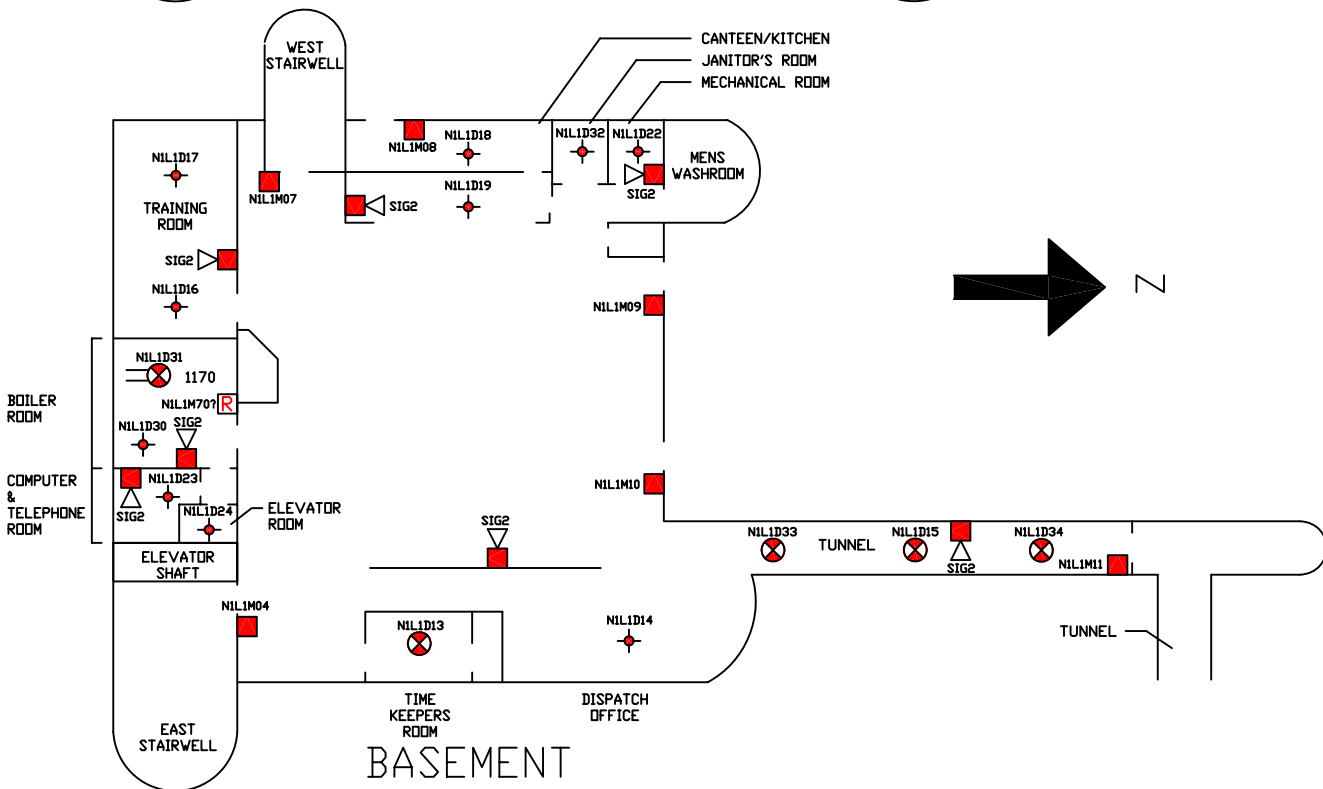

BASEMENT



LEGEND:

- PULL STATION C/W ADDRESSABLE MONITOR MODULE FMM-101A
- ADDRESSABLE HEAT DETECTOR FST-851A
- ADDRESSABLE SMOKE DETECTOR FSP-851A
- ADDRESSABLE DUCT SMOKE DETECTOR
- FIRE ALARM HORN
- FIRE ALARM HORN EXPLOSION PROOF
- FIRE ALARM HORN & STROBE
- SPRINKLER FLOW SWITCH
- SPRINKLER PRESURE SWITCH
- SPRINKLER TAMPER SWITCH

- ADDRESSABLE MONITOR MODULE FMM-1A
- ADDRESSABLE RELAY MODULE FRM-1A
- END OF LLINE RESISTOR
- N1L1M27 ADDRESSABLE DEVICE ADDRESS

FORT ROUGE GARAGE FIRE ALARM SYSTEM BUILDING A ADMINISTRATION AREA EQUIPMENT LAYOUT	REVISSION 0
	REF NO FRG_215
	DRAWING NO. FRG FA 01