


MAIN DISTRIBUTION (7) E-II

PANEL 'XX' (8) E-II

PANEL 'YY' (9) E-II


ELECTRICAL ROOM 03 LAYOUT (10) E-II

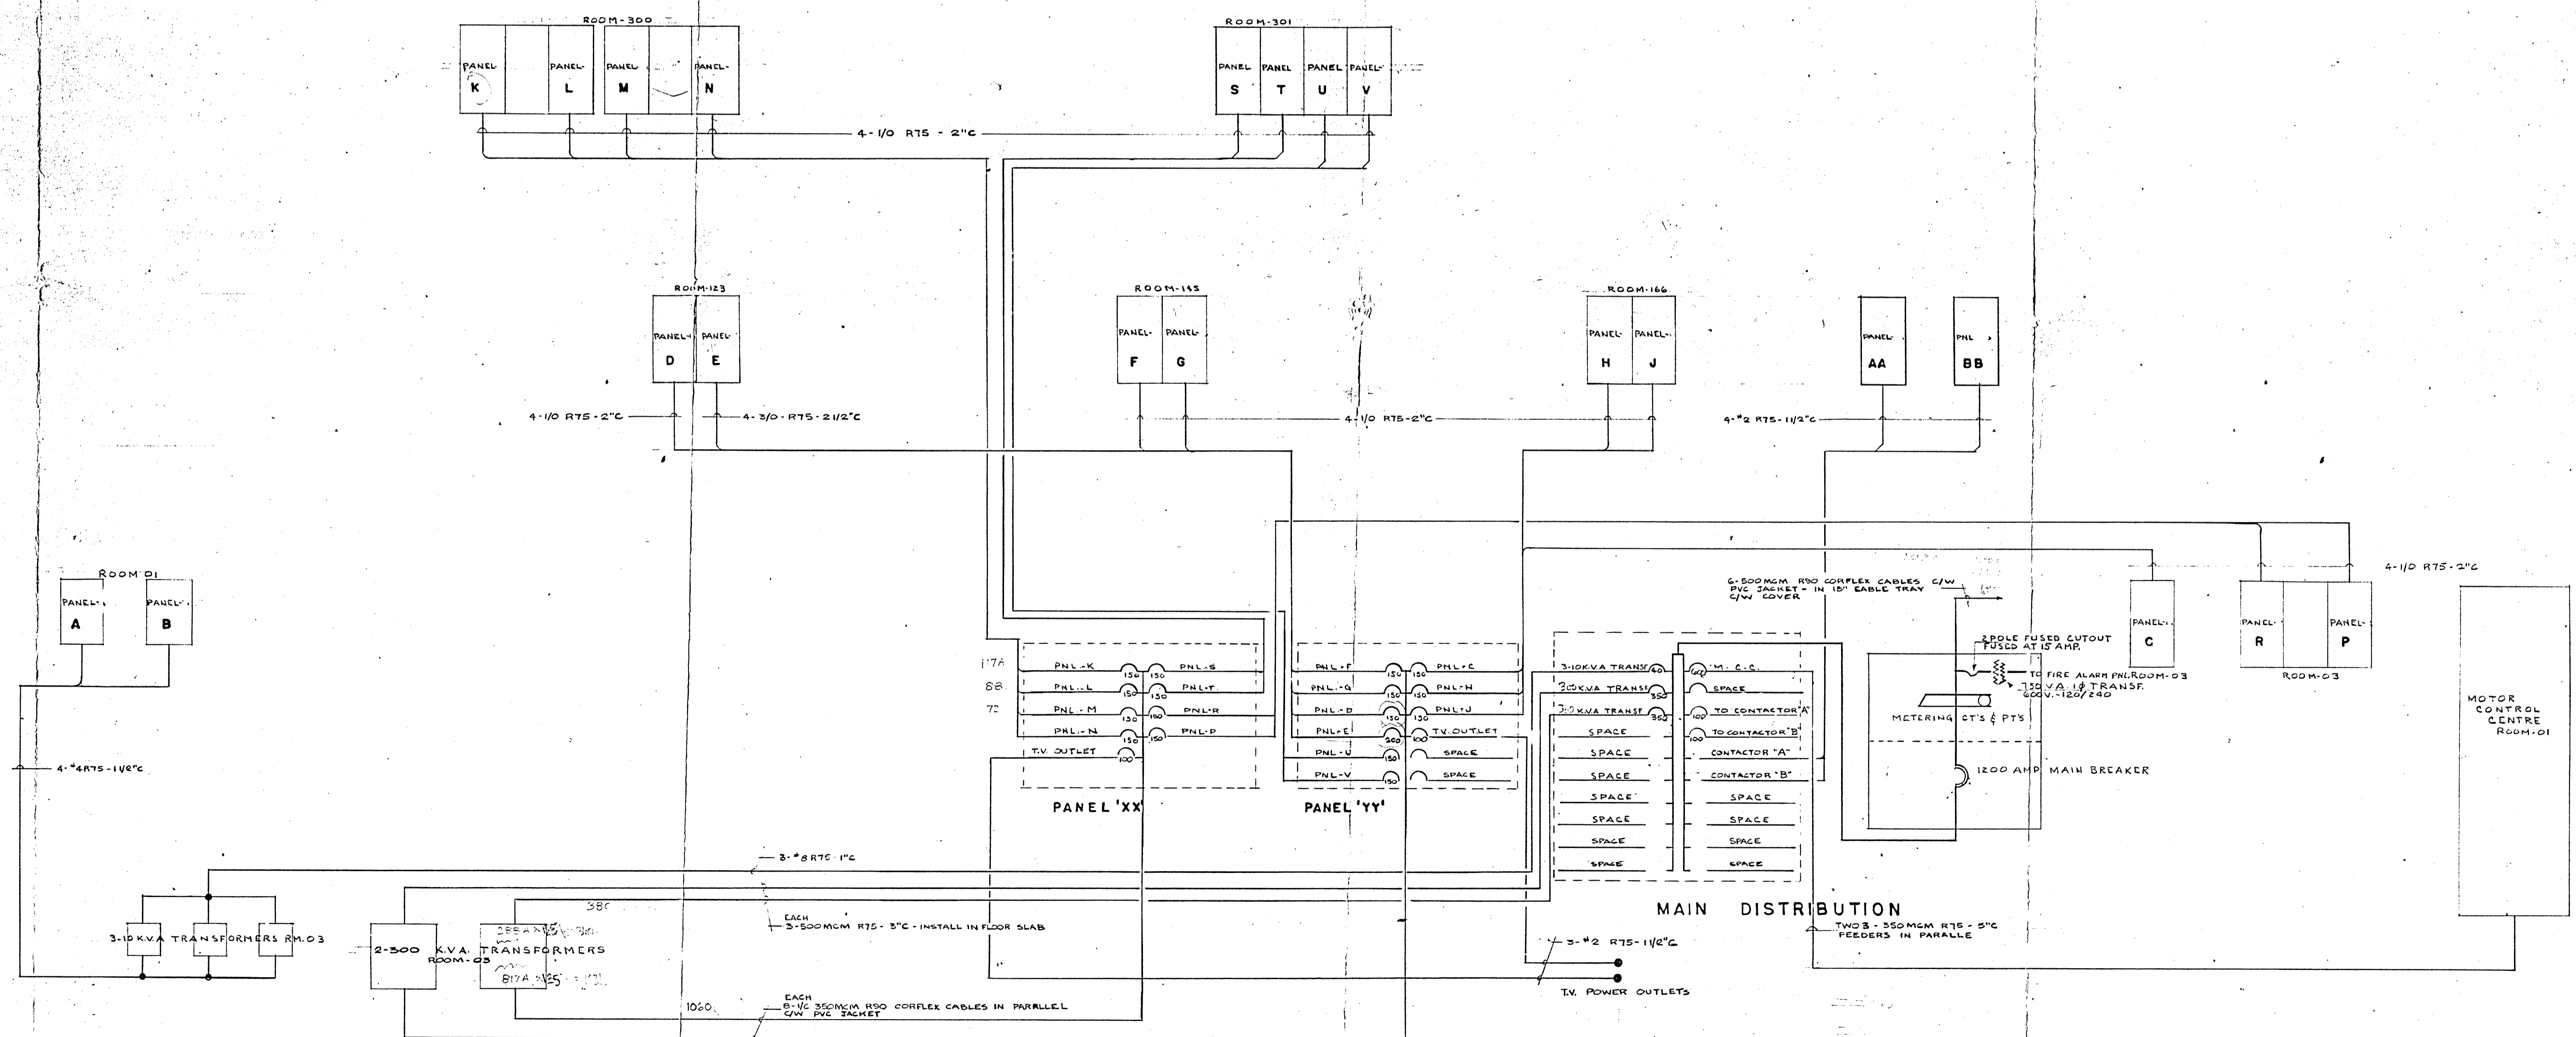


ELECTRICAL DISTRIBUTION (11) E-II

SEC. F	SEC. E	SEC. D
SEC. A	SEC. B	SEC. C

TOP VIEW

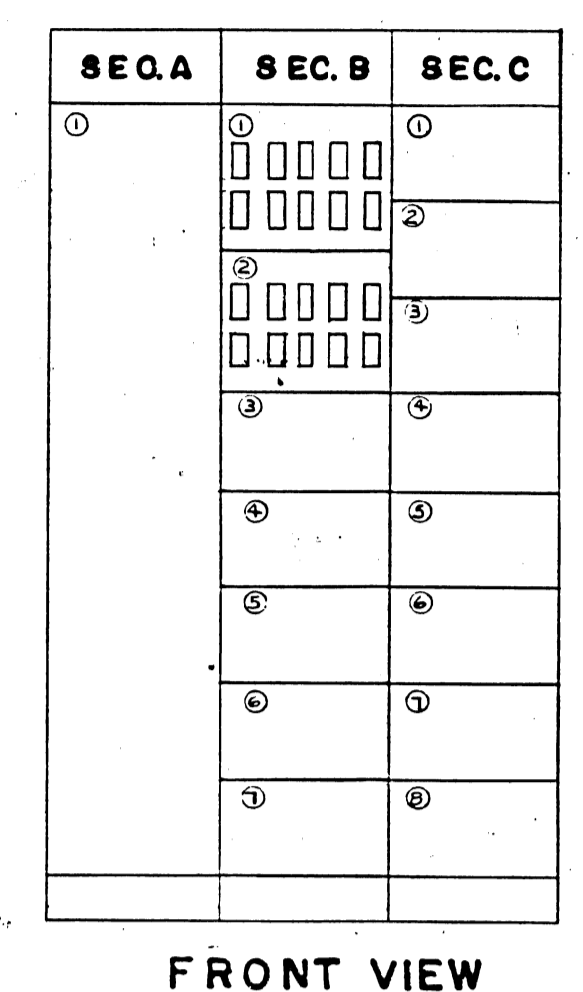

FRONT VIEW

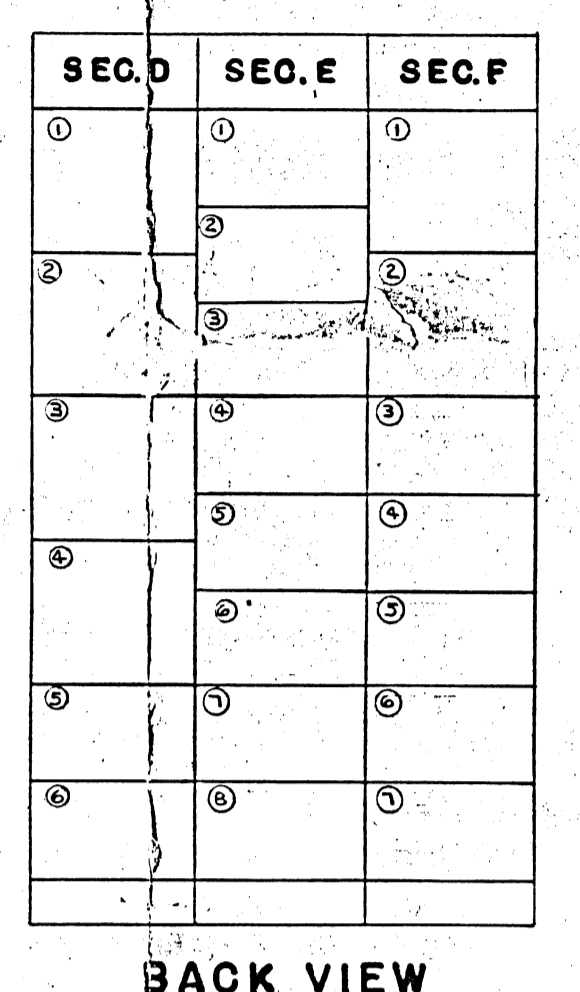

BACK VIEW

MOTOR CONTROL CENTER (6) E-II

KEY NO.	SERVICE DESIGNATION	NR.	STARTER SIZE	FUN.	NO.	INT.	REMARKS	LOCAT.
SECTION-A								
A1	POOL RECIRCULATING PUMP	100	4	F.V.N.R.	X	X	AUTO-TRANSFORMER FUSED TRANSITION CONTROL MOTOR ON HIGH WATER ALARM	RM. 01
SECTION-F								
F1	PRIMARY PUMP	20	2	F.V.N.R.	X	V	STOP-START PUSHBUTTON IN DOOR	RM. 01
F2	PRIMARY PUMP	20	2	F.V.N.R.	X	X	STOP-START PUSHBUTTON IN DOOR	RM. 01
F3	BOILER NO.1	10	2	F.V.N.R.	X	X	30 AMP - 3POLE C.C.T. BREAKER	RM. 01
F4	BOILER NO.2	10	2	F.V.N.R.	X	X	30 AMP - 3POLE C.C.T. BREAKER	RM. 01
F5	BOILER NO.3	10	2	F.V.N.R.	X	X	30 AMP - 3POLE C.C.T. BREAKER	RM. 01
F6	SPACE							
F7	SPACE							
SECTION-B								
B1	MANUAL STARTING SWITCHES						CRISIS ROOM'S ONLY - SEE NOTE	
B2	MANUAL STARTING SWITCHES						ALL PROVISIONS FOR 10-CRISIS	
B3	VACUUM PUMP	5	1	F.V.N.R.	X	X	STOP-START PUSHBUTTON IN DOOR	RM. 01
B4	SUMP PUMP	3	1	F.V.N.R.	X	X	MECHANICAL ALTERNATOR	RM. 01
B5	SUMP PUMP	5	1	F.V.N.R.	X	X	MECHANICAL ALTERNATOR	RM. 01
B6	SPACE						STOP-START PUSHBUTTON IN DOOR	
B7	SPACE						STOP-START PUSHBUTTON IN DOOR	
SECTION-C								
C1	EXHAUST FAN	3	1	F.V.N.R.	X	X	STOP-START PUSHBUTTON IN DOOR	RM. 01
C2	EXHAUST FAN	3	1	F.V.N.R.	X	X	STOP-START PUSHBUTTON IN DOOR	RM. 01
C3	EXHAUST FAN	3	1	F.V.N.R.	X	X	STOP-START PUSHBUTTON IN DOOR	RM. 01
C4	EXHAUST FAN	3	1	F.V.N.R.	X	X	STOP-START PUSHBUTTON IN DOOR	RM. 214
C5	EXHAUST FAN	3	1	F.V.N.R.	X	X	STOP-START PUSHBUTTON IN DOOR	RM. 215
C6	GLYCOL PUMP FOR D5/D4	3	1	F.V.N.R.	X	X	STOP-START PUSHBUTTON IN DOOR	SPACE
C7	GLYCOL PUMP FOR D5/D4	3	1	F.V.N.R.	X	X	STOP-START PUSHBUTTON IN DOOR	SPACE
C8	GLYCOL PUMP FOR D5/D4	3	1	F.V.N.R.	X	X	STOP-START PUSHBUTTON IN DOOR	SPACE
SECTION-D								
D-1	SUPPLY UNIT FAN	15	2	F.V.N.R.	X	X	CENTRAL CONTROL PANEL	CEILING SPACE
D-2	SUPPLY UNIT FAN	15	2	F.V.N.R.	X	X	CENTRAL CONTROL PANEL	CEILING SPACE
D-3	SUPPLY UNIT FAN	15	2	F.V.N.R.	X	X	CENTRAL CONTROL PANEL	CEILING SPACE
D-4	SUPPLY UNIT FAN	15	2	F.V.N.R.	X	X	CENTRAL CONTROL PANEL	CEILING SPACE
D-5	SUPPLY UNIT FAN	15	2	F.V.N.R.	X	X	CENTRAL CONTROL PANEL	CEILING SPACE
D-6	SUPPLY UNIT FAN	15	2	F.V.N.R.	X	X	CENTRAL CONTROL PANEL	CEILING SPACE

NOTE: LIST OF MANUAL STARTING SWITCHES AS FOLLOWS:

B-1		1-1/4\"/>
B-2		1-1/4\"/>

NOTE: ALL CIRCUITS TO BE COMPLETE WITH PILOT LIGHTS.

MOTOR CONTROL CENTER LEGEND (12) E-II

NO.	REF.	DESCRIPTION	DATE	CHKD.
REVISIONS (READ UP)				

DESIGNED BY
K.F.G.

CHECKED BY
H.K.G.

DATE
MARCH 28/68

SMITH CARTER SEARLE ASSOCIATES
ARCHITECTS AND CONSULTING ENGINEERS
WINNIPEG BRANDON PORT ARTHUR TORONTO



PAN-AMERICAN GAMES
SWIMMING FACILITY
WINNIPEG, MANITOBA

ELECTRICAL DISTRIBUTION

AS INDICATED

FILE NUMBER
65080

SHEET NUMBER
E-11

B-14
FILE
RETURN TO C.I.C.
PROPERTIES BUILDING
INVENTORY.

3 0 1 6