


SYMBOL SCHEDULE			
[Symbol]	RECESSED FLUORESCENT LUMINAIRE	[Symbol]	RECESSED ELECTRICAL POWER PANEL (347/600 VOLT)
[Symbol]	SURFACE MOUNTED FLUORESCENT LUMINAIRE	[Symbol]	RECESSED ELECTRICAL POWER PANEL (120/208 VOLT)
[Symbol]	LUMINAIRE CONNECTED TO EMERGENCY OR NIGHT LIGHT CIRCUIT	[Symbol]	RECESSED ELECTRICAL EQUIPMENT CABINET AS NOTED
[Symbol]	POLYHEDRAL RECESSED OR SURFACE MTD-TYPE A	[Symbol]	RECESSED ISOLATED GROUND PANEL
[Symbol]	WALL MOUNTED LUMINAIRE	[Symbol]	SURFACE MOUNTED PANEL TYPICAL
[Symbol]	EMERGENCY LIGHTING BATTERY BANK	[Symbol]	FIRE ALARM MANUAL PULL STATION
[Symbol]	EMERGENCY LIGHTING REMOTE HEAD (DOUBLE)	[Symbol]	FIRE ALARM BELL 10"(250mm) DENOTES SIZE
[Symbol]	EMERGENCY LIGHTING REMOTE HEAD (SINGLE)	[Symbol]	FIRE ALARM THERMAL DETECTOR DENOTES SIZE
[Symbol]	EXIT LIGHT (ARROW DENOTES DIRECTION)	[Symbol]	SMOKE DETECTOR
[Symbol]	SINGLE POLE TOGGLE SWITCH	[Symbol]	FIRE ALARM SYSTEM FLOW SWITCH CONNECTION
[Symbol]	THREE WAY TOGGLE SWITCH	[Symbol]	FIRE ALARM SYSTEM TAMPER VALVE CONNECTION
[Symbol]	GANG MTD. SWITCHES	[Symbol]	FIRE ALARM SYSTEM PRESSURE SWITCH CONNECTION
[Symbol]	DUPLEX RECEPTACLE	[Symbol]	PUBLIC ADDRESS SPEAKER CEILING MOUNTED
[Symbol]	SPLIT WIRE RECEPTACLE	[Symbol]	MICROPHONE OUTLET
[Symbol]	GROUND FAULT INTERRUPTED RECEPTACLE	[Symbol]	INTERCOM OUTLET
[Symbol]	RANGE OUTLET 40A-2P	[Symbol]	T.V. OUTLET
[Symbol]	DIRECT CONNECTION	[Symbol]	VOLUME CONTROLS
[Symbol]	JUNCTION BOX	[Symbol]	ELECTRIC BASEBOARD HEATER
[Symbol]	TELEPHONE OUTLET	[Symbol]	THERMOSTAT
[Symbol]	COMBINATION DATA/VOICE OUTLET DVO	[Symbol]	DROWNING ALARM
[Symbol]	MOTOR CONNECTION	[Symbol]	MOUNTED ABOVE COUNTED
[Symbol]	DISCONNECT SWITCH	[Symbol]	W.P. WEATHER PROOF
[Symbol]	MANUAL MOTOR STARTER		
[Symbol]	MAGNETIC MOTOR STARTER		
[Symbol]	PUSHBUTTON		

- NOTES:
- SUPPLY AND INSTALL NEW DEVICES IN ELEVATOR PIT. WIRE AND CONNECT TO NEAREST AVAILABLE PANEL. DEVICES TO BE INSTALLED AS PER ELEVATOR MANUFACTURE'S REQUIREMENTS.
 - SUPPLY AND INSTALL DEVICES AS SHOWN AND TIE INTO NEAREST AVAILABLE PANEL.
 - SUPPLY AND INSTALL NEW EBB#3, REMOTE HEAD AND EXIT SIGN IN LOCATIONS AS SHOWN. EBB TO BE C/W RECEPTACLE MTD ADJACENT, RECEPTACLE TO BE ON SAME CCT AS LIGHTING IN THE AREA.
 - SUPPLY AND INSTALL NEW FIRE ALARM DEVICES AS SHOWN AND TIE INTO EXISTING SYSTEM.
 - 100A-3P, 600V, 3Ø DISCONNECT FOR ELEVATOR CONTROLLER TO BE FED FROM EXISTING MAIN DIST.
 - 15A-1P DISCONNECT TO BE CONNECTED TO DEDICATED CCT FOR ELEVATOR CAB LIGHTING.

MOTOR SCHEDULE																		
MOTOR TAG	DESCRIPTION	LOCATION	KW/HP	VOLTS/Ø	PACKAGE UNIT	STARTER & ACCESSORIES			FEEDER		BREAKER	CIRCUIT	F/A SHUT DN	INTERLOCKED			REMARKS	
						TYPE	FUNCTION	PL	PB	HOA				WIRE	CONDUIT	WITH		DEVICE
AH-1	AIR HANDLING UNIT	BOILER ROOM	15 HP	600/3Ø		MAG	FVNR	*	*	3#12	1/2"	40A-3P	MAIN DIST					
CU-1	CONDENSING UNIT	ROOF TOP	74 FLA	600/3Ø	*					3#4	1"	100A-3P	MAIN DIST					
PP-1	PERIMETER HEATING PUMP	BOILER ROOM	2 HP	600/3Ø		MAG	FVNR	*	*	3#12	1/2"	15A-3P	NOTE-1					
PP-2	PERIMETER HEATING PUMP STANDBY	BOILER ROOM	2 HP	600/3Ø		MAG	FVNR	*	*	3#12	1/2"	15A-3P	NOTE-1					
PP-3	HEATING COIL PUMP	BOILER ROOM	3/4 HP	600/3Ø		MAG	FVNR	*	*	3#12	1/2"	15A-3P	NOTE-1					
SP-1	SUMP PUMP	ELEVATOR MACHINE ROOM	1/3 HP	120/1Ø						2#12	1/2"	15A-1P	NOTE-2				PROVIDE REC.	
FF-1	FORCE FLOW HEATER FAN	ENT 111	1/6 HP	120/1Ø		MAN		*	*	2#12	1/2"	15A-1P	B-60					
FF-2	FORCE FLOW HEATER FAN	ENT 101	1/6 HP	120/1Ø		MAN		*	*	2#12	1/2"	15A-1P	B-60					
FF-3	FORCE FLOW HEATER FAN	ENT 101	1/6 HP	120/1Ø		MAN		*	*	2#12	1/2"	15A-1P	B-58					
FF-4	FORCE FLOW HEATER FAN	ROOM 123	1/6 HP	120/1Ø		MAN		*	*	2#12	1/2"	15A-1P	B-58					
EF-1	WASHROOM EXHAUST FAN	WOMEN'S RM 110	1 HP	120/1Ø		MAN		*	*	2#12	1/2"	40A-1P	NOTE-2					
EF-2	ELEV. MACHINE EXHAUST FAN	MACHINE ROOM	1/3 HP	120/1Ø		MAN		*	*	2#12	1/2"	15A-1P	NOTE-2					

- NOTES:
- WIRE AND CONNECT THE INDICATED MOTORS TO NEAREST AVAILABLE 600V PANEL.
 - WIRE AND CONNECT THE INDICATED MOTORS TO NEAREST AVAILABLE 120V PANEL.

2	CONSTRUCTION DOC	JAN. 9/98		
1	ISSUED FOR PERMIT	DEC 4/97		
No.	Description	Date (d/m/y)	Drawn	Checked
Revisions/Issuance (Read Up)				
Designed By	Initialed By			
DG				
Drawn By				
DG				
Checked By				
LPW/DG				
Approved By				
LPW				

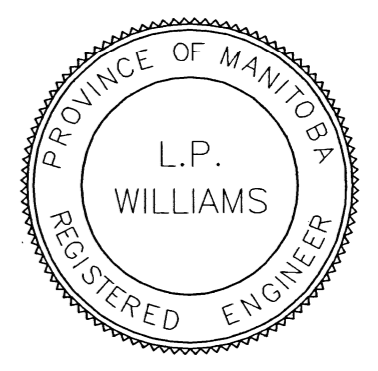

Man-Shield
CONSTRUCTION INC.
205-638 CORYDON AVE
WINNIPEG, MANITOBA
R3M 0X9
(204) 475-4304

Smith Carter Architects
and Engineers Incorporated
1601 Buffalo Place
Winnipeg, Manitoba
Canada, R3T 3K7
Tel. (204) 477-1260
Fax. (204) 477-5346

Smith Carter
Architects
Engineers
Planners
Interior Designers

ADDITIONS AND RENOVATIONS
TO THE PAN-AM POOL
WINNIPEG MANITOBA

Sheet Title
**BASEMENT PLAN - ELECTRICAL
& MOTOR SCHEDULE**

Scales
1/8" = 1'-0"

Date
NOV. 21, 1997

File Number
97126

Sheet Number
E2.1

25 Poselden Bay
 Basement Plan - Electrical & Motor Schedule
 Project Title
**Pan Am Pool Additions And
Renovations**
 1997
 Sheet No.
E2.1
 97126