


ROUGH - IN WORK FOR BUILDING SECURITY SYSTEM NOTES
 SUPPLY & INSTALL, UNLESS OTHERWISE NOTED.

- 1 RUN EMT'S & TERMINATE WITH-IN (4) MAN DOOR HEAD JAMBS.
- 2 DEDICATED EMT RUN FROM BUILDING ALARM CONTROL PANEL TO EXTERIOR SIREN. TERMINATE EMT 8" FROM ROOF PEAK.
- 3 RUN EMT'S AND TERMINATE IN (3) 4" X 4" X 2" RECESSED JUNCTION BOXES FOR ROOM 101, 102 & 103 ALARM KEYPAD INSTALLATIONS. MOUNT BOXES 5'-0" FROM CENTER OF BOXES TO FINISHED FLOOR.
- 4 RUN EMT'S FROM PULL BOXES AND TERMINATE AT (4) ROOM 101, 102 & 103 OVERHEAD DOOR HEAD JAMBS FOR SECURITY CONTACT INSTALLATIONS.
- 5 RUN EMT'S FROM ROOM 102 CEILING MOUNTED PULL BOXES AND TERMINATE IN (2) OCTAGON BOXES FOR HEAT DETECTION DEVICES. ALSO SEE E2 DWG.
- 6 RUN EMT FROM BUILDING ALARM CONTROL PANEL AND TERMINATE IN 8" X 8" X 2" PULL BOX, ROOM 102. MOUNT PULL BOX TO SUPPORT BLOCK BETWEEN CEILING JOIST.
- 7 RUN EMT'S FROM ROOM 102 PULL BOX AND TERMINATE IN (2) OCTAGON BOXES. MOUNT OCTAGON BOXES TO SUPPORT BLOCKS BETWEEN CEILING JOISTS FOR 360 DEGREE MOTION DETECTOR INSTALLATIONS.
- 8 RUN EMT'S FROM PULL BOXES TO ABOVE CEILING CENTERED BETWEEN UPPER WINDOWS FOR (3) GLASS BREAKAGE DETECTION DEVICES.
- 9 EMT FROM BUILDING ALARM CONTROL PANEL TO 6" X 6" X 2" PULL BOXES, ROOM 101 & 103. MOUNT PULL BOXES TO SUPPORT BLOCKS BETWEEN CEILING JOIST.
- 10 EMT TERMINATION POINT FOR WALL MOUNTED MOTION DETECTION DEVICES. TERMINATE EMT 8" BELOW CEILING JOISTS.
- 11 (3) 1" EMT RISERS FROM BUILDING ALARM CONTROL PANEL TO ROOM 101, 102 & 103 CEILING MOUNTED PULL BOXES. ALSO SEE NOTE 2.

LEGEND	
ITEM	DESCRIPTION
[DC1]	DELAYED DOOR CONTACT SWITCHES FOR MAN DOORS BY-OTHERS.
[DC2]	INSTANT DOOR CONTACT SWITCHES FOR OVERHEAD & MAN DOORS BY-OTHERS.
[GB]	GLASS BREAKAGE DETECTORS ON UPPER WINDOWS BY-OTHERS.
KP	KEY PAD INSTALLED BY-OTHERS.
MD	MOTION DETECTOR INSTALLATION BY-OTHERS.
BACP	BUILDING ALARM CONTROL PANEL INSTALLATION BY-OTHERS.
[HI]	BUILDING ALARM SIREN BY OTHERS.
MD	360 DEGREE MOTION SENSORS BY OTHERS.
[JB1]	RECESSED IN-WALL JUNCTION BOX, 4" X 4" X 2"
[JB2]	CEILING MOUNTED OCTAGON BOX FOR HEAT DETECTION DEVICES.
[JB3]	CEILING OCTAGON BOX FOR MOTION DETECTION DEVICES.
[PB1]	CEILING MOUNTED PULL BOX 4" X 4" X 4"
[PB2]	CEILING MOUNTED PULL BOX 8" X 8" X 4"

NOTES:
 ALSO SEE ELECTRICAL DWGS.
 ALL ELECTRICAL ROUGH-IN WORK FOR SECURITY SYSTEM TO BE ROUTED IN EMT WITHIN WALLS & PARALLEL TO BUILDING STRUCTURE FROM BUILDING ALARM CONTROL PANEL TO SECURITY COMPONENT LOCATIONS SHOWN ON DWGS. WIRING BY OTHERS.
 ALL ELECTRICAL ROUGH-IN WORK FOR BUILDING SECURITY SYSTEM & TELEPHONE (MTS) INSTALLATIONS TO BE COORDINATED WITH THE CITY OF WINNIPEG, COMMUNICATIONS BRANCH (PAUL LEMONE, 988-6375) PRIOR TO COMMENCEMENT OF WORK.
 ALL EMT RUNS SHOWN FOR CLARITY.

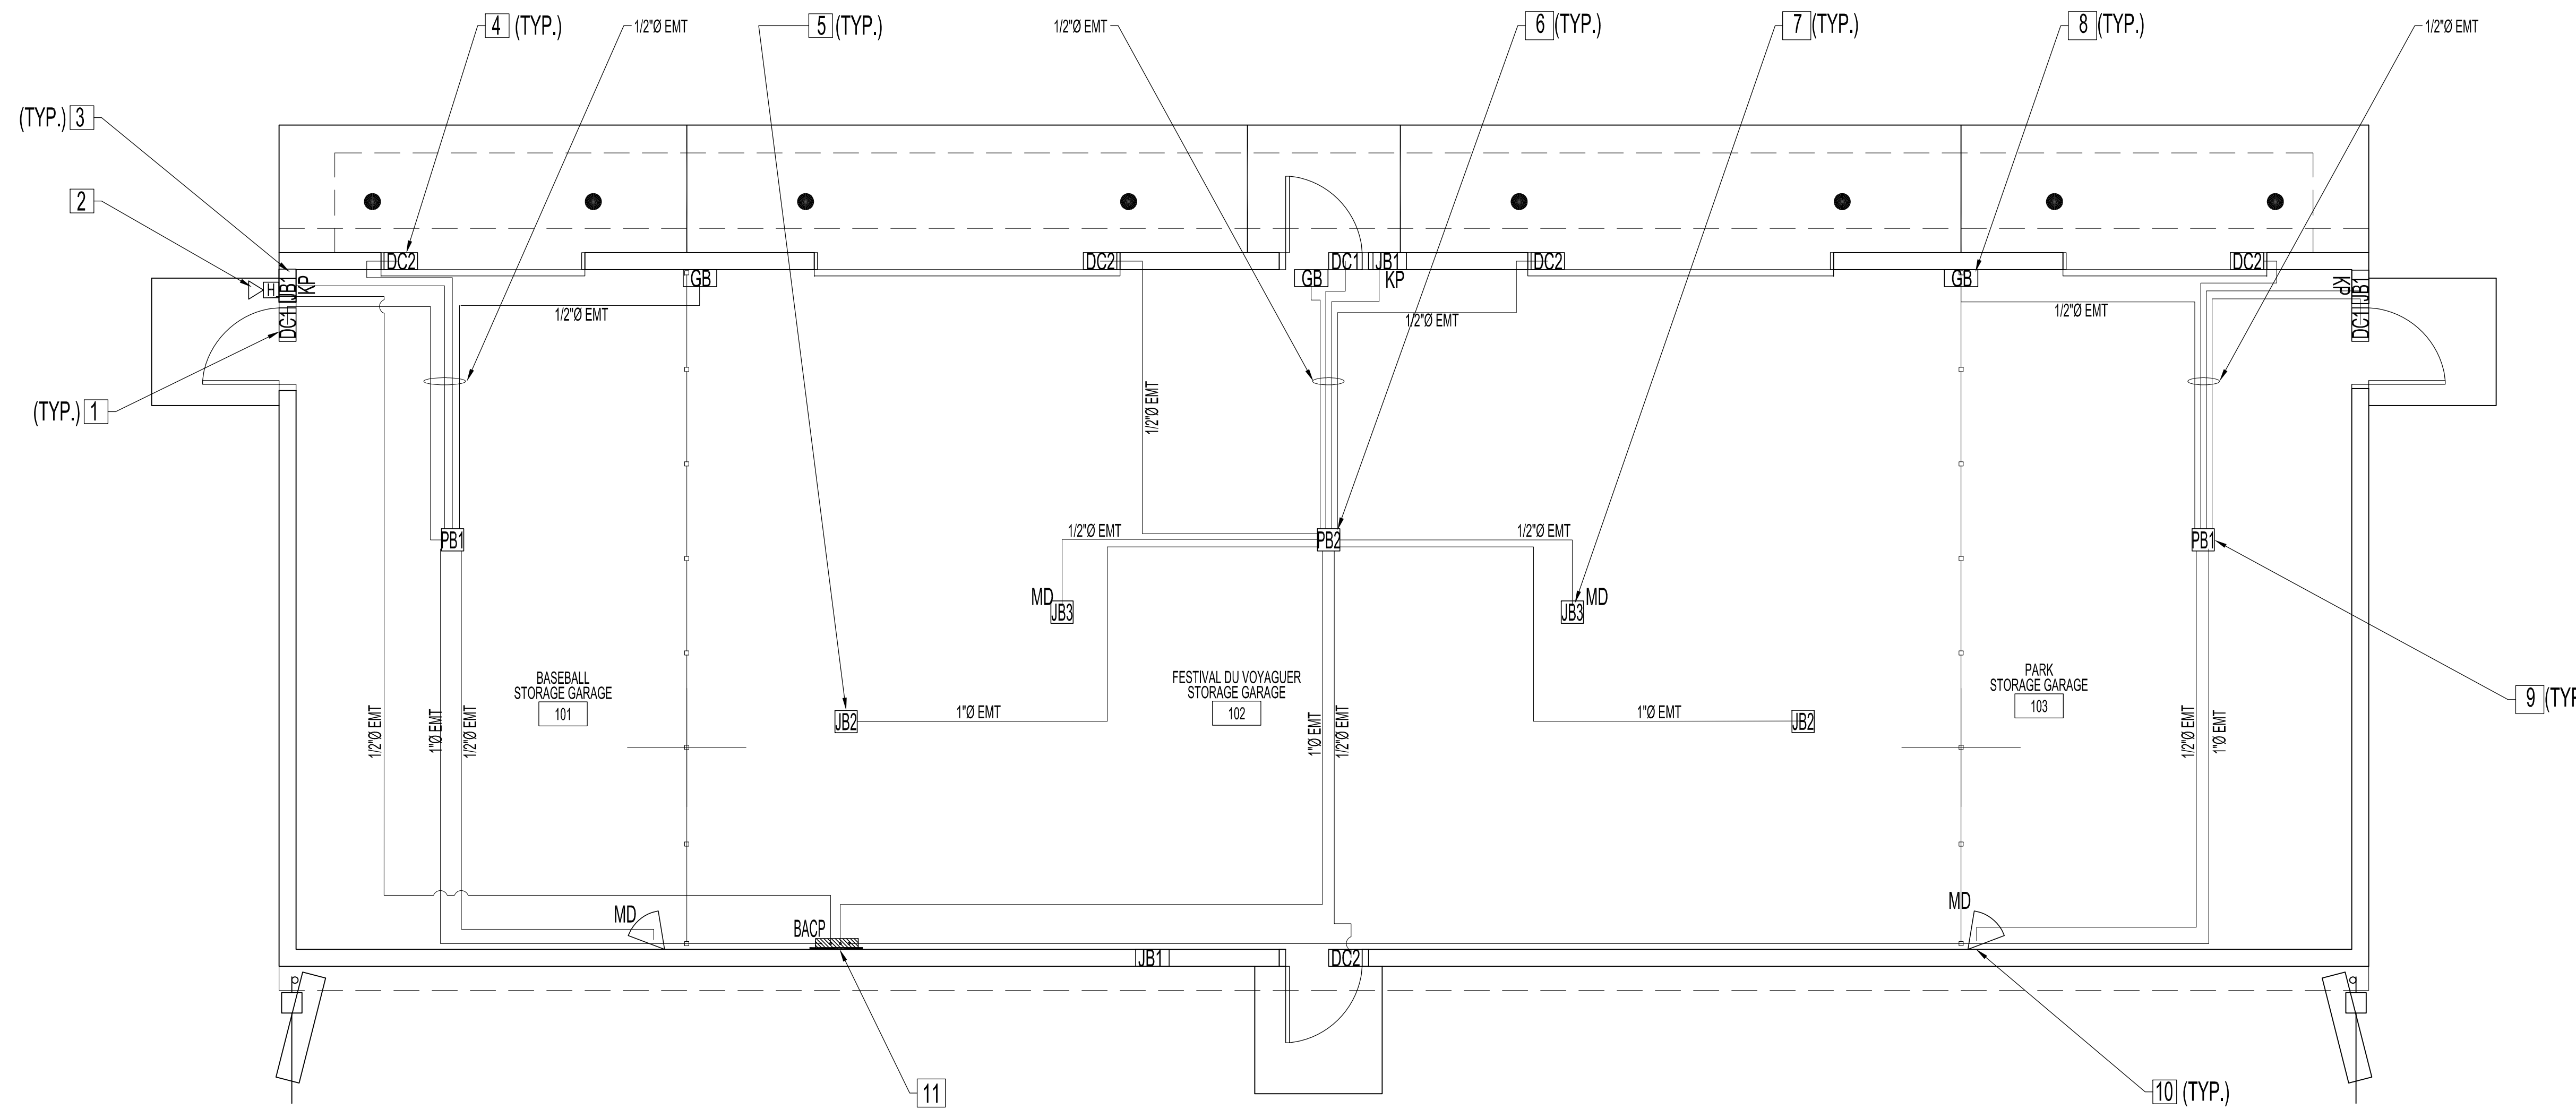

ORIGINAL STAMPED BY: DOUG PALEY
 DATE: 2012.03.09

No.	REVISION/DESCRIPTION	BY	DATE

DRAWN	RCP	CHECKED	DAP	DESIGNED	RCP	APPROVED	DAP

THE CITY OF WINNIPEG
 PLANNING, PROPERTY AND
 DEVELOPMENT DEPARTMENT
 MUNICIPAL ACCOMMODATIONS DIVISION
 3-65 GARRY STREET, R3C 4K4

PROJECT
 WHITTIER PARK
 STORAGE BUILDING
 836 RUE ST. JOSEPH

SHEET TITLE
 MAIN FLOOR PLAN
 ROUGH-IN WORK FOR BUILDING SECURITY SYSTEM
 ELECTRICAL

SCALE	PROJECT No:	SHEET No:
AS SHOWN	2010-031	E4