



NOTE: CHAINAGES SHOWN ARE ALONG E. R. OF LILY ST.

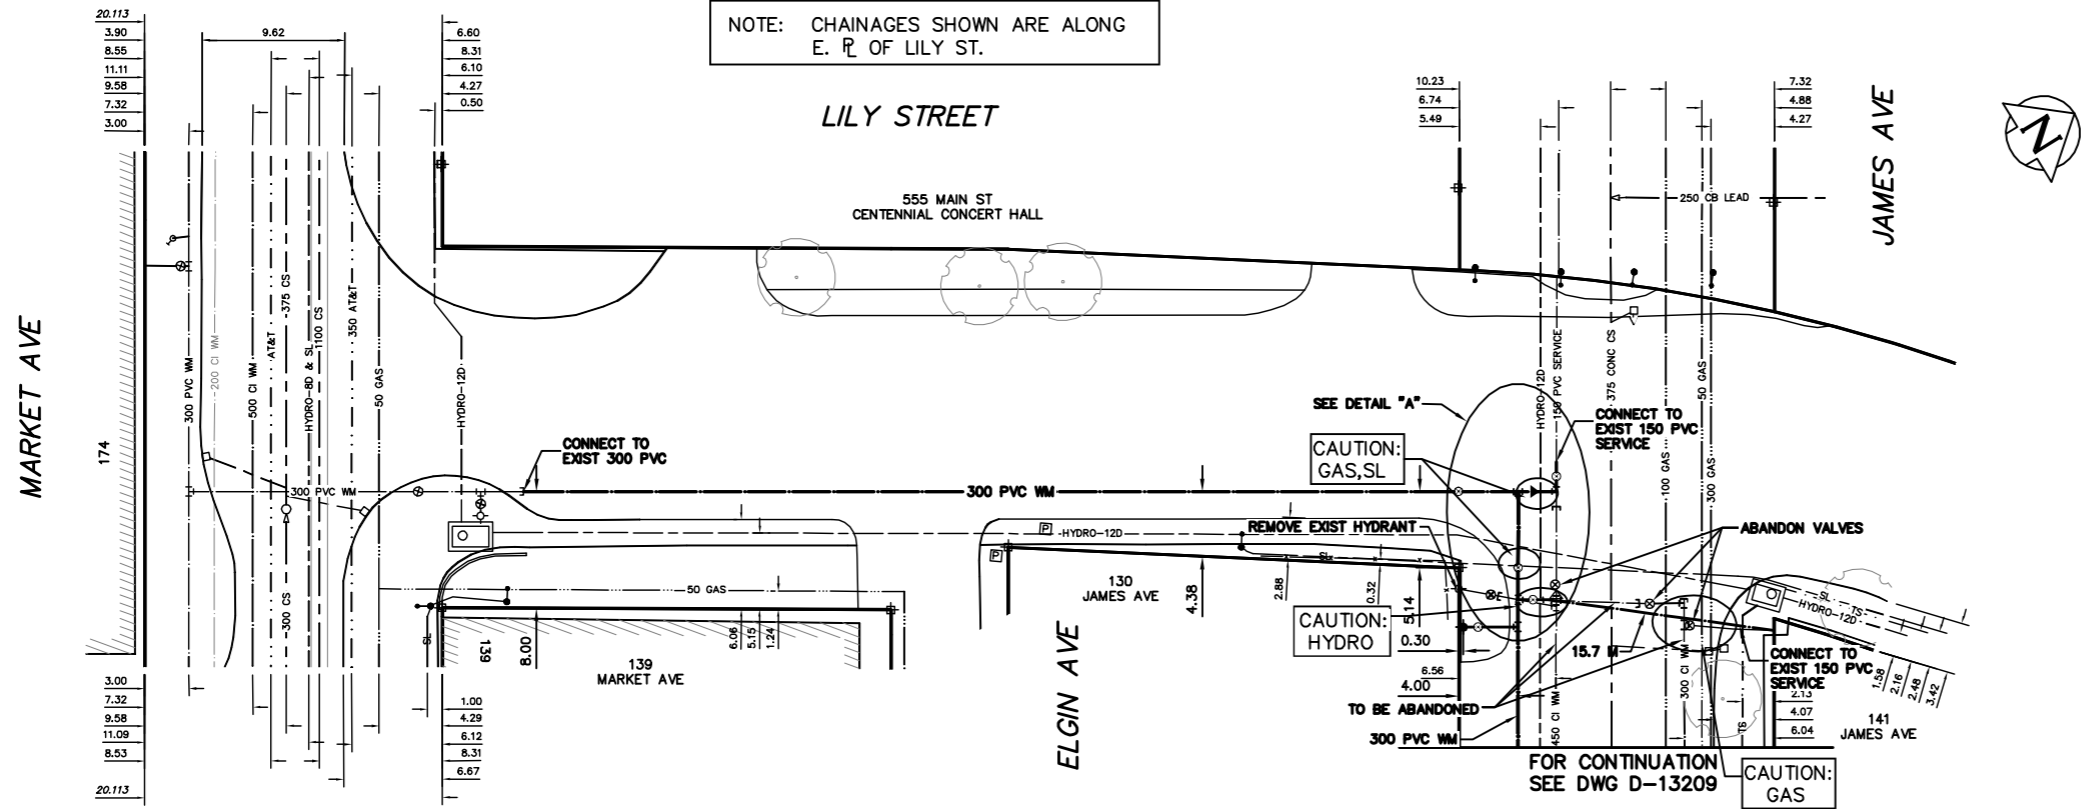

WATER SERVICE INFORMATION					
ADDRESS	SIZE (mm) MATERIAL (STREET)	SIZE (mm) MATERIAL (PROP.)	SHORT & LONG MEASUREMENT	CORP. LOCATION	REMARKS
110 JAMES AVE COMMERCIAL	150 PVC	150 PVC	3.97 EWL BLDG 4.0 EEL BERTHA	OPP VALVE	SERV. OFF JAMES
128 JAMES AVE COMMERCIAL	12 LEAD	12 LEAD	24.41 WEL BLDG 31.98 WEL BERTHA	0.2 W OF S/C	SERV. OFF JAMES RENEW TO R
128 JAMES AVE COMMERCIAL	150 PVC	150 PVC	12.10 WEL BLDG 19.76 WEL BERTHA	OPP VALVE	SERV. OFF JAMES RENEW TO R
130 JAMES AVE COMMERCIAL	25 COPPER	25 COPPER	5.49 EWL BLDG 51.19 EEL LILY	0.1 W OF S/C	SERV. OFF JAMES RECONNECT SERVICE
130 JAMES AVE COMMERCIAL	150 COPPER	150 COPPER	7.31 EWL BLDG 52.85 EEL LILY	OPP VALVE	SERV. OFF JAMES CONNECT TO EXIST SERVICE
130 JAMES AVE COMMERCIAL	25 COPPER	25 COPPER	17.96 EWL BLDG 63.39 EEL LILY	1.2 E OF S/C	SERV. OFF JAMES RECONNECT SERVICE
130 JAMES AVE COMMERCIAL	150 COPPER	100 COPPER	33.03 EWL BLDG 78.81 EEL LILY	0.3 E OF S/C	SERV. OFF JAMES CONNECT TO EXIST SERVICE
130 JAMES AVE COMMERCIAL	25 COPPER	25 COPPER	34.45 EWL BLDG 41.62 WEL BERTHA	OPP S/C	SERV. OFF JAMES RECONNECT SERVICE
141 JAMES AVE COMMERCIAL	38 COPPER	38 COPPER	7.82 WEL BLDG 27.50 EEL LILY	0.9 W OF S/C	SERV. OFF JAMES RECONNECT SERVICE
141 JAMES AVE COMMERCIAL	150 COPPER	150 COPPER	8.22 WEL BLDG 0.85 EEL LILY	OPP VALVE	SERV. OFF JAMES RENEW W/150 PVC TO R
139 MARKET AVE COMMERCIAL	25 COPPER	25 COPPER	11.42 EWL BLDG 12.02 EEL LILY	4.1 W OF S/C	SERV. OFF MARKET
139 MARKET AVE COMMERCIAL	150 PVC	150 PVC	7.11 EWL BLDG 7.68 EEL LILY	OPP VALVE	SERV. OFF MARKET
555 MAIN ST COMMERCIAL	150 PVC	150 PVC	1.23 EEL LILY 6.32 NSL JAMES	OPP VALVE	SERV. OFF LILY
555 MAIN ST COMMERCIAL	150 AC	150 AC	55.16 WEL BLDG 72.24 WEL LILY	OPP VALVE	SERV. OFF MARKET

* SERVICES TO BE RENEWED TO R. ALL OTHERS TO BE RECONNECTED

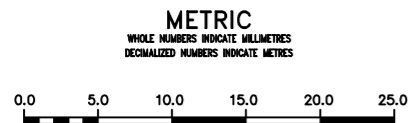

WARNING
IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:
1) NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.
2) TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.
SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

LOCATION APPROVED UNDERGROUND STRUCTURES
SUPV. U/G STRUCTURES COMMITTEE DATE
NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M. ELEV.	
CONSTRUCTION COMPLETION DATE: YYYY MM DD	
DESIGNED BY	TS
CHECKED BY	SC
DRAWN BY	CJH/RS
APPROVED BY	KZ
SCALE:	
HORIZONTAL	1:250
VERTICAL	1:50
RELEASED FOR CONSTRUCTION	
DATE	2013 04 19
DATE	
PLOT DATE:	2013 04 19

DESIGNED BY	TS	CHECKED BY	SC
DRAWN BY	CJH/RS	APPROVED BY	KZ
SCALE:		RELEASED FOR CONSTRUCTION	
HORIZONTAL	1:250		
VERTICAL	1:50		
DATE	2013 04 19	DATE	
PLOT DATE:	2013 04 19		

ENGINEER'S SEAL
ORIGINAL SIGNED BY K.R. ZUREK 13.04.19
CONSULTANT DRAWING NUMBER

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION
2013 WATER RENEWALS
SHEET 2 OF 10
CITY DRAWING NUMBER
LILY STREET MARKET AVENUE TO JAMES AVENUE
D-13210