


FIELD CONNECTION DIAGRAM:

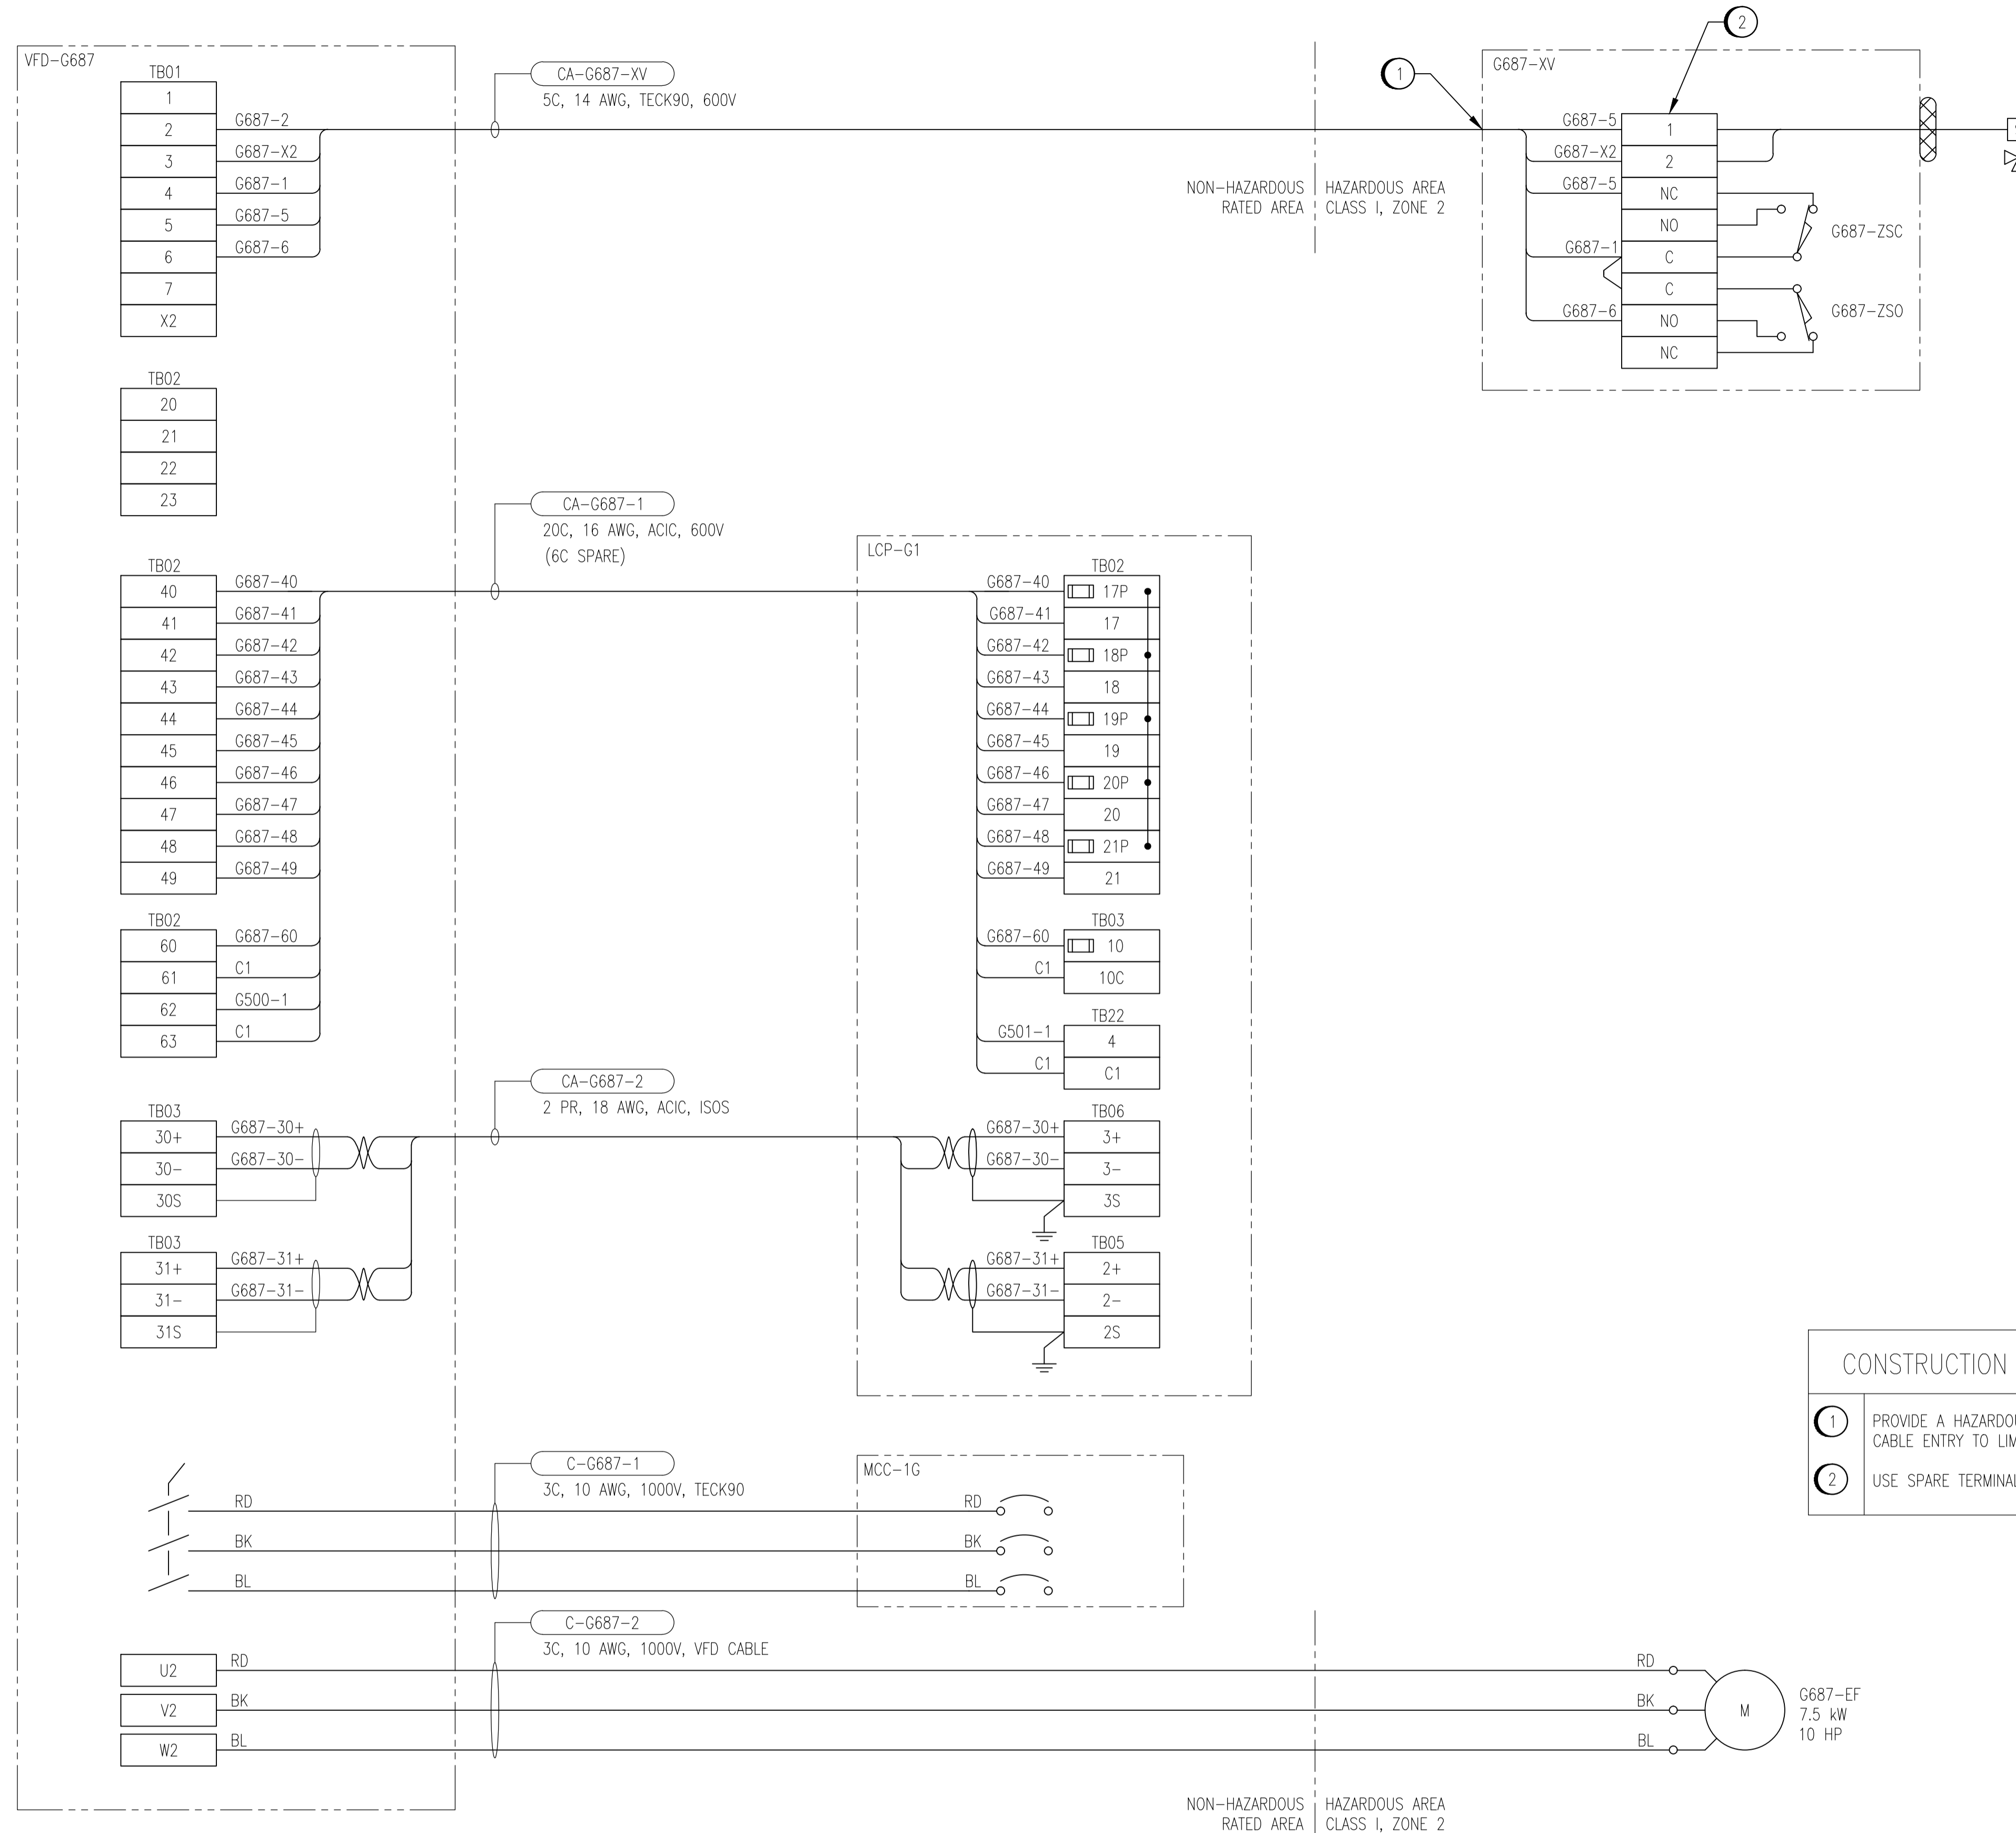

CONSTRUCTION NOTES

1. PROVIDE A HAZARDOUS RATED CABLE GLAND SEAL AT CABLE ENTRY TO LIMIT SWITCH ENCLOSURE.

2. USE SPARE TERMINALS IN G687-XV FOR SOLENOID WIRING.

- NOTES:**
- THIS DRAWING SUPERCEDES SEP-2125.
 - GAS DETECTION ALARM RELAY IN LCP-G1. SEE DRAWING 1-0102G-A0065.



NO.	REVISIONS	DATE	DESIGN	CHECK
01	ISSUED FOR TENDER, BID OPP. 42-2013	2013/01/15	TMC	CJR
00	ISSUED FOR TENDER, BID OPP. 545-2012	2012/09/10	TMC	CJR

<p>SNC-LAVALIN INC. 148 Nature Park Way Winnipeg, MB, Canada R3P 0X7 204-786-8080</p>		ENGINEER'S SEAL
DESIGNED BY: I. CHURCH	CHECKED BY: C. REIMER	
DRAWN BY: M.J. PERSSON	APPROVED BY: C. REIMER	
SCALE: NTS	RELEASED FOR CONSTRUCTION BY: N. HARRINGTON	
DATE: 2011/11/09	DATE: 2012/09/10	
CONSULTANT NO.: 112577-0116-47DD-0004		

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

SOUTH END WATER POLLUTION CONTROL CENTRE
VENTILATION & MISC UPGRADES
MOTOR SCHEMATIC
G687-EF FAN

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0102G-E0038	002	01	A1

DRAWING NUMBER	REFERENCE DRAWINGS
----------------	--------------------