


WET WELL PARTIAL FLOOR PLAN
SCALE 1: 20

SPECIFIC NOTES:

1. INSTALL BEAMS.
2. SAWCUT SLAB FOR OPENINGS.
3. DO NOT OVER CUT CORNERS.
4. CHANNELS AND ANGLE FINISH: SSPC-SP6 SURFACE PREPARATION C/W 2) COATS SELF-PRIMING EPOXY PAINT (10 MILS TOTAL DFT). (INTERNATIONAL P.C. INTERGARD 345 OR EQUIV.) COLOUR: GREY
5. BOLTS TO BE ASTM A193/A320 GRADE B8M CLASS 2 (AISI SS316) C/W ASTM A194 GRADE 8M NUTS (AISI SS316) AND AISI SS 316 WASHERS.
6. CONCRETE ANCHORS HILTI KWIK BOLTS 3, STAINLESS STEEL, EMBED MINIMUM 95 INTO CONCRETE.
7. LOCATE EXISTING REBAR IN CONCRETE BEAMS. SPACE BETWEEN CHANNELS IS ±50 TO ALLOW HILTI ANCHORS TO MISS REBAR.

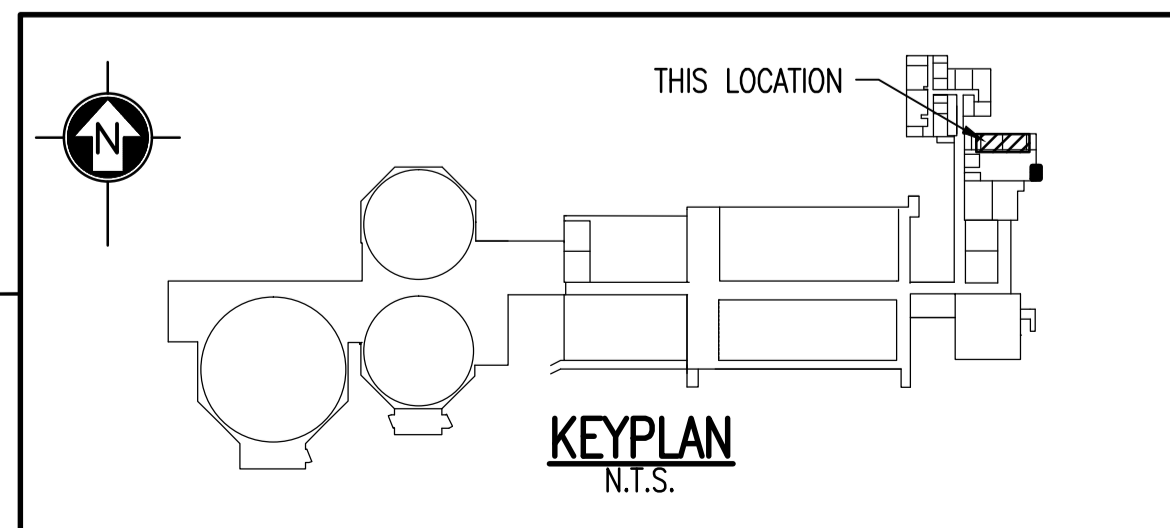

NO.	REVISIONS	DATE	DESIGN	CHECK
01	ISSUED FOR TENDER, BID OPP. 42-2013	2013/01/15	KK	RB
00	ISSUED FOR TENDER, BID OPP. 545-2012	2012/10/15	KK	RB

DESIGNED BY:	K. KOTYK
CHECKED BY:	R. BEAN
DRAWN BY:	M. TUGADE
APPROVED BY:	C. REIMER
SCALE:	AS NOTED
DATE:	2012/06/18
RELEASED FOR CONSTRUCTION BY:	NEIL HARRINGTON
DATE:	2012/10/15
CONSULTANT NO.:	112577-0116-42DD-00045

ENGINEER'S SEAL
ORIGINAL DRAWING
SEALED BY:
K. K. KOTYK
SNC-Lavalin
MEMBER #21950
2012/10/18
REV. 00

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

SOUTH END WATER POLLUTION CONTROL CENTRE
VENTILATION & MISC. UPGRADE
MECHANICAL OPENING & DETAILS
GRIT BUILDING WET WELL

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0102G-S0018	001	01	A1