


FIELD

RTU PANEL

0900
0901
0902
0903
0904
0905
0906
0907
0908
0909
0910
0911
0912
0913
0914
0915
0916
0917
0918
0919
0920
0921
0922

NOTE:
1. ALL TAGS PREFIXED BY 'COL-PBC'
UNLESS OTHERWISE NOTED.

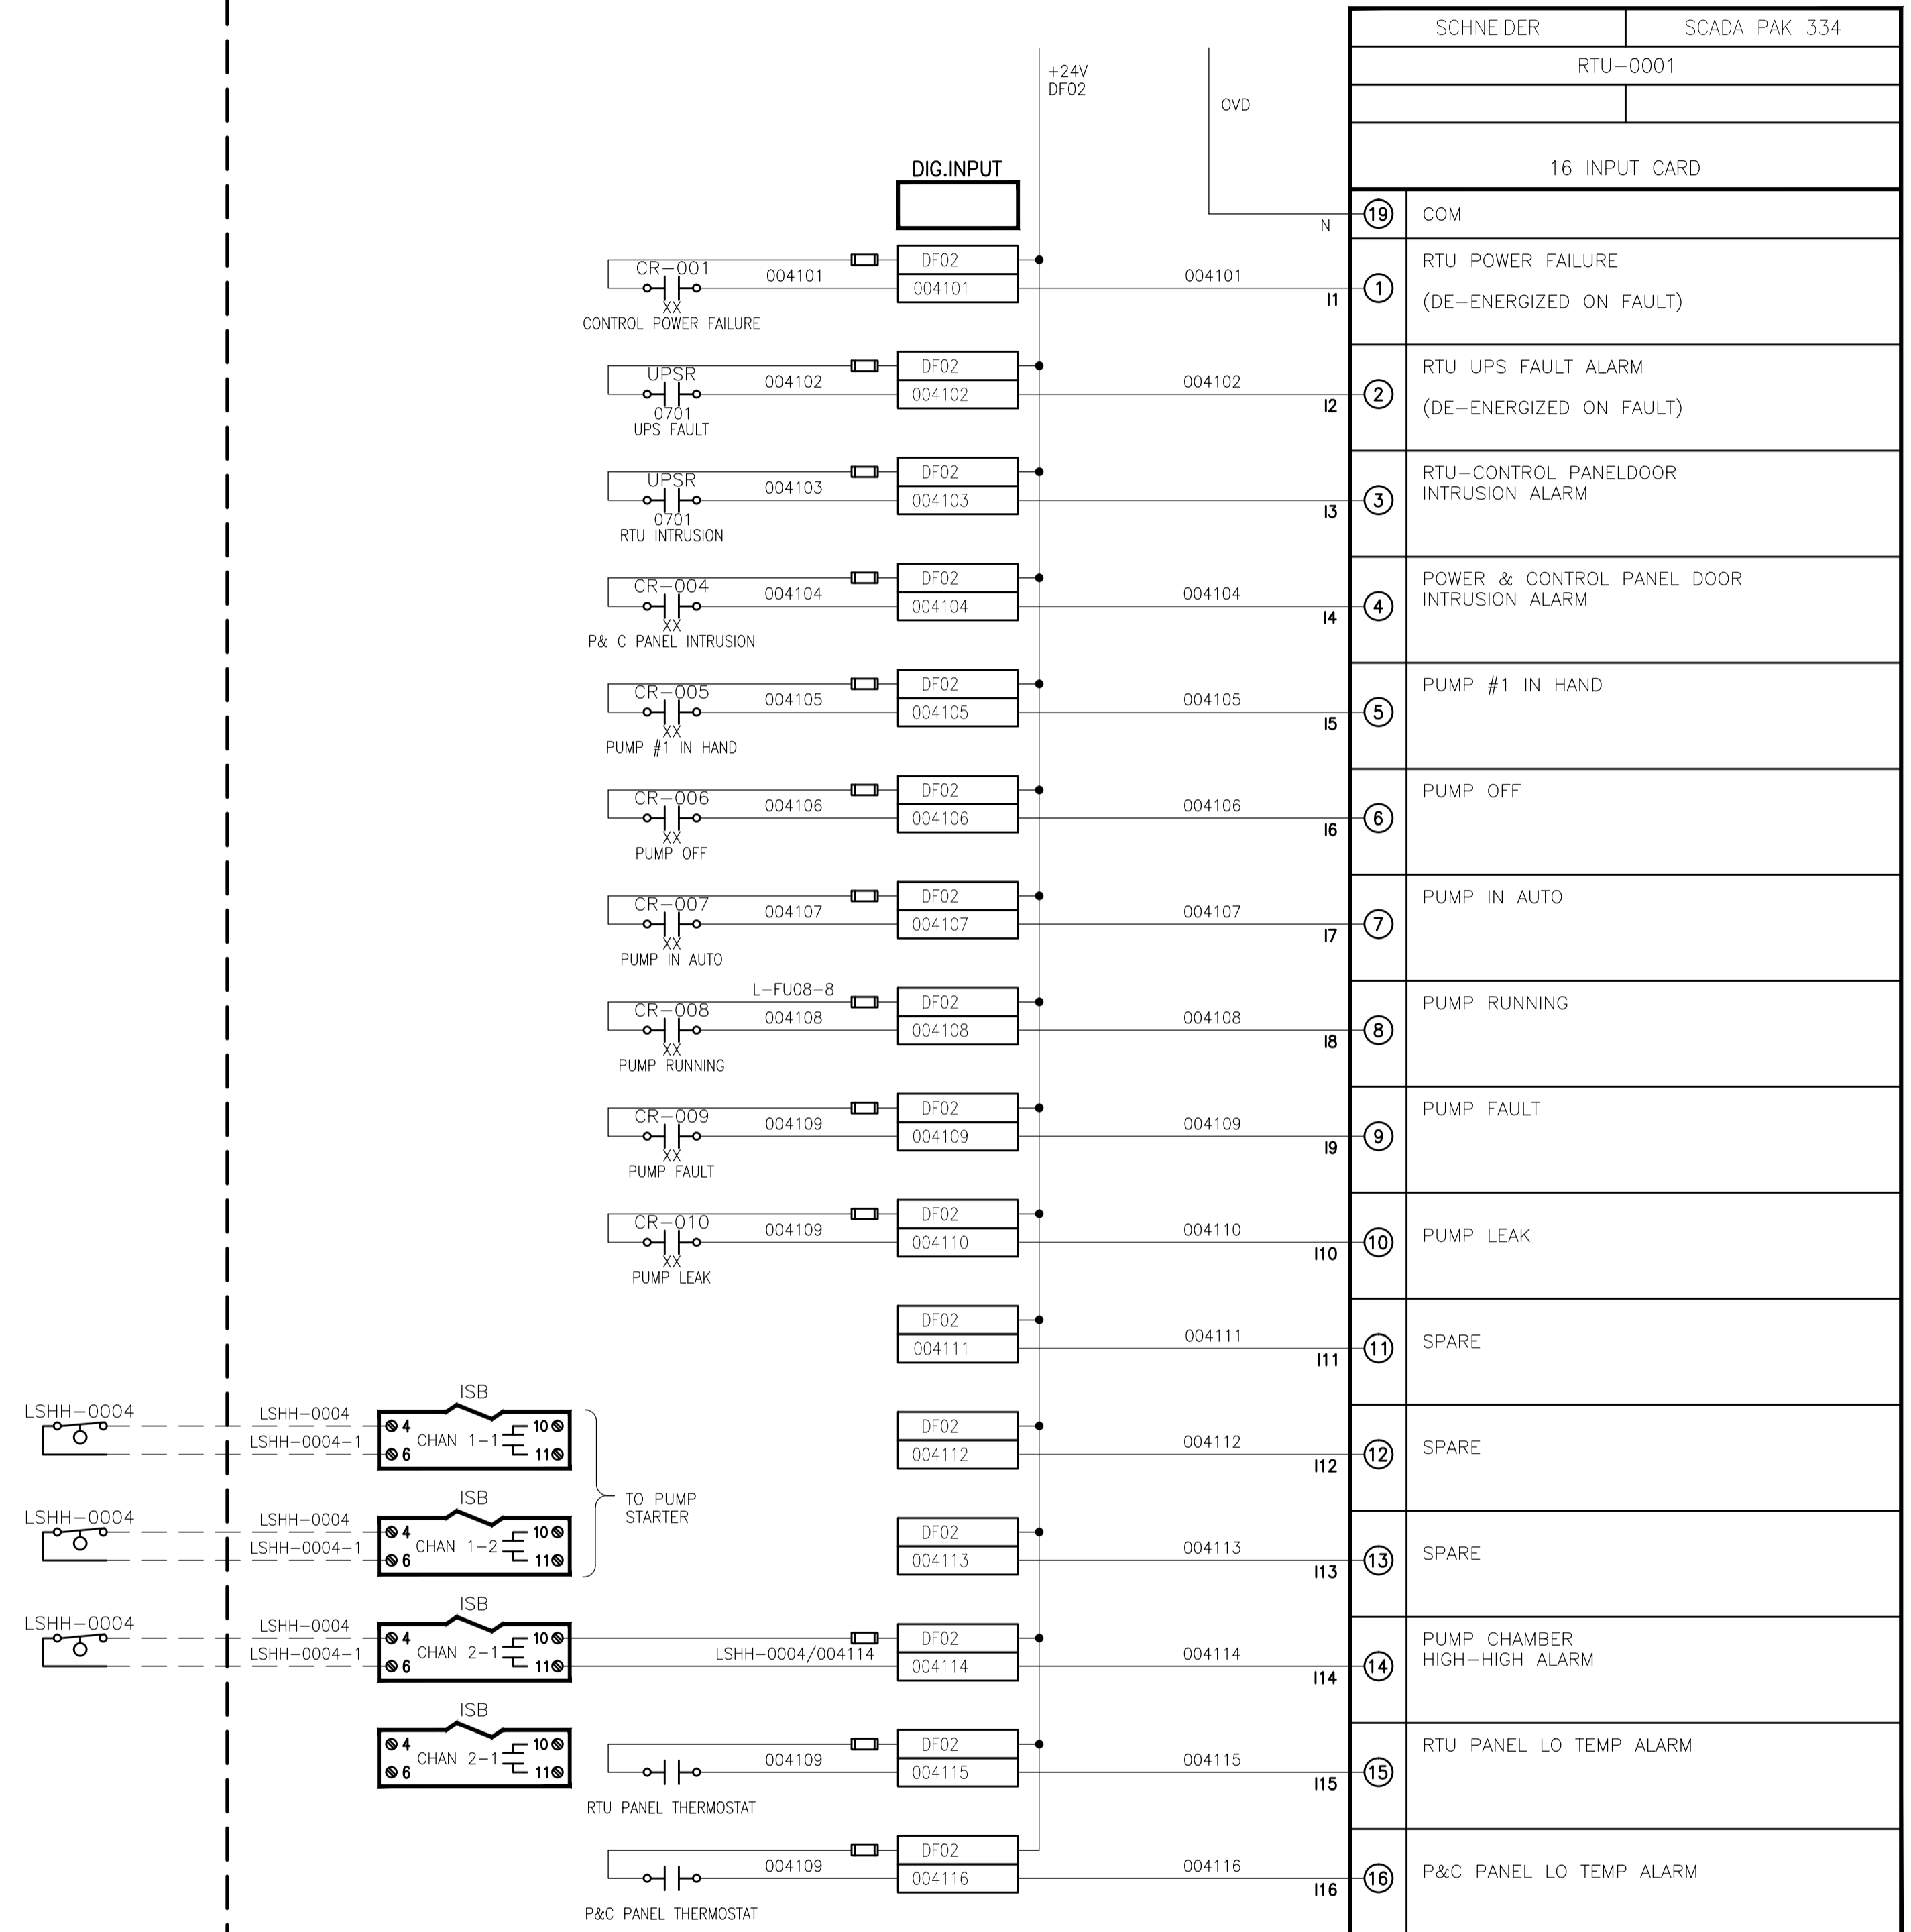

RTU-0001

Printed: November 12, 2013, at 4:11:52 PM | User: Sreedhar, C:\app
 File: C:\1325513108-000 (McDermot Ave Outfall Gate Chamber)\10 - electrical\Sheets\14.dwg | Layout: 14 SHT1



		MMM Group Limited Suite 111 - 93 Lombard Ave. Winnipeg, MB R3B 3B1 T. 204.943.3178 F. 204.943.4848 www.mmm.ca	
DESIGNED BY	M.P.	CHECKED BY	M.P./D.C.
DRAWN BY	R.D.	APPROVED BY	K.H.
HOR. SCALE	AS NOTED	RELEASED FOR CONSTRUCTION	
VERT. SCALE	AS NOTED		
No.	REVISIONS	DATE	BY
B	ISSUED FOR TENDER	13.11.12	M.P.
A	ISSUED FOR CLIENT REVIEW	13.11.04Z	M.P.
		13.10.16	

ENGINEER'S SEAL

BID OPPORTUNITY: 912-2013
PLOT DATE: 13.10.16

THE CITY OF WINNIPEG
 WASTE AND WATER DEPARTMENT
McDERMOT
SRS OUTFALL GATE CHAMBER
 RTU PANEL DIGITAL INPUT CARD 1

CONSULTANT DRAWING No.: I4 - SHT 1 OF 2	
SHEET 17	OF 22
CITY DRAWING No.: LD-7262	