

FIELD

RTU PANEL

1000
1001
1002
1003
1004
1005
1006
1007
1008
1009
1010
1011
1012
1013
1014
1015
1016
1017
1018
1019
1020
1021
1022


NOTE:
1. ALL TAGS PREFIXED BY 'COL-PBC'
UNLESS OTHERWISE NOTED.

ACTUATOR CHAMBER FLOOD ALARM
FLOAT SWITCH HI-HI LEVEL
LSH-0001

LSHH-0004

LSHH-0004

SPARE

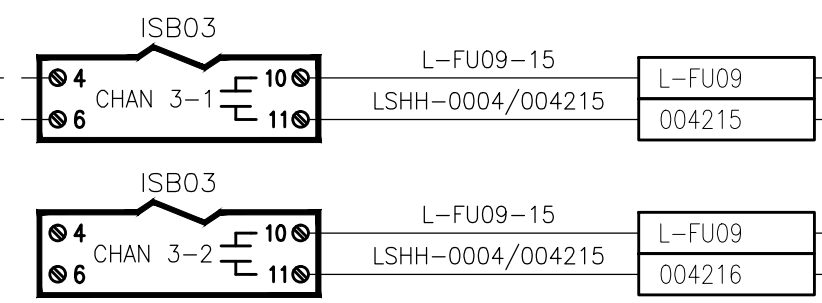


+24V
DF03

OVD

SCHNEIDER		SCADA PAK 334	
RTU-0001			
16 INPUT CARD			
19	COM		
1	ACTUATOR LOCAL		
2	ACTUATOR REMOTE		
3	ACTUATOR OPEN		
4	ACTUATOR CLOSE		
5	ACTUATOR OPENING		
6	ACTUATOR CLOSING		
7	ACTUATOR OPENED O/L TRIP.		
8	ACTUATOR CLOSED O/L TRIP.		
9	SPARE		
10	SPARE		
11	FLAP OPEN IN ACTUATOR CHAMBER		
12	SPARE		
13	SPARE		
14	SPARE		
15	ACTUATOR CHAMBER HIGH HIGH ALARM		
16	SPARE		

RTU-0001

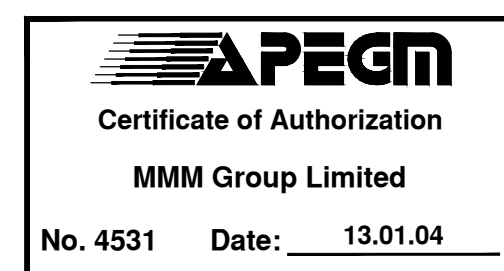

		MMM Group Limited Suite 111 - 93 Lombard Ave. Winnipeg, MB R3B 3B1 T. 204.943.3178 F. 204.943.4848 www.mmm.ca	
DESIGNED BY	M.P.	CHECKED BY	M.P./D.C.
DRAWN BY	R.D.	APPROVED BY	K.H.
HOR. SCALE	AS NOTED	RELEASED FOR CONSTRUCTION	
VERT. SCALE	AS NOTED		
No.	REVISIONS	DATE	BY
B	ISSUED FOR TENDER	11/08/13	M.P.
A	ISSUED FOR CLIENT REVIEW	13/11/04	M.P.
		DATE	13.10.16
		DATE	13.10.16

ENGINEER'S SEAL

BID OPPORTUNITY: 912-2013
PLOT DATE: 13.10.16

THE CITY OF WINNIPEG
 WASTE AND WATER DEPARTMENT

OUTFALL GATE CHAMBER UPGRADES
 RTU PANEL DIGITAL INPUT CARD 2

CONSULTANT DRAWING No.:	I4 - SHT 2 OF 2
SHEET OF	18 OF 22
CITY DRAWING No.:	LD-7263