



RTU PANEL

FIELD

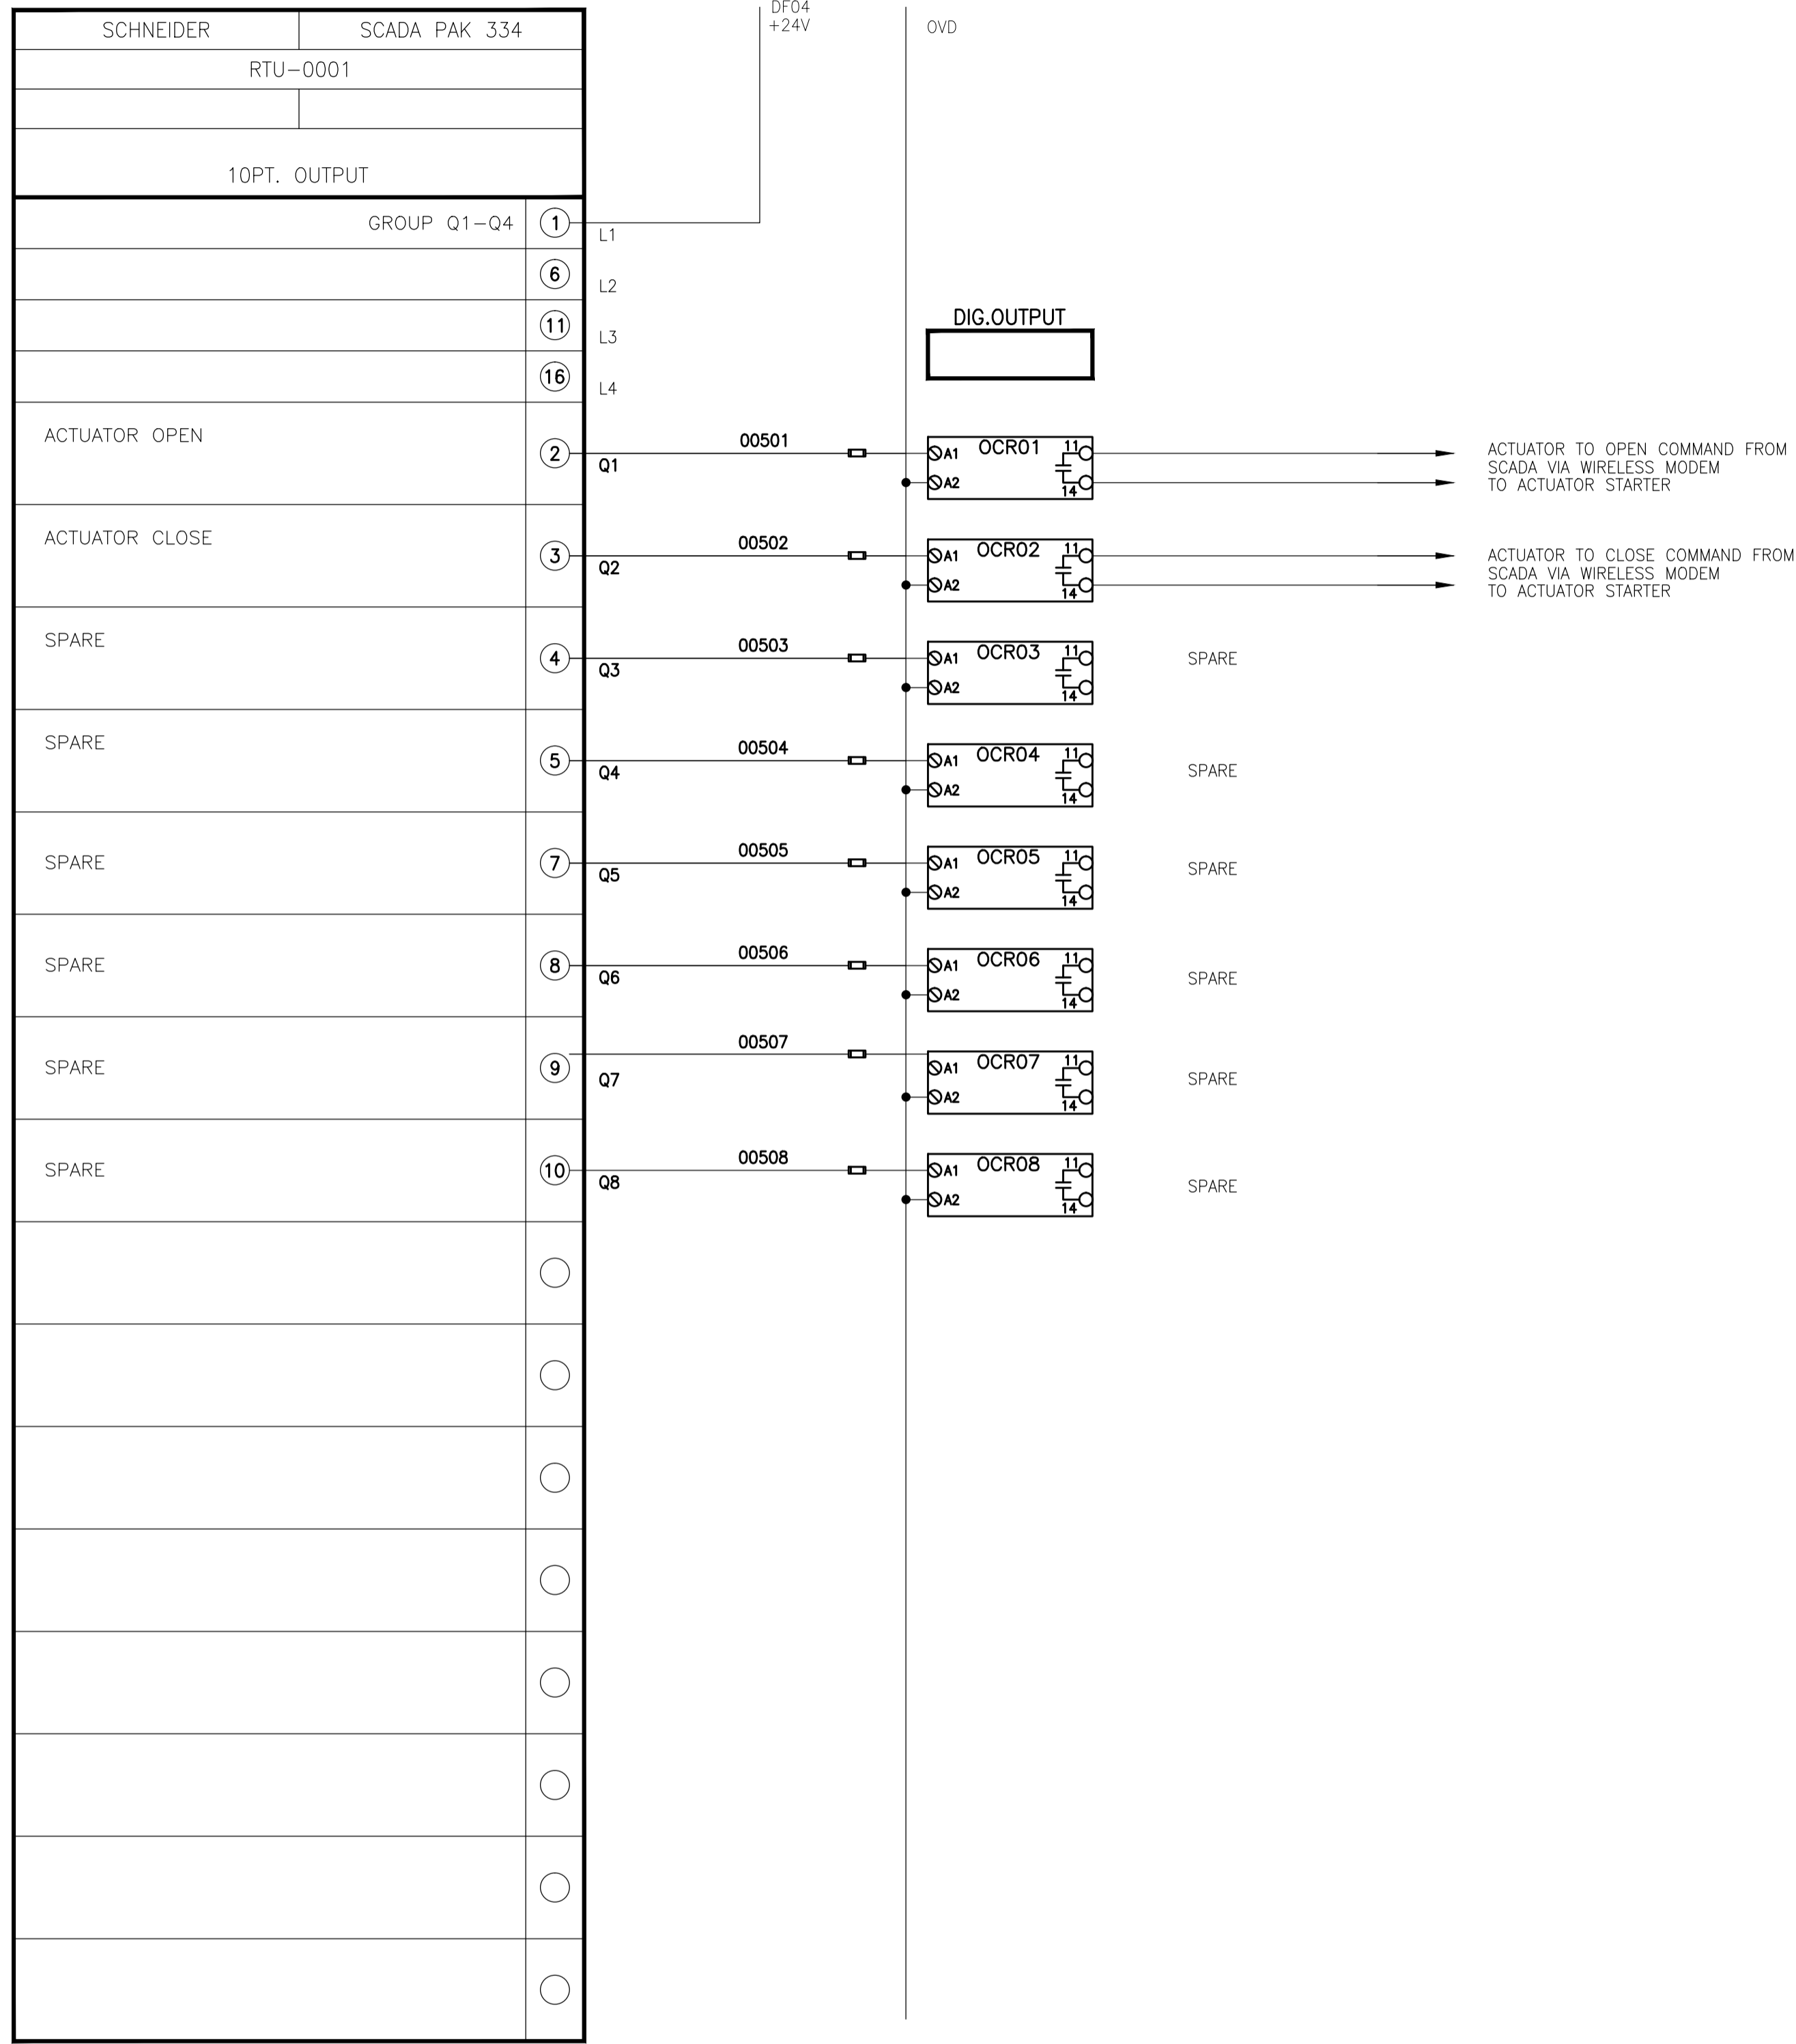

- 500
- 501
- 502
- 503
- 504
- 505
- 506
- 507
- 508
- 509
- 510
- 511
- 55
- 513
- 514
- 515
- 516
- 517
- 518
- 519
- 520



NOTE:
 1. ALL TAGS PREFIXED BY 'XXX-XXX'
 UNLESS OTHERWISE NOTED.

Printed: November 12, 2013, at 4:11:10 PM | Last Saved By: C:\app
 File: C:\13255\13108-000 (McDermot Ave Outfall Gate Chamber)\40 - electrical\Sheet15.dwg | Layout: I5



DESIGNED BY		M.P.	CHECKED BY		M.P./D.C.
DRAWN BY		R.D.	APPROVED BY		K.H.
HOR. SCALE		AS NOTED	RELEASED FOR CONSTRUCTION		
VERT. SCALE		AS NOTED			
No. REVISIONS		DATE	BY	DATE	DATE
B		ISSUED FOR TENDER	11/08/13	M.P.	
A		ISSUED FOR CLIENT REVIEW	13/11/04	M.P.	
				13.10.16	13.10.16

ENGINEER'S SEAL

BID OPPORTUNITY: 912-2013
 PLOT DATE: 13.10.16

THE CITY OF WINNIPEG
 WASTE AND WATER DEPARTMENT

Winnipeg

OUTFALL GATE CHAMBER UPGRADES
McDERMOT
 SRS OUTFALL GATE CHAMBER

RTU Panel Digital Output Card

CONSULTANT DRAWING No.:	I5
SHEET	19 OF 22
CITY DRAWING No.:	LD-7264