
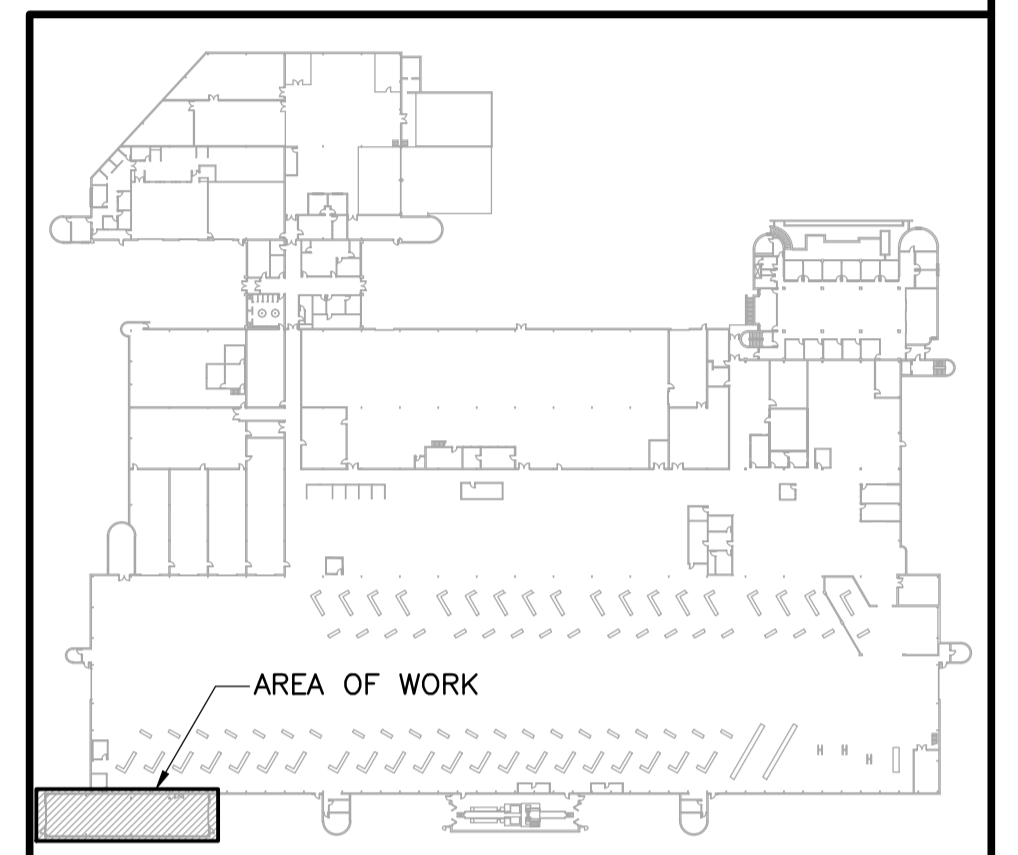


REFERENCE DRAWINGS	
NO.	DESCRIPTION




NO.	DATE	DESCRIPTION	PREPARED	REVIEW	DESIGN	AUTHORIZED
01	14.02.05	ISSUED W/ ADDENDUM No. 01	EV	HC	HC	DLP
00	14.01.17	ISSUED FOR CONSTRUCTION	HA	HC	HC	DLP

ORIGINAL DRAWING REVISION "00" SEALED BY H.A. CEANAS 14.01.17

DESIGNED BY: HC	PREPARED BY: BM/HA	REVIEWED BY: HC
AUTHORIZED BY: DLP	DATE: 13.11.15	SCALE: AS NOTED

THE CONTENT OF THIS DOCUMENT IS NOT INTENDED FOR THE USE OF, NOR IS IT INTENDED TO BE RELIED UPON BY ANY PERSON, FIRM OR CORPORATION OTHER THAN THE CLIENT AND TETRA TECH WEI Inc. (Tetra Tech). TETRA TECH WEI Inc. (Tetra Tech) DENIES ANY LIABILITY WHATSOEVER TO OTHER PARTIES FOR DAMAGES OR INJURY SUFFERED BY SUCH THIRD PARTY ARISING FROM THE USE OF THIS DOCUMENT BY THEM WITHOUT THE EXPRESSED WRITTEN AUTHORITY OF TETRA TECH WEI Inc. (Tetra Tech) AND OUR CLIENT. THIS DOCUMENT IS SUBJECT TO FURTHER RESTRICTIONS IMPOSED BY THE CONTRACT BETWEEN THE CLIENT AND TETRA TECH WEI Inc. (Tetra Tech) AND THESE PARTIES' PERMISSION MUST BE SOUGHT REGARDING THIS DOCUMENT IN ALL OTHER CIRCUMSTANCES.


CLIENT: CITY OF WINNIPEG TRANSIT DEPARTMENT

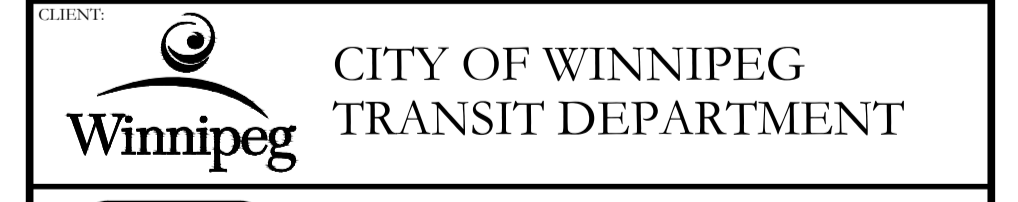

PROJECT NAME: CITY OF WINNIPEG TRANSIT - FORT ROUGE GARAGE BUS MAINTENANCE ADDITION

DRAWING DESCRIPTION: ELECTRICAL PARTIAL MAIN FLOOR PLAN

DRAWING NO: 1329720500-DWG-E0002	REV: 01
----------------------------------	---------

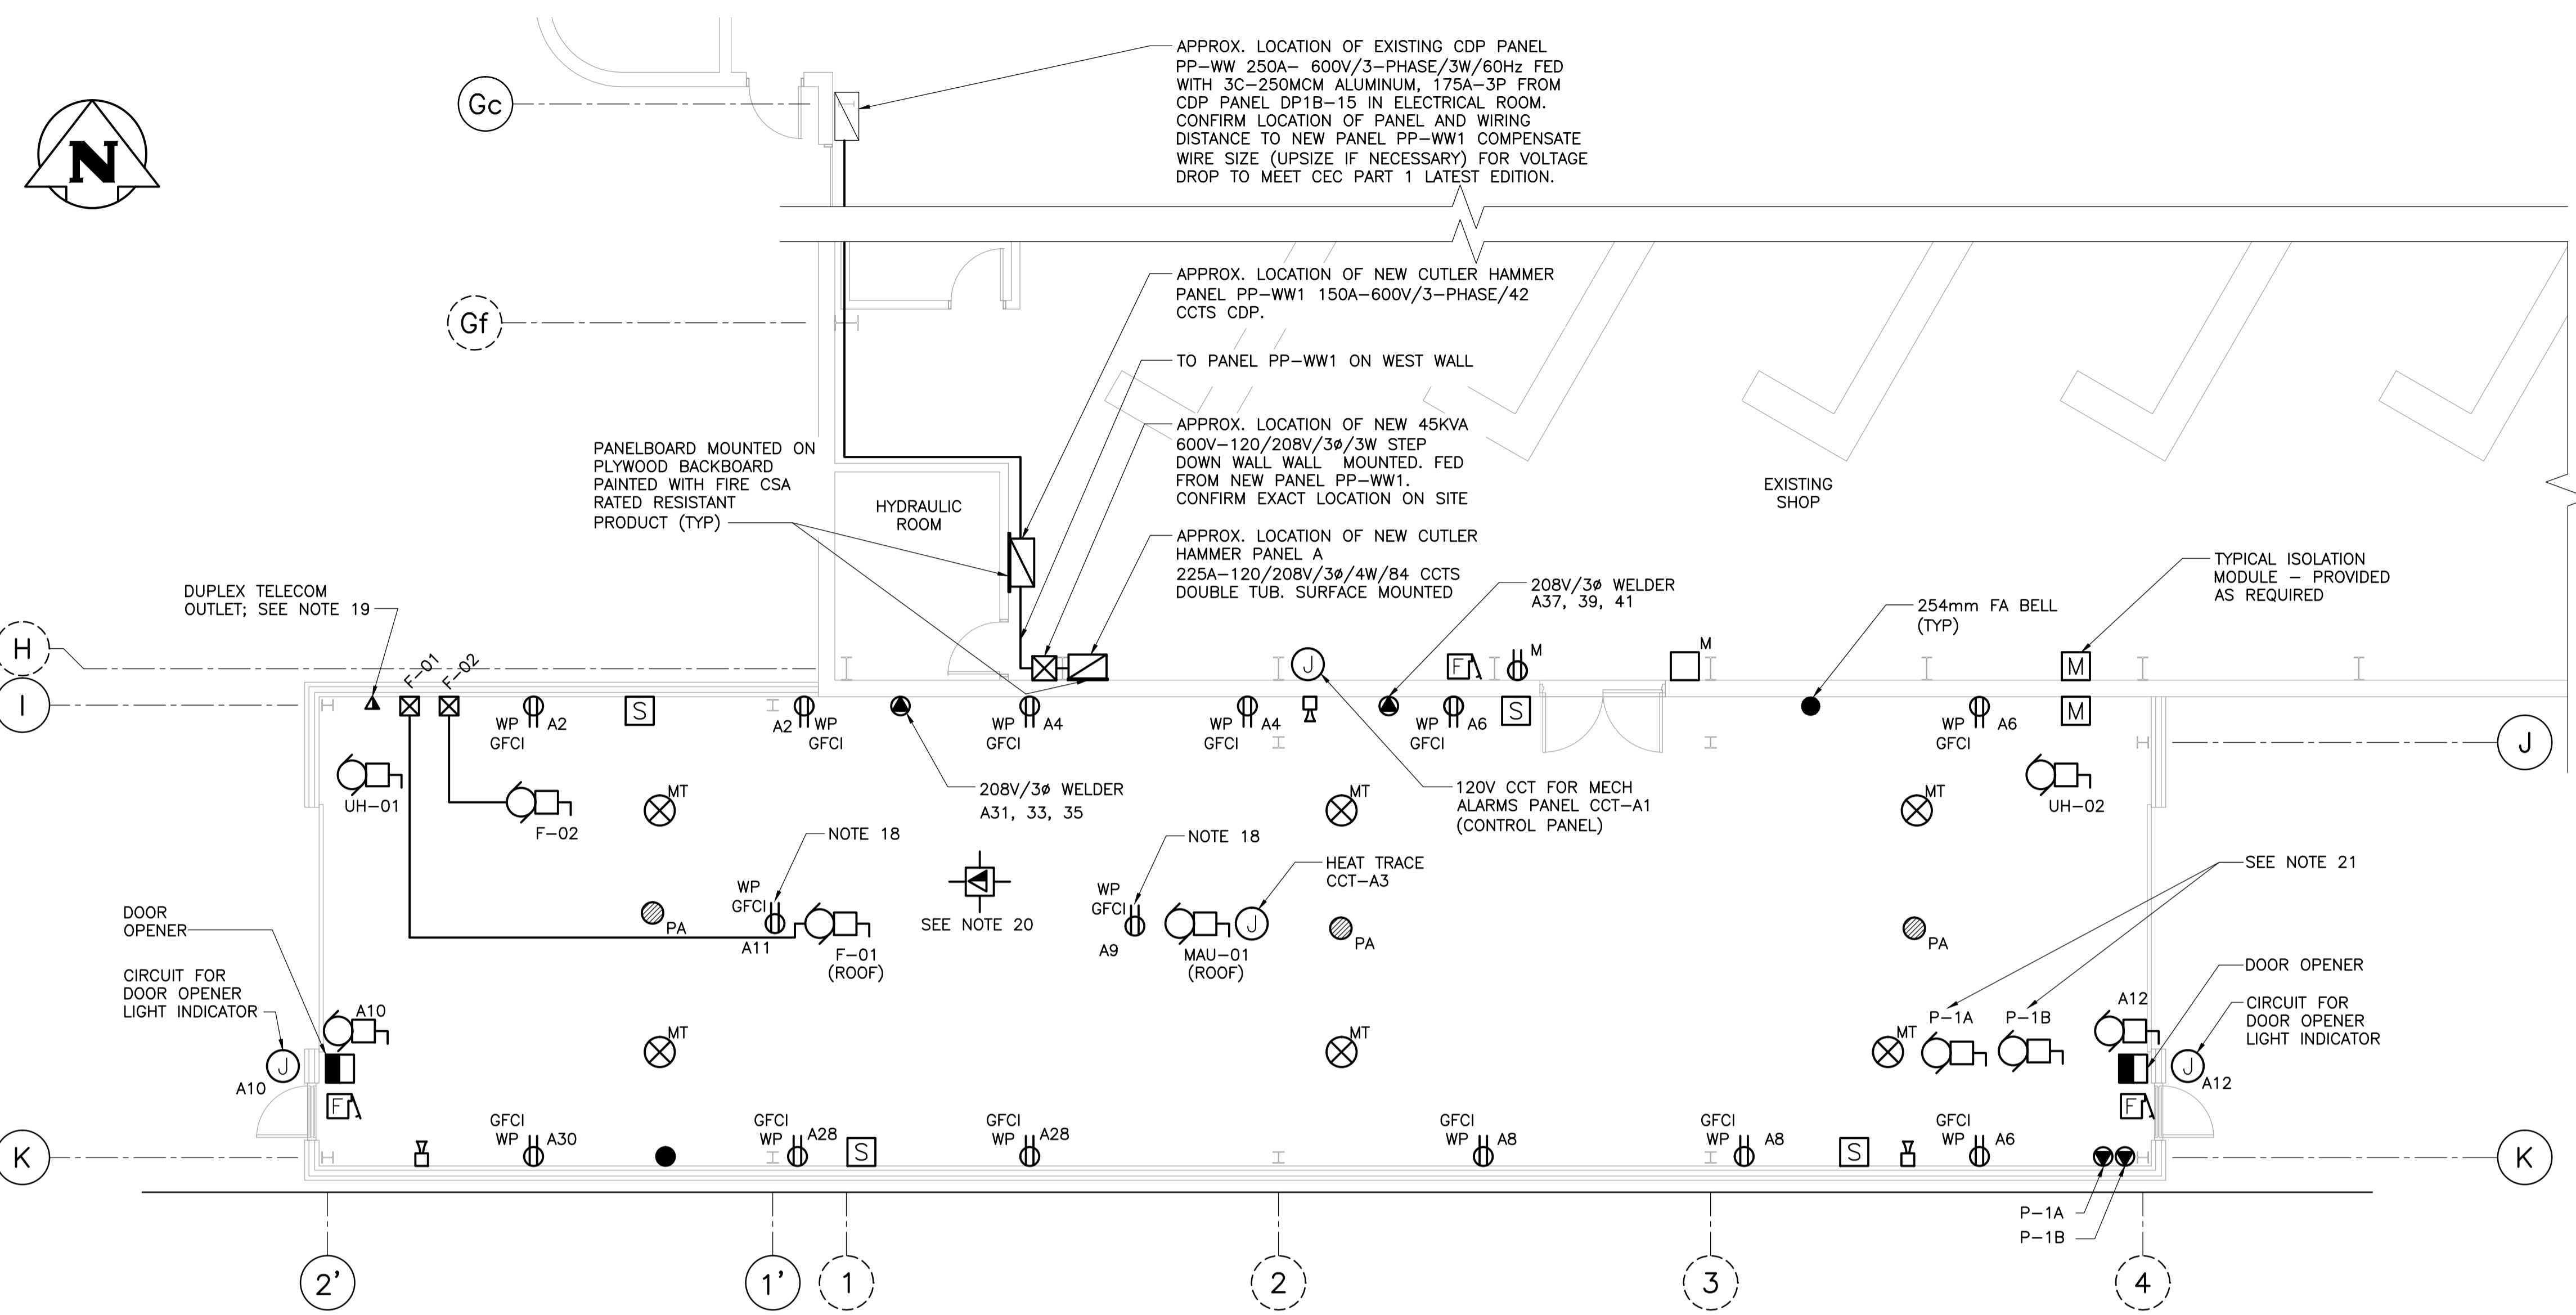

1 FLOOR PLAN
1 : 75

21. INSTALL ISOLATION MODULES AS PER CAN/ULC-S524 LATEST EDITION.
22. ALL EMPTY CONDUITS SHALL BE COMPLETE WITH PULL CORDS AND SHALL RUN FROM CABLE TRAYS TO OUTLETS.
23. ELECTRICAL SUBCONTRACTOR TO PROVIDE POWER TO DOOR OPENERS. WIRING OF DOOR COMPONENTS AND CONTROLS SHALL BE COORDINATED BY DOOR INSTALLER.

EMERGENCY LIGHTING SCHEDULE					
TYPE	DESIGN	MANUFACTURER	CATALOGUE NO.	VOLTS	REMARKS
EXIT SIGN	E-1	LUMACELL	LER3-500-WH-120	120V	4X RATED EXIT SIGN
EMERGENCY HEADS	-	LUMACELL	MQM-2-LD13	24VDC	MICRO LIGHT SERIES, C/W 24V-4W LED LAMP. CSA CERTIFIED.
BATTERY UNITS	BB1	LUMACELL	RG24S-144-2-LD13	120V 24V	SUPPLY VOLTAGE: 120VAC OUTPUT VOLTAGE: 24VDC OPERATING TIME: 30 MINUTES BATTERY: SEALED, MAINTENANCE FREE. CHARGER: SOLID STATE, MULTI-RATE, VOLTAGE/CURRENT REGULATED, INVERSE TEMP. COMPENSATED, SHORT CIRCUIT PROTECTED, MODULAR CONSTR. SOLID STATE TRANSFER, LOW VOLTAGE DISC. SIGNAL LIGHTS "LED". HEAD: C/W TWO ADJUSTABLE EMERG. LTG. HEADS. MOUNTING: C/W T.L. RECEPTACLE, AND MOUNTING SHELF.

- NOTES:**
- REFER TO ELECTRICAL KEY PLAN AND SYMBOL LEGEND DWG E0001 FOR ELECTRICAL SYMBOL SCHEDULE AND LETTERS DESIGNATION
 - ELECTRICAL SUBCONTRACTOR TO CONFIRM EXPANDABILITY AND CAPACITY OF EXISTING FIRE ALARM SYSTEM. INCLUDE ALL COSTS FOR PROGRAMMING, EXPANSION AND MODIFICATIONS TO COMPLY WITH DESIGN AND APPLICABLE CODES TO MAKE THE SYSTEM OPERATIONAL.
 - ELECTRICAL SUBCONTRACTOR TO SUPPLY, INSTALL WIRE AND CONNECT NEW FIRE ALARM DEVICES TO EXISTING ZONES. COORDINATE LOCATIONS WITH MECHANICAL SUBCONTRACTOR AND TRADES INVOLVED. NEW FIRE ALARM DEVICES TO MATCH EXISTING IN ALL RESPECTS.
 - MOUNTING HEIGHT OF DEVICES AND SPACING BETWEEN HVAC DIFFUSERS AND FIRE ALARM DEVICES TO BE AS PER CAN/ULC-S524 LATEST EDITION.
 - ALL DEVICES TO HAVE DEDICATED GROUNDING.
 - ELECTRICAL SUBCONTRACTOR TO PROVIDE ALL WIRING AND RELAYS REQUIRED TO INTERLOCK MECHANICAL AND FIRE ALARM SYSTEMS.
 - INCLUDE ALL COSTS FOR FIRE ALARM TESTING, VERIFICATION AND REPLACEMENT OF EXISTING DEVICES NOT PERFORMING WITHIN THE AREA OF RENOVATION.
 - TESTING AND VERIFICATION TO INCLUDE MAIN NOTIFIER FIRE ALARM PANEL (LOCATED AT THE MAIN ENTRANCE), DEVICES, LOOPS AND ZONES AFFECTED BY THIS RENOVATION/ADDITION.
 - ELECTRICAL CONTRACTOR TO PROVIDE WALL AND CEILING MOUNTED FRAME STRUCTURALLY CAPABLE TO ACCOMMODATE TRANSFORMER. CONFIRM SIZE AND WEIGHT PREVIOUS TO INSTALLATION.
 - REFER TO ARCHITECTURAL DRAWINGS FOR BUILDING DETAILS.
 - ELECTRICAL CONTRACTOR TO WIRE NEW PANELS AND TELECOM SERVICES USING PORTIONS EXISTING CABLE TRAY (NEW POWER WIRING TO BE RUN IN UNDERSIDE OF CABLE TRAY) AND ADD SECTIONS AS NECESSARY. APPROXIMATE DISTANCE BETWEEN EXISTING PANEL PP-WW AND NEW PANEL PP-WW1 IS 200 FT. CONFIRM WITH PANEL MANUFACTURER HARDWARE AVAILABILITY FOR PANEL PP-WW TO ACCOMMODATE NEW 125A BREAKER FOR NEW PANEL PP-WW1.
 - ALL TELECOM CONDUITS TO BE 27mm MIN UNLESS NOTED OTHERWISE.
 - ELECTRICAL SUBCONTRACTOR SHALL CONTACT THE CONTRACT ADMINISTRATOR FOR A PHYSICAL INSPECTION OF THE CONDUIT SYSTEM PRIOR TO THE PLACEMENT OF CABLING. INSPECTION SHALL BE CONDUCTED AT THE SAME TIME AS A SITE MEETING.
 - ALL TELECOM OUTLET LOCATIONS TO BE CONFIRMED ON SITE AND APPROVED BY THE CITY OF WINNIPEG. ALL PHONE SYSTEMS TO BE DONE BY MTS. THE ELECTRICAL SUBCONTRACTOR TO HIRE MTS, COORDINATE WORK IN ADVANCE TO MEET ALL THE CITY OF WINNIPEG REQUIREMENTS AND CARRY ALL COSTS ASSOCIATED TO A COMPLETE AND OPERATIONAL SYSTEM.
 - THE CITY OF WINNIPEG SHALL SUPPLY, INSTALL AND TERMINATE ALL DATA AND NETWORKING WIRING AND SUPPLY AND INSTALL ALL ACTIVE EQUIPMENT (COMPUTERS, SWITCHES, ROUTER, TELEPHONES, ETC.)
 - ELECTRICAL SUBCONTRACTOR TO INCLUDE 3/4" EMT EMPTY CONDUIT FOR ADDITIONAL SPEAKERS FOR PUBLIC ADDRESS SYSTEM AND RELOCATE ALL EXISTING CONFLICTING SPEAKERS AS PER CITY OF WINNIPEG DESIGNATED LOCATIONS. NEW SPEAKERS, WIRING AND CONNECTIONS BY THE CITY OF WINNIPEG.
 - ELECTRICAL SUBCONTRACTOR TO PROVIDE 3/4" EMT EMPTY CONDUIT FOR ADDITIONAL WHISTLE HORN DEVICES AS INDICATED BY THE CITY OF WINNIPEG. THE CITY OF WINNIPEG TO PROVIDE ALL WIRING, TERMINATIONS AND ADDITIONAL DEVICES.
 - EQUIPMENT MAINTENANCE RECEPTACLE (FOR ROOF MOUNTED EQUIPMENT): PROVIDE AND INSTALL WEATHERPROOF DUPLEX RECEPTACLE CSA CONFIGURATION 5-20R, PROTECTED WITH A GFCI CLASS A CIRCUIT BREAKER 15A-1P. DEDICATED CIRCUIT A9, A11 TO BE WIRED WITH 2-#12 RW90+G CONDUCTORS IN 27mm EMT CONDUIT. RECEPTACLE TO BE LOCATED WITHIN 7.5m OF THE ROOF TOP ELECTRICAL EQUIPMENT AND MINIMUM OF 750mm ABOVE FINISHED ROOF. RECEPTACLE TO BE PROTECTED FROM MECHANICAL DAMAGE. UPDATE PANEL BOARDS DIRECTORY AND AS-BUILT DRAWINGS TO BE INCORPORATED IN O&M MANUALS.
 - DUPLEX TELECOM OUTLET. PROVIDE ALL CABLES, TERMINATIONS AND CONNECTIONS TO MAKE JACKS OPERATIONAL.
 - PROVIDE CEILING MOUNTED 120V RECEPTACLE AND EMPTY TELECOMMUNICATIONS CONDUIT FOR OWNERS' SUPPLIED AND