


- NOTES:**
- REFER TO DUCT SCHEDULE FOR MATERIAL
 - ALL EXHAUST ODOROUS DUCTWORK FROM WASTE SLUDGE SUMP TO DISCHARGE DAMPER OF FAN EF-K611/K612 ON ROOF ARE TO BE STAINLESS STEEL
 - ALL SUPPLY AIR DUCTWORK ON AHU-K610 ARE TO BE STAINLESS STEEL
 - ALL EXHAUST ODOROUS DUCTWORK FROM DISCHARGE DAMPER OF FAN EF-K611/K612 ON ROOF TO EXISTING STACK ARE TO BE FRP
 - FIELD RUN REFRIGERANT LINES FROM ACC UNITS TO CONDENSERS IN BASEMENT SERVICE GALLERY
 - FIELD RUN ALL CONDENSATE DRAIN PIPES FROM ACC UNITS TO BALLAST ROOM HUB DRAIN

PRIMARY CLARIFIER TANK 1

GROUND FLOOR PLAN
1:100

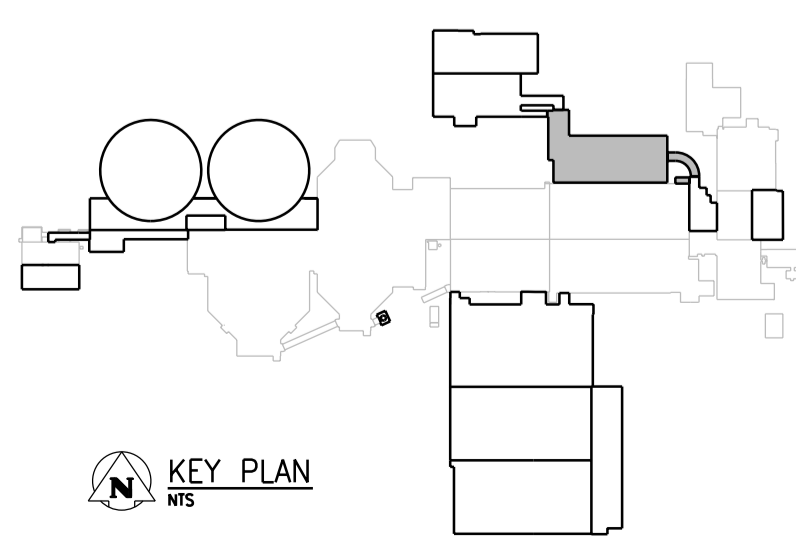

DESIGNED BY: D. LE CHECKED BY: T. TRAN DRAWN BY: K. FONG APPROVED BY: D. LE SCALE: 1:100 DATE: 2015/08/13		ISSUED FOR CONSTRUCTION BY: T. TURZAK DATE: 2015/08/13		SOUTH END WATER POLLUTION CONTROL CENTRE SEWPPCC UPGRADING/EXPANSION PROJECT MECHANICAL HIGH RATE CLARIFICATION BUILDING HVAC - GROUND FLOOR PLAN		CITY DRAWING NUMBER: 1-0102-MGAD-K602 SHEET: 00 REV: A1 SIZE: A1	
00 ISSUED FOR TENDER NO. REVISIONS		08/2015 DATE		K.F. J.C. DESIGN CHECK		CONSULTANT NO.: 474248	