


FUSE SCHEDULE			
TB	IDENTIFIER	SIZE	RATED CURRENT (A)
TB04	1	5x20mm	0.2
	2	5x20mm	0.2
	3	5x20mm	0.2
	4	5x20mm	0.2
	5	5x20mm	0.2
	6	5x20mm	0.2
	7	5x20mm	0.2
	8	5x20mm	0.2
	9	5x20mm	0.2
	10	5x20mm	0.2
	11	5x20mm	0.2
	12	5x20mm	0.2
	13	5x20mm	0.2
	14	5x20mm	0.2
	15	5x20mm	0.2
	16	5x20mm	0.2

NOTES:
 1. CR04 CONTACTS HAVE NO CONNECTION. THIS RELAY IS FOR FUTURE.



DRAWING NUMBER	REFERENCE DRAWINGS

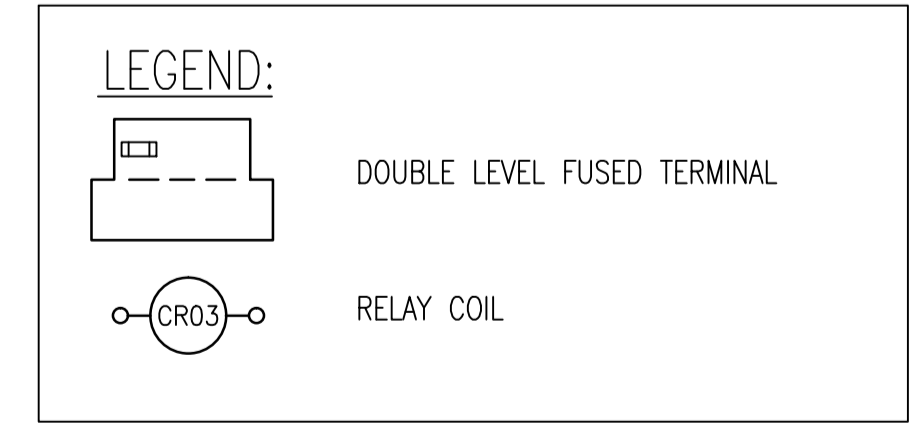

NO.	REVISIONS	DATE	DESIGN	CHECK
01	REVISED OUTPUT RELAYS	2015/09/28	BJC	-
00	ISSUED FOR TENDER	2015/09/17	BJC	-

SNC-LAVALIN INC. 148 Nature Park Way Winnipeg, MB, Canada R3P 0X7 204-786-8080	
DESIGNED BY: B. CLEVEN	CHECKED BY:
DRAWN BY: C. BURZYNSKI	APPROVED BY:
SCALE: NTS	ISSUED FOR CONSTRUCTION BY:
DATE: 2015/08/06	DATE:
CONSULTANT NO.:	

ENGINEER'S SEAL
PRELIMINARY
NOT TO BE USED FOR CONSTRUCTION

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT
 OLIVE WASTEWATER PUMPING STATION
 2015 UPGRADES
 RTU I/O WIRING DIAGRAM
 CONTROL PANEL CP-LB1
 DISCRETE OUTPUTS 00001-00016
 CITY DRAWING NUMBER: **1-0169L-A0004** SHEET REV. SIZE: **001 01 A1**