


Railing Section
L-5 Scale: 1:20

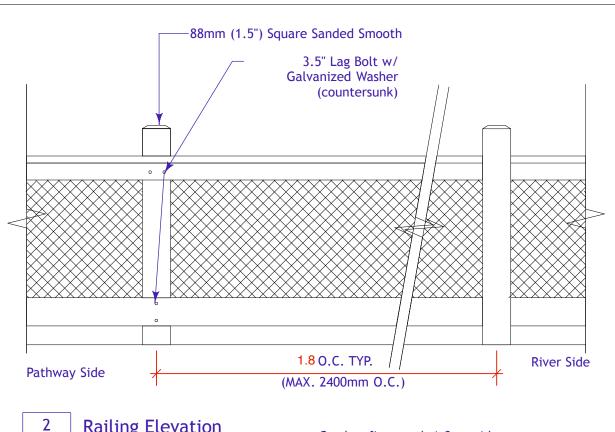

Railing Elevation Crusher fines path 1.8 m wide-Scale: 1:20 Compacted Granular Sub-Base. Where depthexceeds 15 cm to be compacted in lifts to min 95% of proctor density. Installation in 0.7m 1.8m frozen condition is prohibited. Existing Slope-Fence - See Detail-Durahold II wall (number ofcourses varies - see plan) Non-Woven Geotextile on back of wall 10 cm. dia weeping tilec.w. sock. Drain to air. Non-Woven Geotextileon subgrade Site Restoration **Existing Site Durahold II Retaining Wall**

Scale: 1:50

B 15-10-26 For Bid Opp A 15-10-11 For Review

No. Date Issue Notes

Drawing No.

Royalwood Site Improvements

John Bruce Details

