


NOTE: CHAINAGES SHOWN ARE ALONG W. R. OF WIDLAKE STREET

WIDLAKE STREET

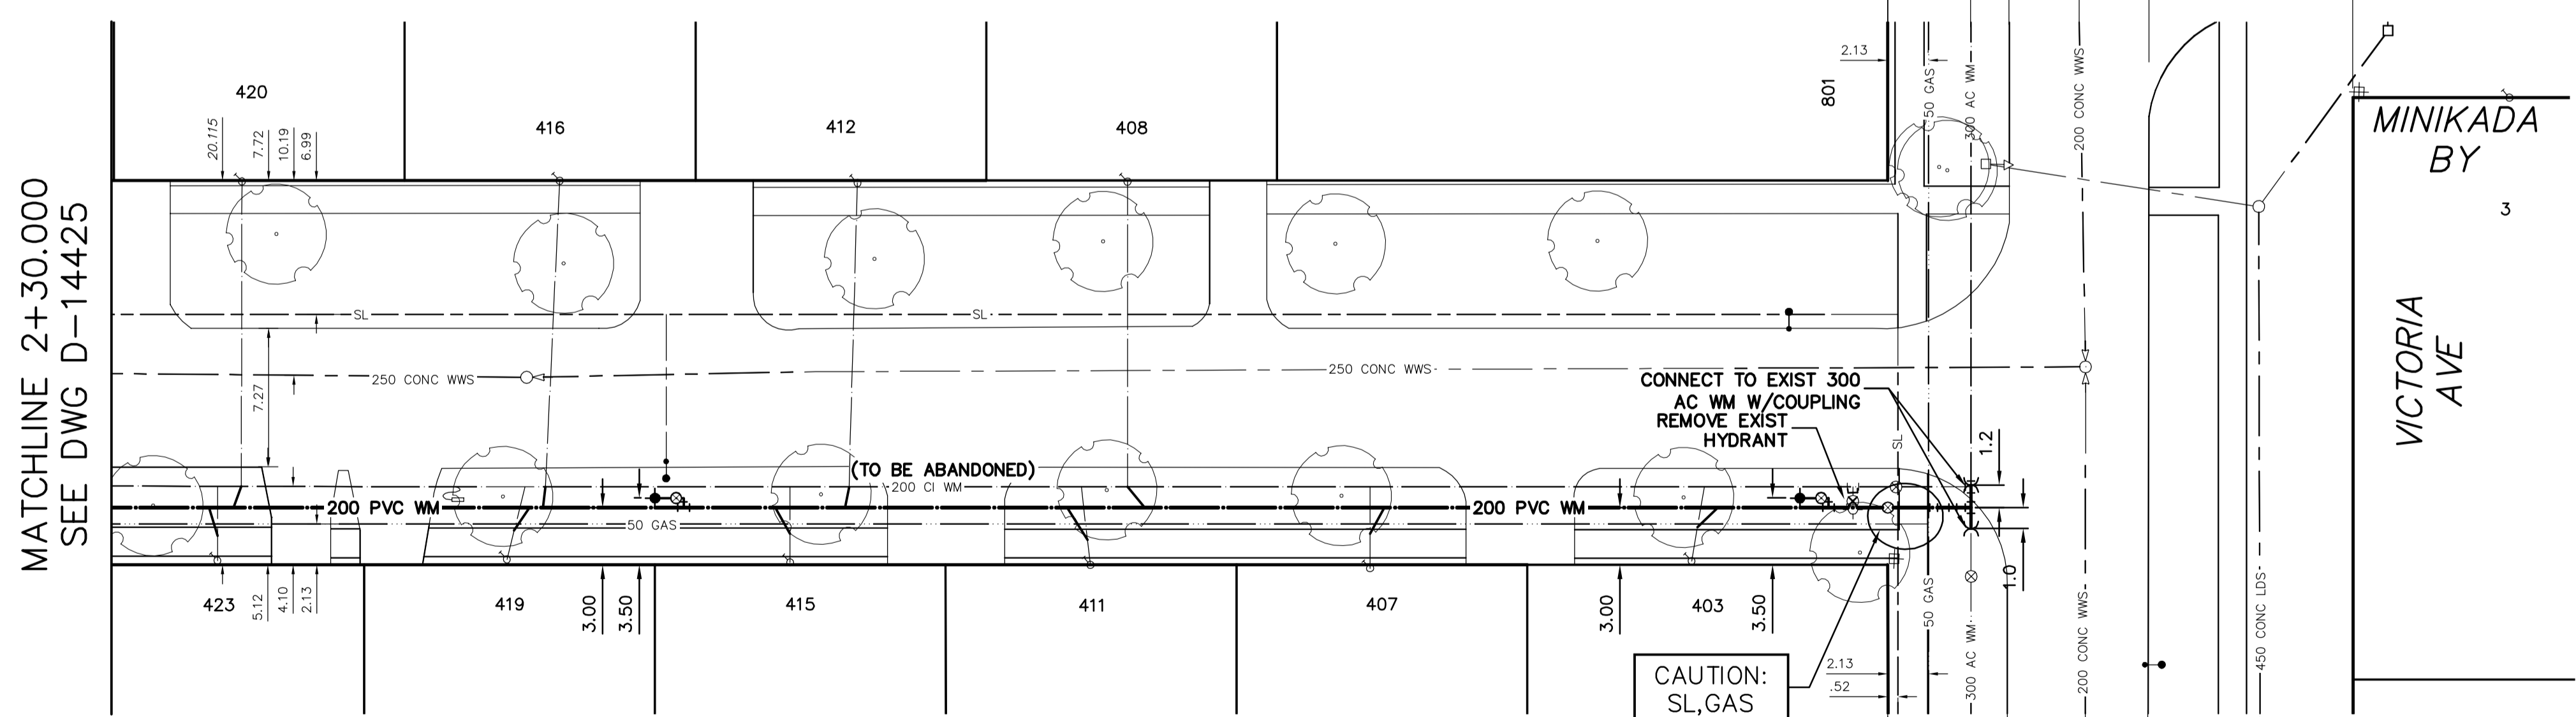

CAUTION GAS ON W SIDE

ALL CORP CONNECTIONS MAY NOT BE REPRESENTATIVE OF ACTUAL LOCATION


WATER SERVICE INFORMATION

ADDRESS	SIZE (mm) MATERIAL (STREET)	SIZE (mm) MATERIAL (PROP.)	SHORT & LONG MEASUREMENT	CORP. LOCATION	REMARKS
471 WIDLAKE ST	20	20	4.79 SNL HSE		OUTSIDE LIMITS
471 WIDLAKE ST	CU	CU	8.367>NNL COLDSTREAM AVE	2.1 S OF S/C	
485 WIDLAKE ST		20	2.61 NSL HSE		RECONNECT SERVICE
485 WIDLAKE ST		CU	8.949>NNL COLDSTREAM AVE		
451 WIDLAKE ST		20	7.51 SNL HSE		RECONNECT SERVICE
451 WIDLAKE ST		CU	26.880>NNL COLDSTREAM AVE		
447 WIDLAKE ST		20	8.28 SNL HSE		RECONNECT SERVICE
447 WIDLAKE ST		CU	42.901>NNL COLDSTREAM AVE		
443 WIDLAKE ST		20	4.15 NSL HSE		RECONNECT SERVICE
443 WIDLAKE ST		CU	59.479>NNL COLDSTREAM AVE		
439 WIDLAKE ST		20	4.28 NSL HSE		RECONNECT SERVICE
439 WIDLAKE ST		CU	74.672>NNL COLDSTREAM AVE		
435 WIDLAKE ST		20	4.69 NSL HSE		RECONNECT SERVICE
435 WIDLAKE ST		CU	90.418>NNL COLDSTREAM AVE		
432 WIDLAKE ST		20	4.00 NSL HSE		RECONNECT SERVICE
432 WIDLAKE ST		CU	131.608>NNL VICTORIA AVE		
431 WIDLAKE ST		20	0.15 NSL HSE		RECONNECT SERVICE
431 WIDLAKE ST		CU	108.694>NNL COLDSTREAM AVE		
428 WIDLAKE ST		20	5.53 NSL HSE		RECONNECT SERVICE
428 WIDLAKE ST		CU	116.232>NNL VICTORIA AVE		
427 WIDLAKE ST		20	5.47 NSL HSE		RECONNECT SERVICE
427 WIDLAKE ST		CU	125.881>NNL COLDSTREAM AVE		
424 WIDLAKE ST		20	4.58 NSL HSE		RECONNECT SERVICE
424 WIDLAKE ST		CU	101.724>NNL VICTORIA AVE		
423 WIDLAKE ST		20	0.90 NSL HSE		RECONNECT SERVICE
423 WIDLAKE ST		CU	87.619>NNL VICTORIA AVE		
420 WIDLAKE ST		20	3.93 NSL HSE		RECONNECT SERVICE
420 WIDLAKE ST		CU	86.528>NNL VICTORIA AVE		
419 WIDLAKE ST		20	5.67 NSL HSE		RECONNECT SERVICE
419 WIDLAKE ST		CU	72.436>NNL VICTORIA AVE		
416 WIDLAKE ST		20	2.16 NSL HSE		RECONNECT SERVICE
416 WIDLAKE ST		CU	69.659>NNL VICTORIA AVE		
415 WIDLAKE ST		20	4.46 NSL HSE		RECONNECT SERVICE
415 WIDLAKE ST		CU	57.581>NNL VICTORIA AVE		
412 WIDLAKE ST		20	4.57 NSL HSE		RECONNECT SERVICE
412 WIDLAKE ST		CU	54.04>NNL VICTORIA AVE		
411 WIDLAKE ST		20	3.62 NSL HSE		RECONNECT SERVICE
411 WIDLAKE ST		CU	41.827>NNL VICTORIA AVE		
408 WIDLAKE ST		20	5.66 NSL HSE		RECONNECT SERVICE
408 WIDLAKE ST		CU	39.877>NNL VICTORIA AVE		
407 WIDLAKE ST		20	3.90 NSL HSE		RECONNECT SERVICE
407 WIDLAKE ST		CU	27.157>NNL VICTORIA AVE		
403 WIDLAKE ST		20	5.29 NSL HSE		RECONNECT SERVICE
403 WIDLAKE ST		CU	10.296>NNL VICTORIA AVE		
801 VICTORIA AVE	20	20			OUTSIDE LIMITS
801 VICTORIA AVE	CU	CU			

\*SERVICES TO BE RENEWED TO R. ALL OTHERS TO BE RECONNECTED

FOR INDEX SEE D-14412

NOTE: ALL VALVES TO BE INSTALLED CLOCKWISE TO CLOSE

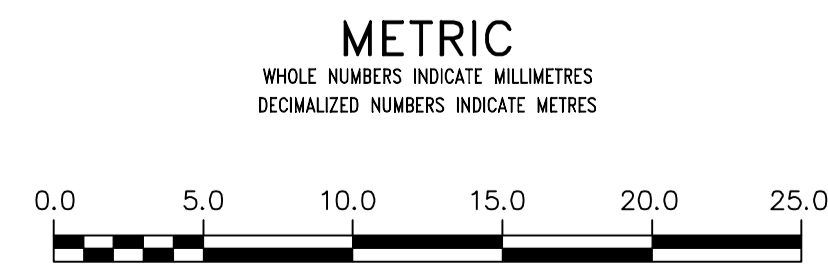

**WARNING**  
IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:  
1) NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.  
2) TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS.  
SEE PROVINCIAL REGULATION 210/72 FOR DETAILS

**LOCATION APPROVED UNDERGROUND STRUCTURES**  
SUPV. U/G STRUCTURES COMMITTEE DATE  
NOTE: LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M. ELEV.	NO.	REVISIONS	DATE	BY

DESIGNED BY	ML	CHECKED BY	SC
DRAWN BY	RS	APPROVED BY	KZ
SCALE:	HORIZONTAL 1:250	RELEASED FOR CONSTRUCTION	
	VERTICAL 1:50		
		KAS ZUREK	
		DATE 2016 10 01	DATE 2016 10 31
		PLOT DATE: 2016 11 01	

ENGINEER'S SEAL  
ORIGINAL SIGNED BY S.J.R. COUNROYER 16/10/31  
CONSULTANT DRAWING NUMBER

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT  
ENGINEERING DIVISION

2016 WATER MAIN RENEWAL  
CONTRACT 13  
WIDLAKE STREET  
130 S OF COLDSTREAM AVENUE TO VICTORIA AVENUE

SHEET 15 OF 15  
CITY DRAWING NUMBER  
D-14426