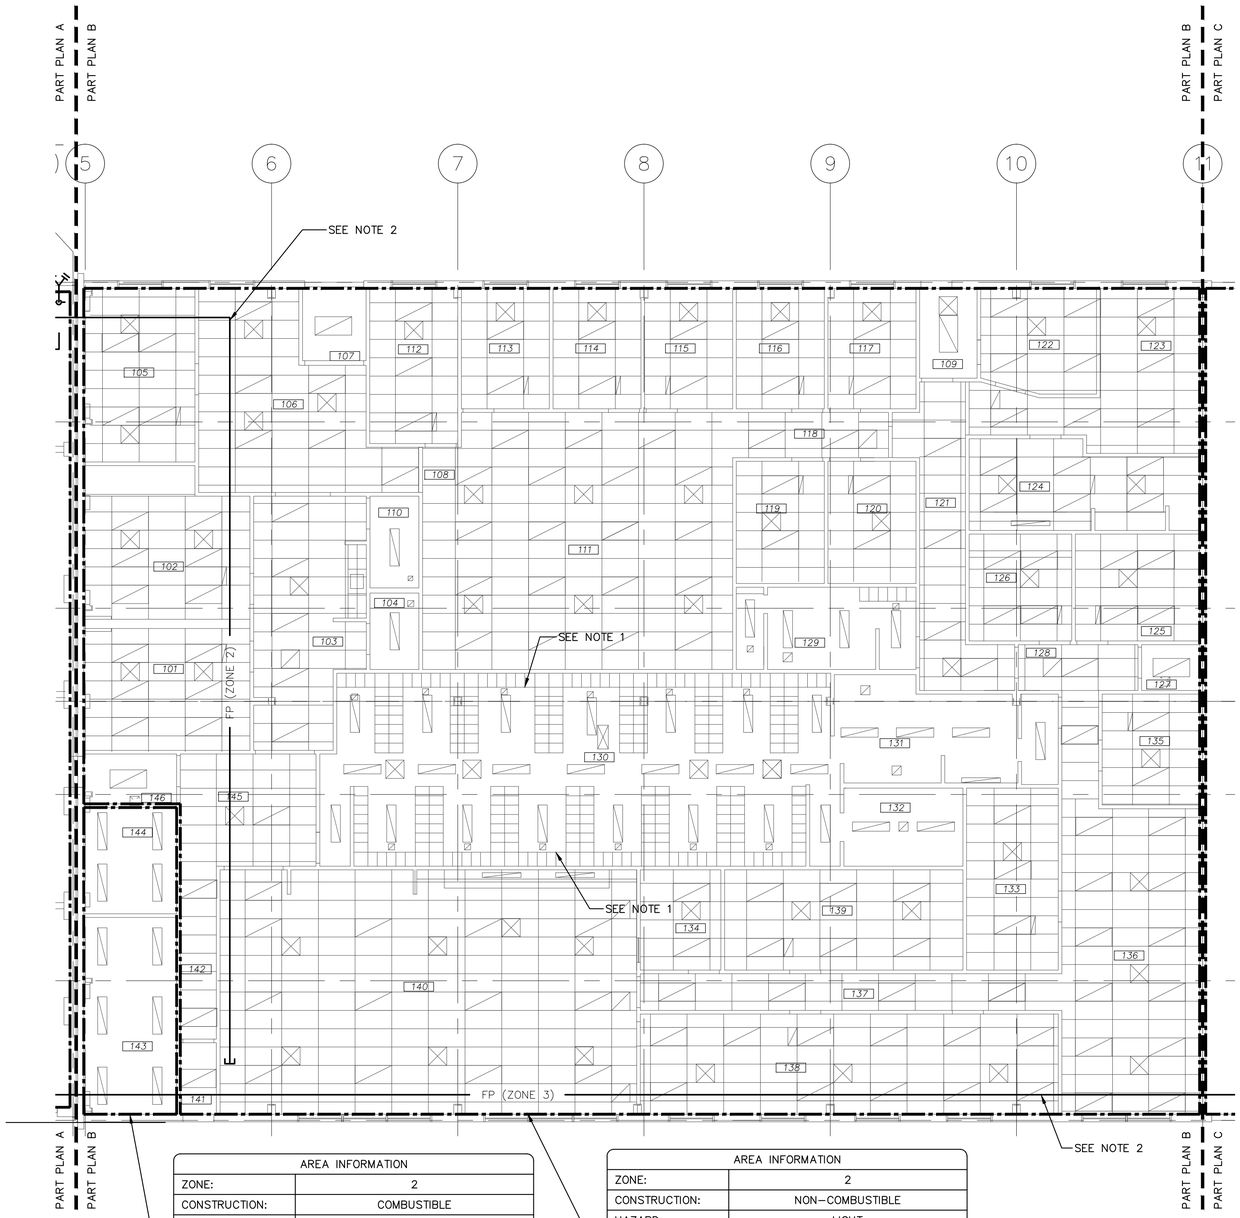

DRAWING NOTES:

1. USE OF SIDEWALL HEADS IN BULKHEAD IF SPACE IS AVAILABLE IN BULKHEAD.
2. SPRINKLER SYSTEM TO BE LOCATED ABOVE CEILING SYSTEMS UNLESS NOTED OTHERWISE.

AREA INFORMATION	
ZONE:	2
CONSTRUCTION:	COMBUSTIBLE
HAZARD:	ORDINARY 1
DENSITY:	8 mm/min (0.2 gpm/ft2)
AREA:	--
SPRINKLER INFO::	UPRIGHT/STD TEMP
ADDITIONAL INFO:	WET SYSTEM WITH LESS THAN 9.15 m CEILINGS

AREA INFORMATION	
ZONE:	2
CONSTRUCTION:	NON-COMBUSTIBLE
HAZARD:	LIGHT
DENSITY:	4 mm/min (0.1 gpm/ft2)
AREA:	140 m2 (1,500 ft2)
SPRINKLER INFO::	PENDENT/STD TEMP
ADDITIONAL INFO:	WET SYSTEM WITH LESS THAN 9.15 m CEILINGS

1 FIRE PROTECTION PART PLAN B OFFICES
1 : 100

0 2500 5000 7500 10000

METRIC
WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

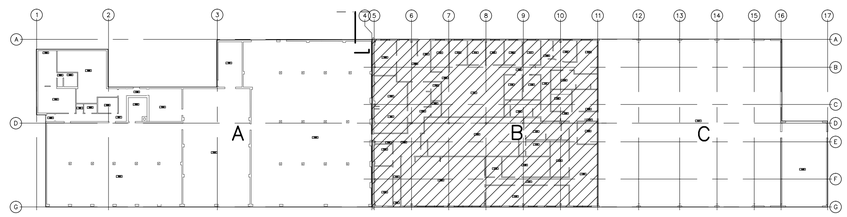

552 NORTH KEY PLAN

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES COMMITTEE — DATE

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

B.M.
ELEV.

CONSTRUCTION COMPLETION DATE: YYYY MM DD

NO.	REVISIONS	DATE	BY
0	ISSUED FOR BID OP 1077-2018	2019 01 10	JDB

DESIGNED BY	JDB	CHECKED BY	JDB
DRAWN BY	JDB	APPROVED BY	
SCALE: HORIZONTAL AS NOTED VERTICAL		RELEASED FOR CONSTRUCTION	
DATE	2019 01 11	DATE	

PLOT DATE: 2019 01 11

ENGINEER'S SEAL

ORIGINAL SIGNED BY x.x. xxxxxxx YY/MM/DD

CONSULTANT DRAWING NUMBER

BID OPPORTUNITY: XXX-20XX
CONTRACT NUMBER: X

Winnipeg

THE CITY OF WINNIPEG

WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

552 PLINGUET AVENUE
FIRE PROTECTION UPGRADES

BUILDING - 552 NORTH

PART PLAN B - OFFICES
SPRINKLER SYSTEM

SHEET 5 OF 18

CITY DRAWING NUMBER

1-0702N-M0003-001

FILE PATH: O:\PROJECTS\Water\W-819 Plinguet Fire Protection System\04-CA\01- Bid Documents\1077-2018\Drawings\
FILE NAME: 1-0702N-M0003-001.dwg