



AREA INFORMATION	
ZONE:	1
CONSTRUCTION:	NON-COMBUSTIBLE
HAZARD:	ORDINARY 1
DENSITY:	8 mm/min (0.2 gpm/ft2)
AREA:	330 m2 (3,500 ft2)
SPRINKLER INFO.:	UPRIGHT/STD TEMP
ADDITIONAL INFO:	DRY SYSTEM WITH LESS THAN 9.15 m CEILINGS

**DRAWING NOTES:**


1. PROVIDE SPRINKLER COVERAGE UNDER OVERHEAD DOORS, PROVIDE DRIP DRUMS AT LOW POINTS.
2. SEE CONTINUATION ON DRAWING ^^^ FOR MEZZANINE.

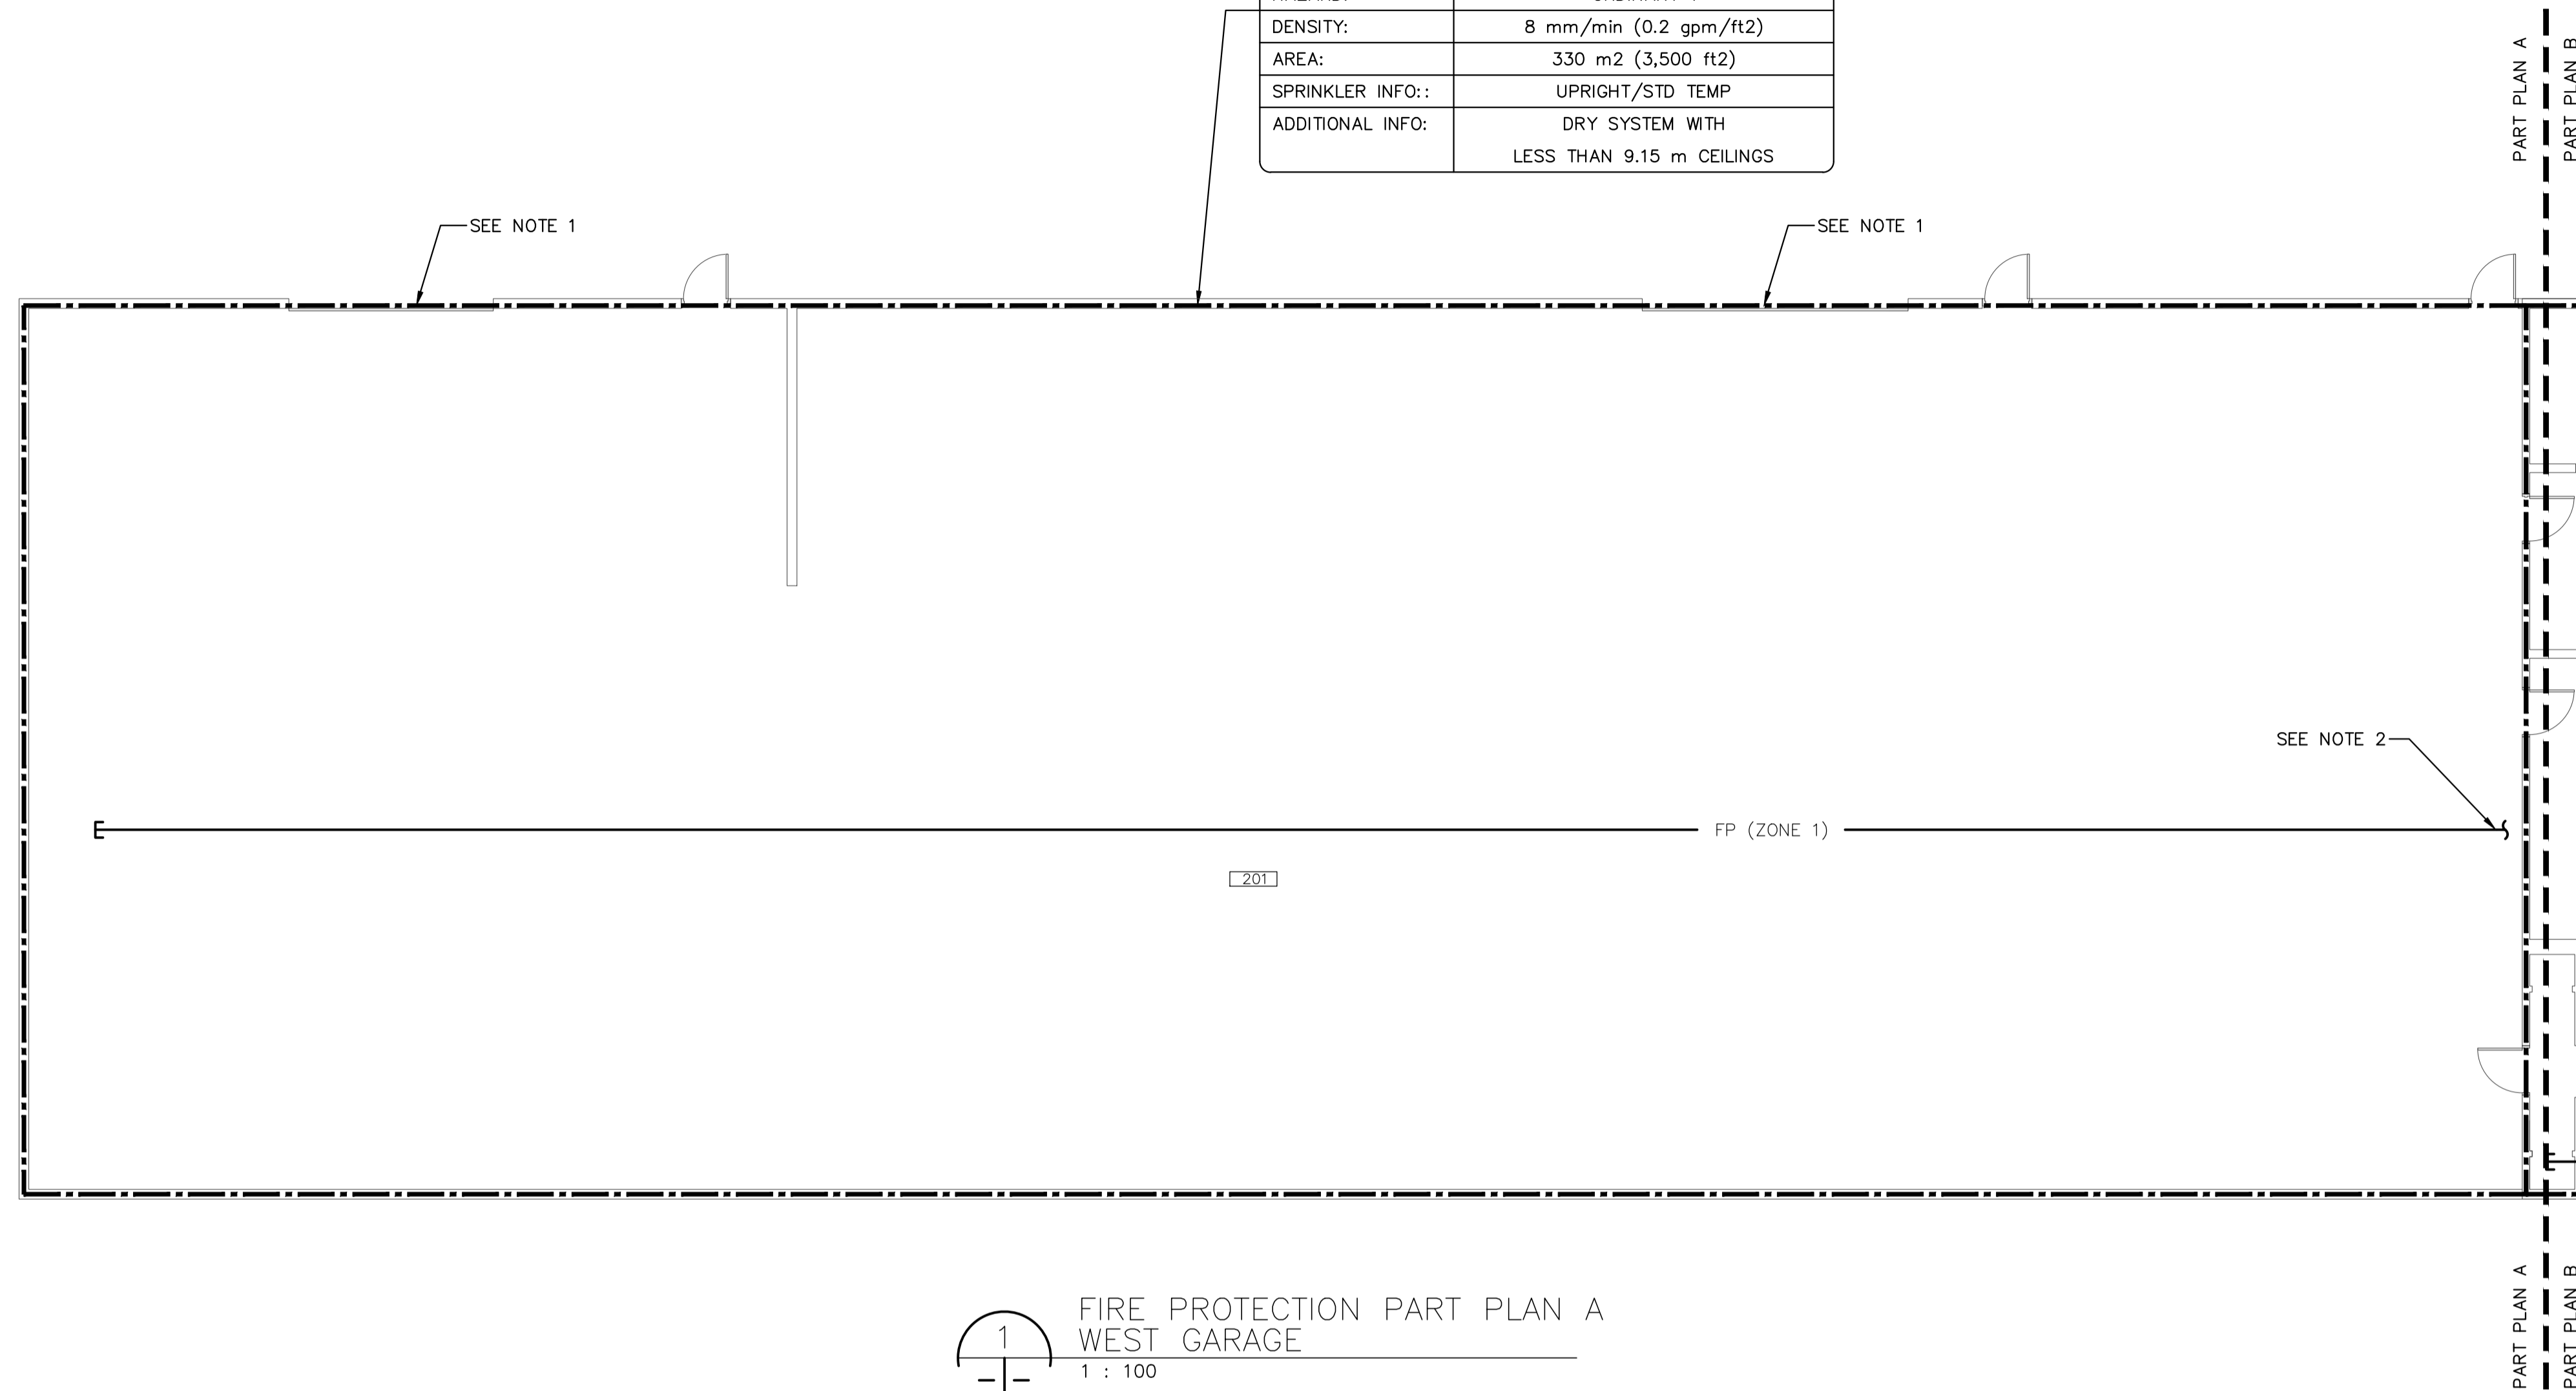

1  
FIRE PROTECTION PART PLAN A  
WEST GARAGE  
1 : 100

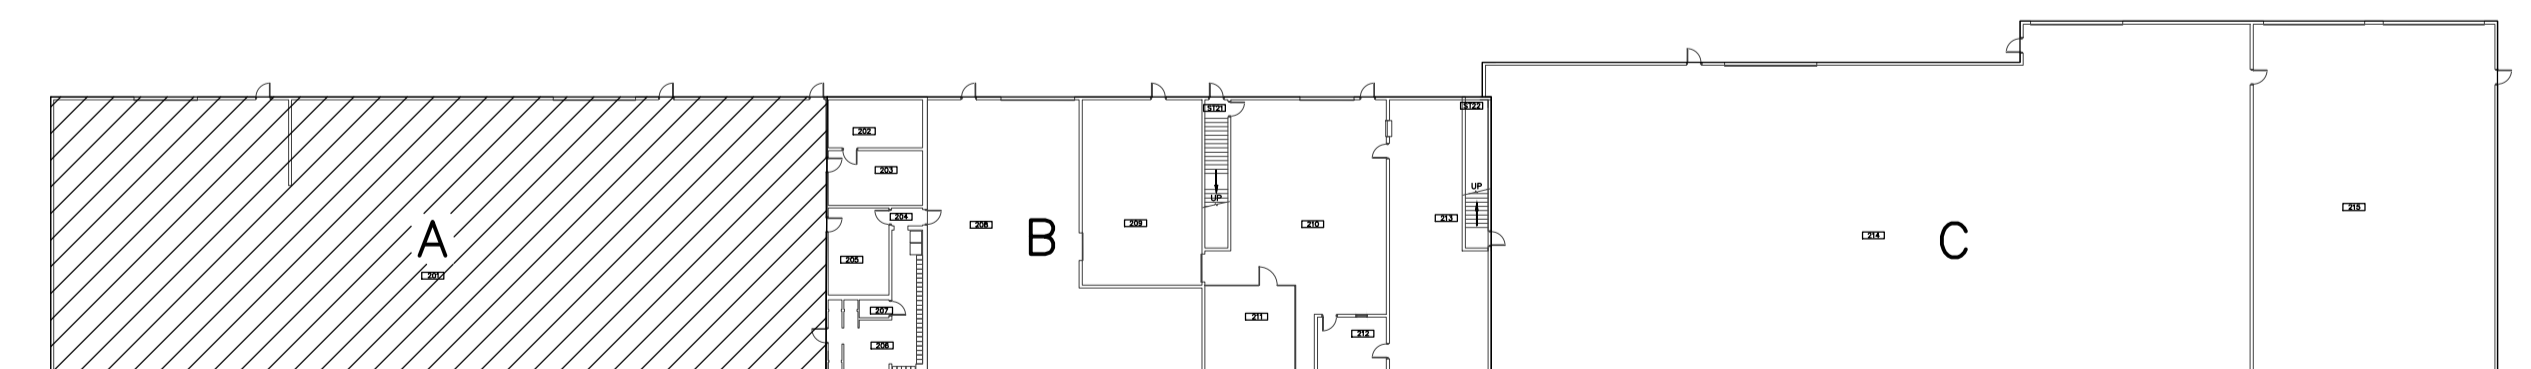

552 SOUTH KEY PLAN



**METRIC**  
WHOLE NUMBERS INDICATE MILLIMETRES  
DECIMALIZED NUMBERS INDICATE METRES

LOCATION APPROVED UNDERGROUND STRUCTURES  SUPV. U/G STRUCTURES COMMITTEE DATE  NOTE: LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.	B.M. ELEV. CONSTRUCTION COMPLETION DATE: YYYY MM DD	DESIGNED BY JDB CHECKED BY JDB  DRAWN BY JDB APPROVED BY  SCALE: HORIZONTAL AS NOTED VERTICAL DATE 2019 01 11	ENGINEER'S SEAL  ORIGINAL SIGNED BY x.x. xxxxxxxx YY/MM/DD  CONSULTANT DRAWING NUMBER	<b>THE CITY OF WINNIPEG</b> WATER AND WASTE DEPARTMENT ENGINEERING DIVISION  552 PLINGUET AVENUE FIRE PROTECTION UPGRADES BUILDING - 552 SOUTH PART PLAN A - WEST GARAGE SPRINKLER SYSTEM	SHEET 11 OF 18 CITY DRAWING NUMBER 1-0702S-M0002-001
	NO. REVISIONS DATE BY 0 ISSUED FOR BID OP 1077-2018 2019 01 10 JDB	PLOT DATE: 2019 01 11	BID OPPORTUNITY: XXX-20XX CONTRACT NUMBER: X	FILE PATH: O:\PROJECTS\Water\W-819 Plinguet Fire Protection System\04-CA\01- Bid Documents\1077-2018\Drawings\1-0702S-M0002-001.dwg	