


B SIZE - 279mm x 432mm

General DWG\1-0179F-A0002-001.dwg

LAST SAVE: 2018/12/13 - 4:45pm
PATH: M:\657381\4ENG\481C\DD -

MCC-F71
(ELECTRICAL ROOM)

RTU PANEL
(ELECTRICAL ROOM)

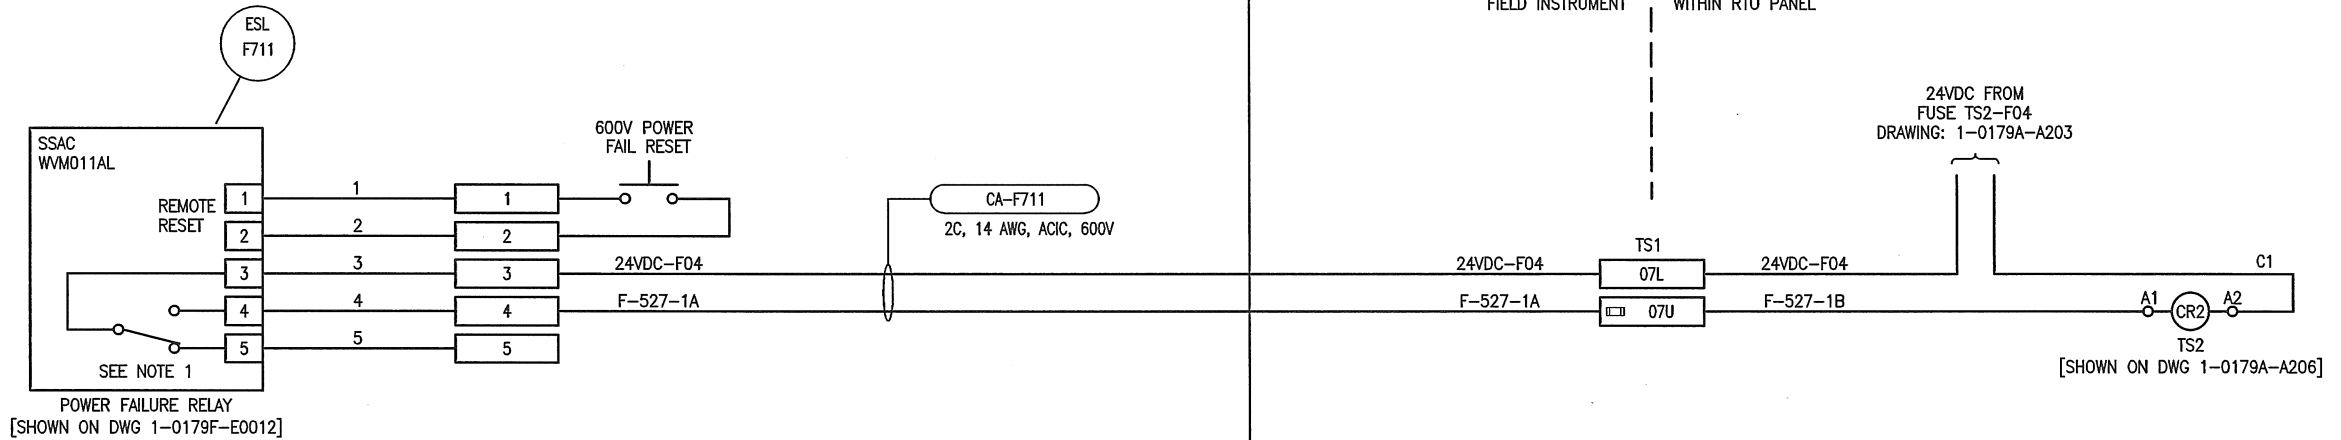

SETTINGS:
UNBALANCE = 10%
LINE VOLTAGE = 600
TRIP DELAY = 0.25 sec
RESTART DELAY = 0.25 sec
SELECTOR = MANUAL RESET


NOTES:

- CONTACT TO BE CLOSED WHEN 600V POWER IS AVAILABLE AND OPEN UPON A POWER LOSS.



SNC-LAVALIN INC.
148 Nature Park Way
Winnipeg, MB, Canada R3P 0X7
204-786-8080

ENGINEER'S SEAL

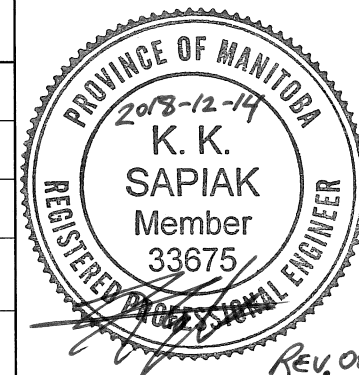

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

ROLAND FLOOD PUMPING STATION
2019 UPGRADES
LOOP DIAGRAM
MCC-F71 600 VOLT POWER STATUS
ESL-F711

NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER AND CONSTRUCTION	2018/12/14	KS	BC

DESIGNED BY: K. SAPIAK	CHECKED BY: B. CLEVEN
DRAWN BY: K. SAPIAK	APPROVED BY: B. CLEVEN
SCALE: NTS	DATE: 2018/08/23
ISSUED FOR CONSTRUCTION	
BY: K. ZUREK	DATE: 2018/12/14
CONSULTANT NO.:	

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0179F-A0002	001	00	B