


1-0179F-E0007	ELECTRICAL PLAN LAYOUT MAIN FLOOR DEMOLITION
1-0179F-E0002	ELECTRICAL SINGLE LINE DIAGRAM DEMOLITION
1-0179A-A200 - A224	ROLAND FLOOD STATION - RTU DRAWINGS
DRAWING NUMBER	REFERENCE DRAWINGS



DEMOLITION NOTES


- (A) PROVIDE DEMOLITION OF EXISTING FIELD WIRING AND ASSOCIATED CONDUIT BACK TO THE SOURCE.
- (B) DISCONNECT EXISTING FIELD WIRING TERMINATING AT THE RTU PANEL AND MARK WIRES AS INDICATED. RTU PANEL WILL BE RELOCATED TO THE ELECTRICAL ROOM. WIRING WILL BE RE-CONNECTED TO A NEW RTU MARSHALLING PANEL THAT WILL BE LOCATED IN THE SAME LOCATION AS REMOVED RTU PANEL.
- (C) PROVIDE DEMOLITION OF EXISTING 120 VAC SUPPLY WIRING AND ASSOCIATED CONDUIT BACK TO EXISTING MOTOR ROOM 120/240V PANELBOARD. A NEW 120 VAC SUPPLY WILL TIE INTO SAME RTU PANEL TERMINALS.

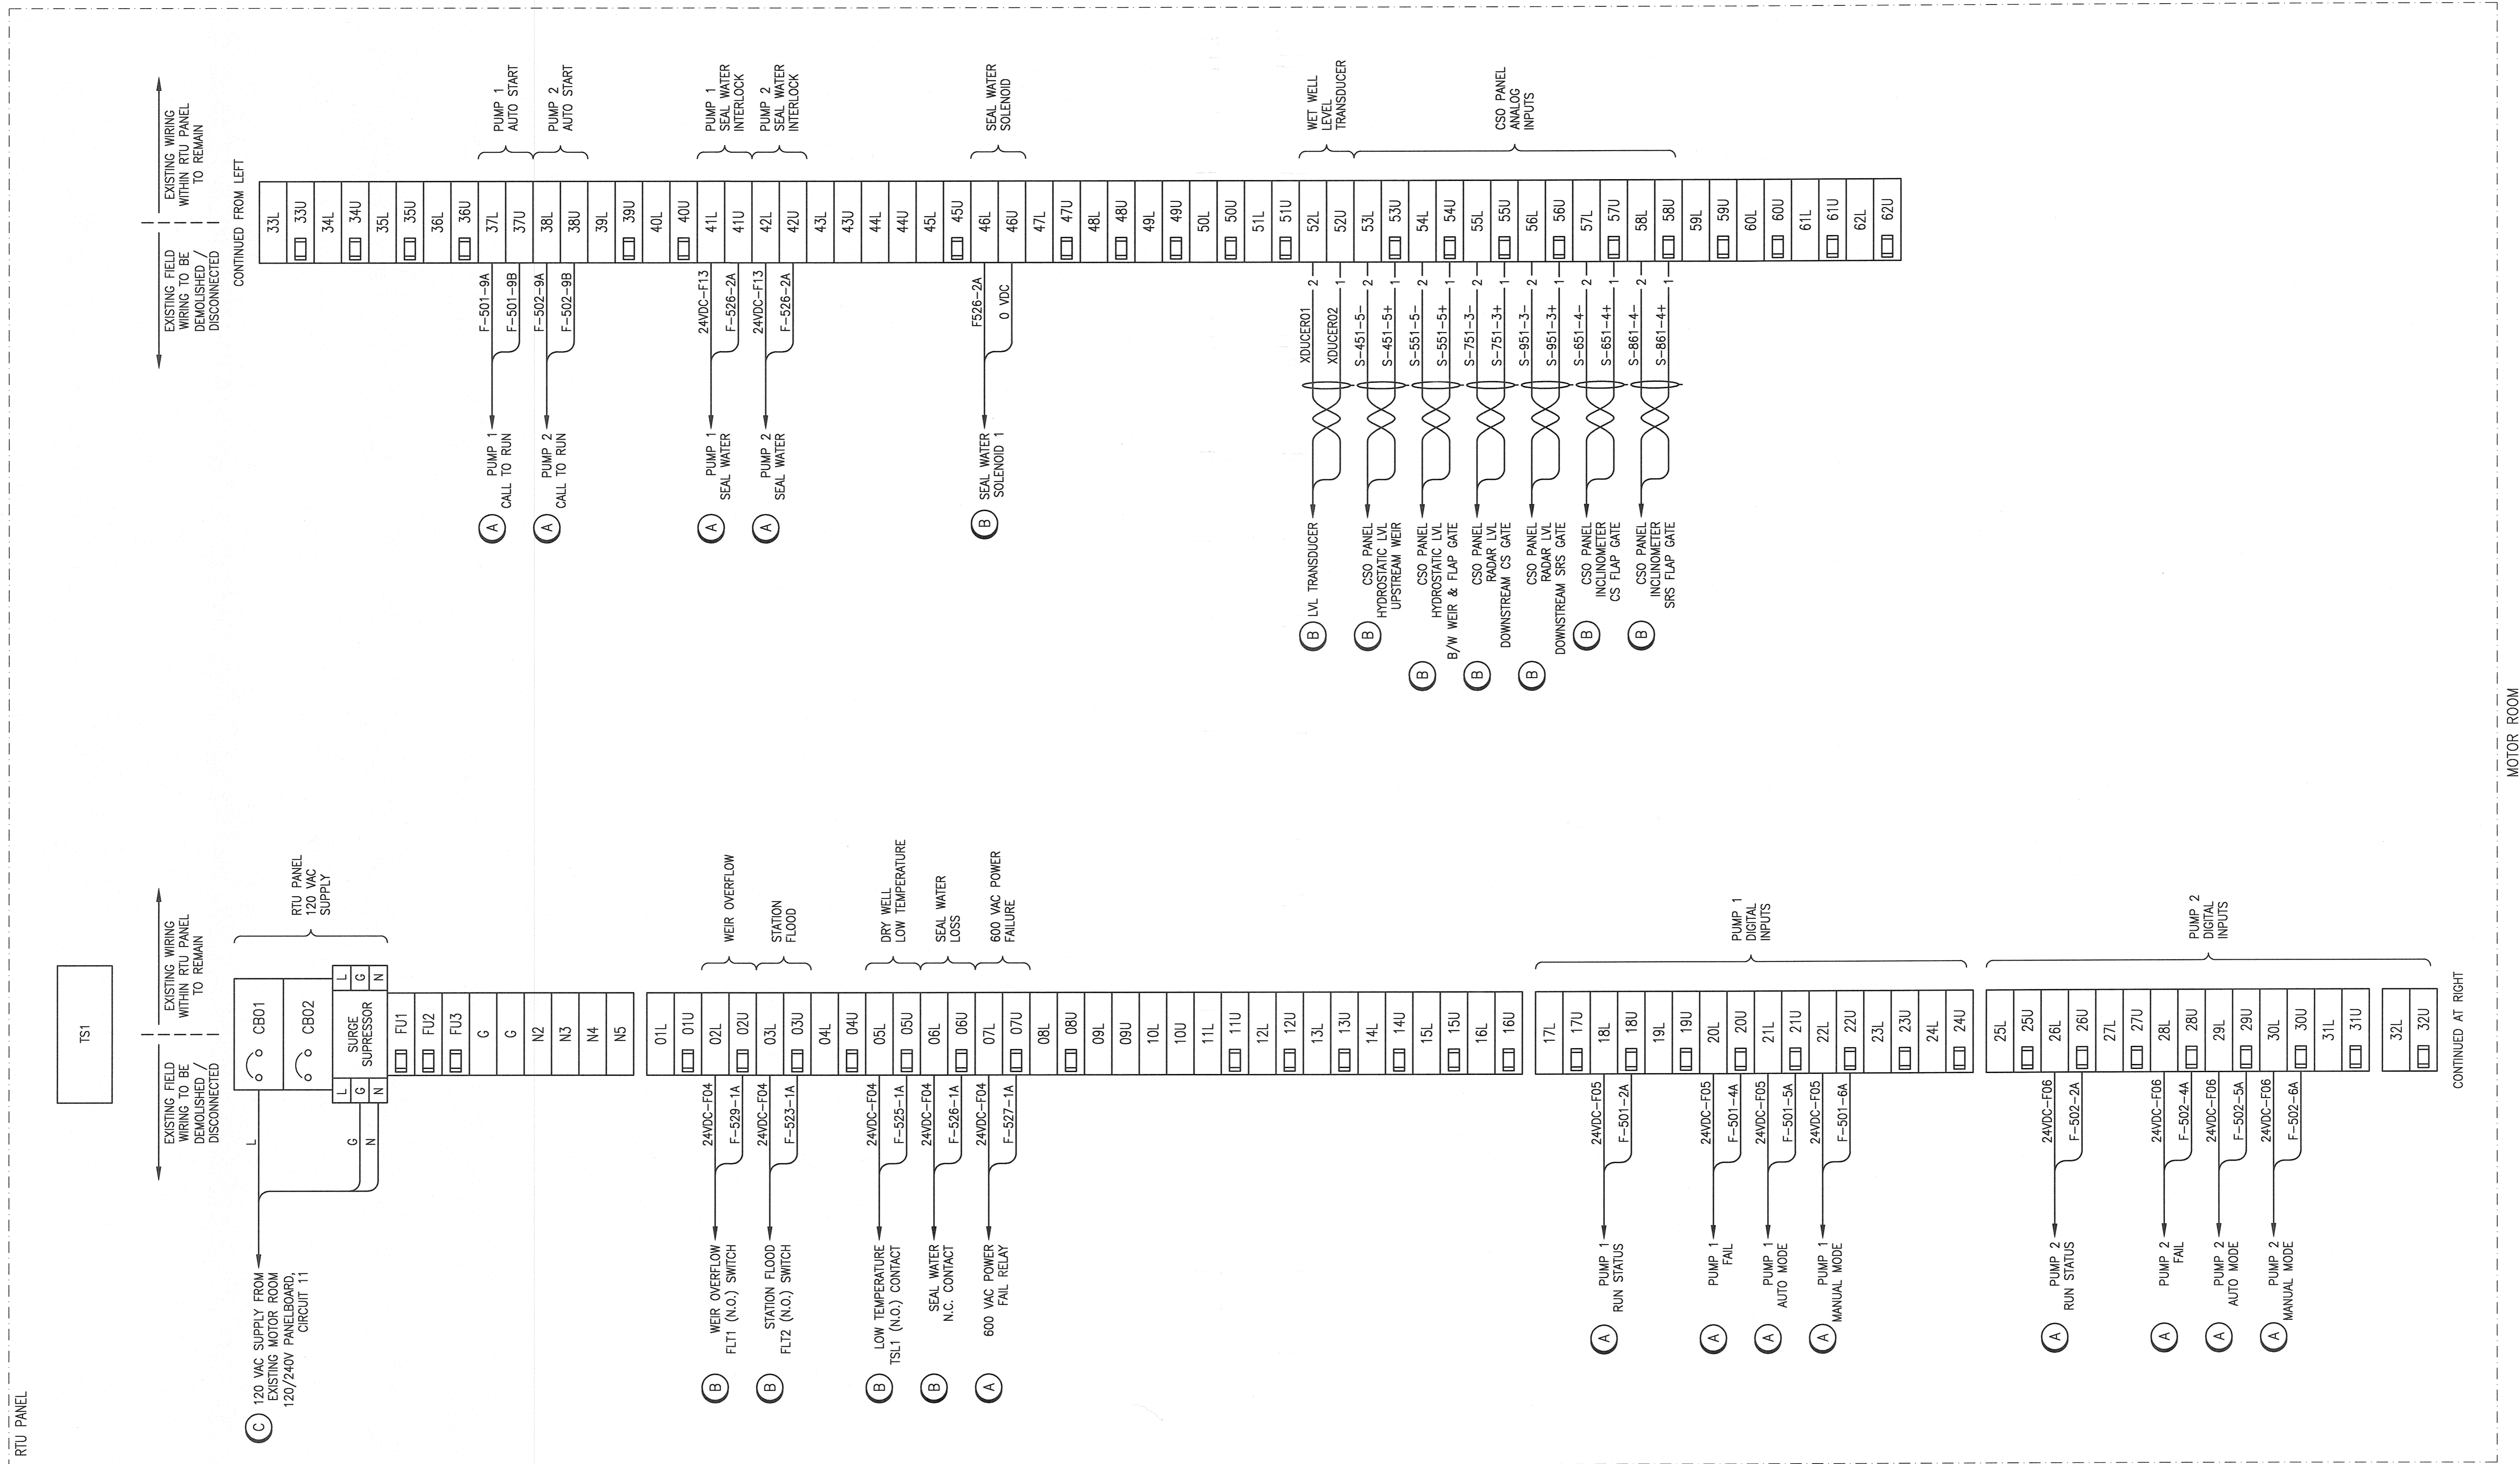

00	ISSUED FOR TENDER AND CONSTRUCTION	2018/12/14	KS	BC
NO.	REVISIONS	DATE	DESIGN	CHECK

SNC-LAVALIN INC.
 148 Neilson Park Way
 Winnipeg, MB, Canada R3P 0X7
 204-786-8080

DESIGNED BY: K. SAPIAK
 CHECKED BY: B. CLEVEN
 DRAWN BY: K. SAPIAK
 APPROVED BY: B. CLEVEN
 SCALE: NTS
 ISSUED FOR CONSTRUCTION BY: K. ZUREK
 DATE: 2018/09/28
 DATE: 2018/12/14

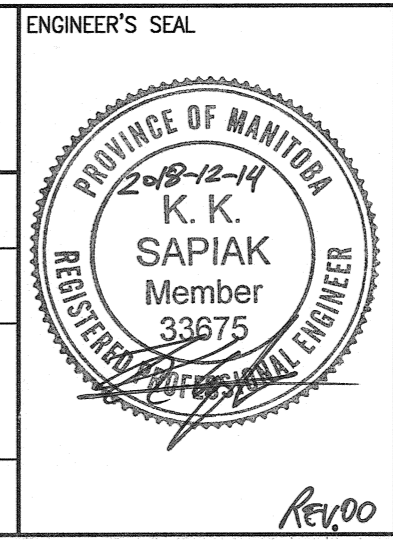

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

ROLAND FLOOD PUMPING STATION
 2019 UPGRADES
 RTU PANEL
 MOTOR ROOM DEMOLITION

CITY DRAWING NUMBER: 1-0179F-A0009
 SHEET: 001
 REV: 00
 SIZE: A1

MOTOR ROOM

CONTINUED AT RIGHT

CONTINUED FROM LEFT