


1 MAIN FLOOR PLAN - TRACK 13-24 - DEMOLITION - ELECTRICAL  
SCALE: 1/8" = 1'-0"

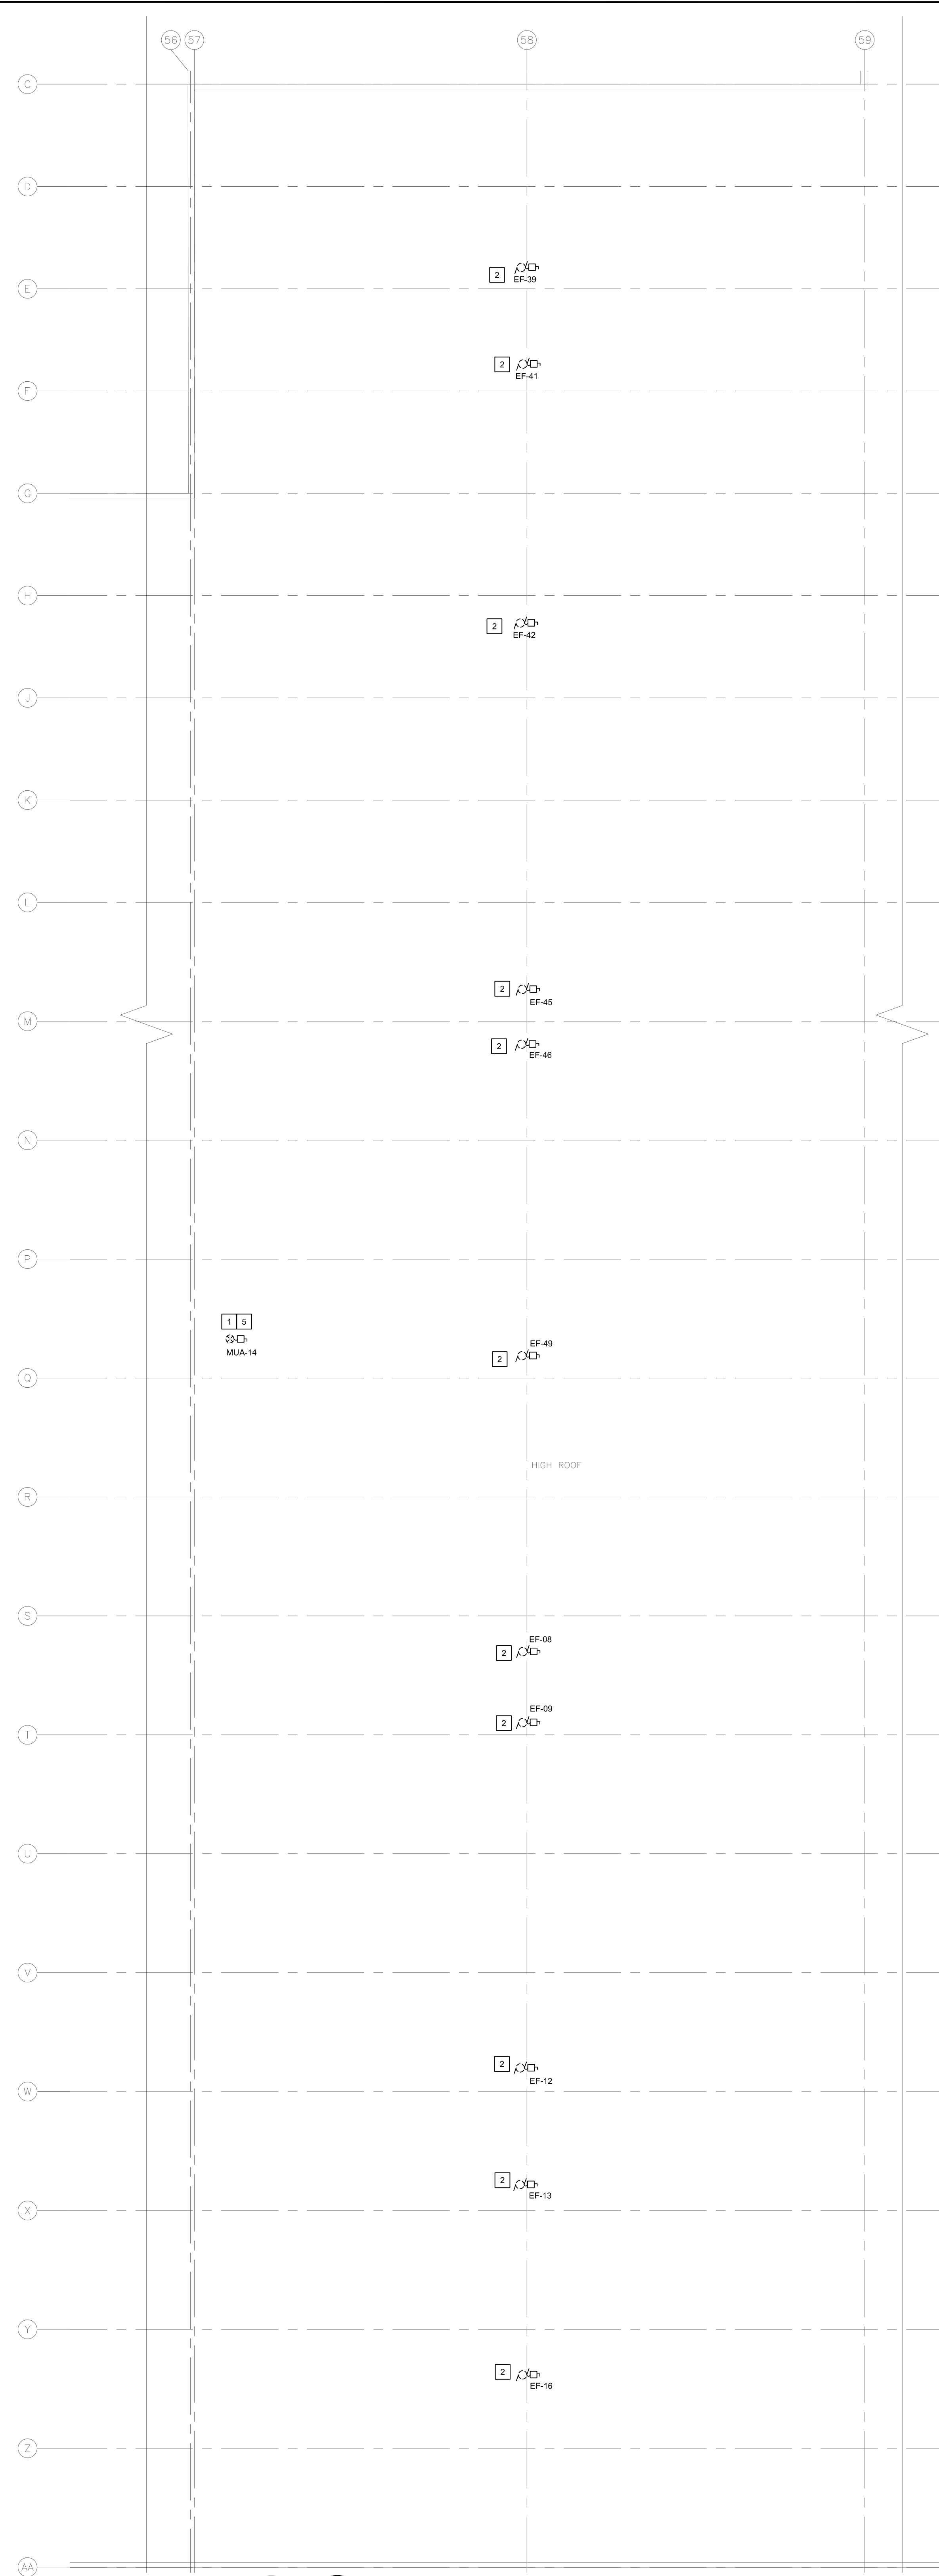


2 ROOF PLAN - TRACK 13-24 - DEMOLITION - ELECTRICAL  
SCALE: 1/8" = 1'-0"

**GENERAL NOTES**

- A. ELECTRICAL SUBCONTRACTOR TO VISIT SITE DURING BID AND VERIFY ALL EXISTING SERVICES ON SITE PRIOR TO SUBMITTING BID. REPORT ANY DISCREPANCIES TO CONTRACT ADMINISTRATOR DURING BID PERIOD.
- B. FOR ALL EXISTING ELECTRICAL DEVICES, EQUIPMENT, ETC. THAT ARE TO BE REMOVED, REMOVE EXISTING CONDUIT, WIRING, CONTROL PANEL, MOTOR STARTER, ETC., BACK TO SOURCE UNLESS OTHERWISE NOTED. TURN BREAKERS OFF, MARK AS SPARE, UPDATE PANEL DIRECTORY AND LABELLING. FOR CONDUITS EMBEDDED IN FLOOR SLAB, REMOVE WIRING, CUT CONDUIT AT FLOOR LEVEL AND SEAL CONDUIT.
- C. EXISTING EQUIPMENT TO BE OFFERED TO THE CITY UPON REMOVAL. DISPOSAL OF EQUIPMENT UPON THE CITY'S REQUEST.
- D. COORDINATE WITH THE CITY PRIOR TO SHUT-DOWN OR REMOVAL OF EQUIPMENT.
- E. EMPLOY ROOFING SUBCONTRACTOR TO PATCH AND REPAIR HOLES IN ROOF WHICH REMAIN AFTER DEMOLITION.
- F. ALL ABANDONED EQUIPMENT AND SERVICES WITHIN AREA OF WORK SHALL BE REMOVED.
- G. THIS BUILDING MAY CONTAIN ASBESTOS. REFER TO FRONT END SPECIFICATIONS FOR FURTHER INFORMATION.
- H. FIRE STOP ALL PENETRATIONS LEFT BY DEMOLITION OF CABLE/CONDUITS.
- I. ELECTRICAL SUBCONTRACTOR TO VERIFY ALL EXISTING CIRCUITING ON SITE PRIOR TO DISCONNECTION OF LOADS.

**DEMOLITION KEY NOTES**

1. EXISTING MAKEUP AIR UNIT AND CONTROLLER TO BE REMOVED BY MECHANICAL. REMOVE ALL ASSOCIATED WIRING/CONDUIT BACK TO SOURCE.
2. EXISTING ROOF TOP FAN TO BE REMOVED BY MECHANICAL. REMOVE WIRING/CONDUIT BACK TO SOURCE (MCC/AMA), TURN OFF AND MARK MCC/WRAPPER AS SPARE.
3. FED FROM CDP PP-NH.
4. FED FROM CDP PP-DD (REFER TO DRAWING E1.2 FOR LOCATION).
5. FED FROM CDP PP-KX (REFER TO DRAWING E1.2 FOR LOCATION).
6. FED FROM CDP PP-GD.
7. EXISTING INFRARED HEATER TO REMAIN. RETAIN SECTION OF WIRING IN EXISTING CIRCUIT. EXTEND WIRING/CONDUIT AS REQUIRED.
8. DISCONNECT EXISTING INFRARED HEATER TO BE DEMOLISHED BY MECHANICAL. REMOVE CONDUIT, WIRING, ETC. BACK TO SOURCE. RETAIN SECTION OF WIRING/CONDUIT FEEDING IH-12 (TO REMAIN); REFER TO KEY NOTE 7.
9. DISCONNECT EXISTING INFRARED HEATER TO BE DEMOLISHED BY MECHANICAL. REMOVE CONDUIT, WIRING, ETC. BACK TO SOURCE. PRIOR TO REMOVAL, INSPECT AND PERFORM INSULATION RESISTANCE (DEGREES TEST) ON EXISTING WIRING. IF WIRING PASSES TESTING AND INSPECTION, PROVIDE CASH CREDIT FOR WIRE REMOVAL AND NEW WIRING (REFER TO E1.1, KEY NOTE 7). CREDIT TO BE ACCEPTED AT THE DISCRETION OF THE CITY.
10. DISCONNECT AND REMOVE BREAKER IN EXISTING PANEL LP-GF FOR CIRCUIT 25 SERVING INFRARED HEATERS IH-09, TO IH-11.

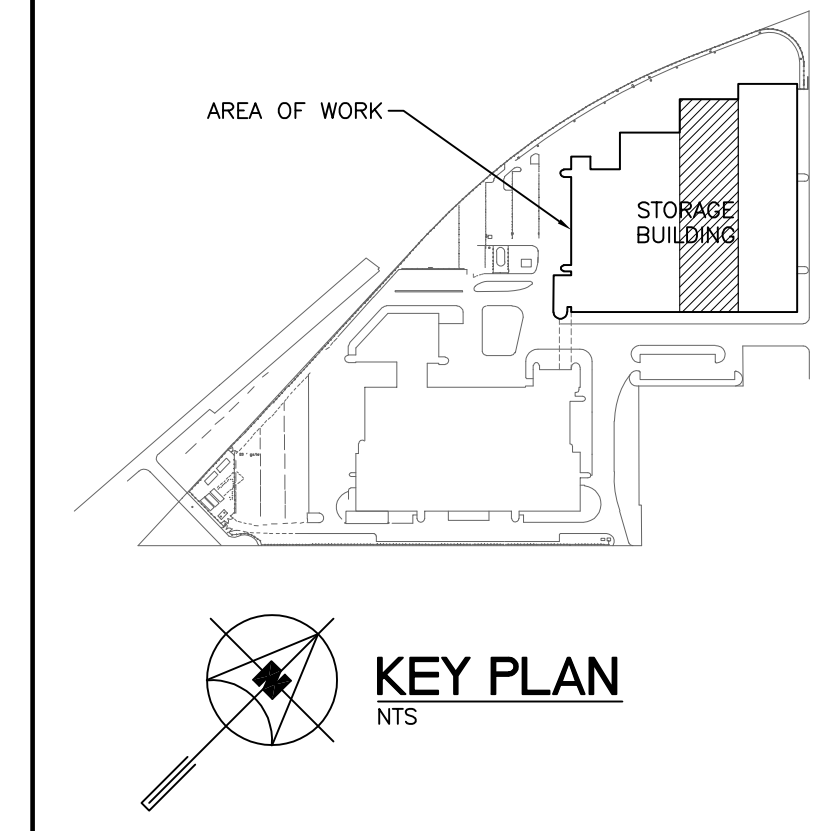

KEY PLAN  
N15

0	ISSUED FOR CONSTRUCTION	VEK	09/11/18
NO.	Description	BY	EDM/MYY

**ENGINEERS**  
**GEOSCIENTISTS**  
**MANITOBA**  
 Certificate of Authorization  
**SMS Engineering Ltd.**  
 No. 166



770 Bradford Street  
 Winnipeg, Canada 3  
 T 204 775 0291  
 SMSeng.com

Project Title  
**CITY OF WINNIPEG FORT ROUGE TRANSIT BASE - STORAGE TRACK 13-24 - MECHANICAL UPGRADE**  
 Drawing Title  
**WINNIPEG MANITOBA**  
**MAIN FLOOR AND ROOF PLAN - TRACK 13-24 - DEMOLITION - ELECTRICAL**

Drawn By	RD	Checked By	VEK	Approved By	VEK
Scale	AS NOTED	Date	NOVEMBER 2018	Project No.	18-245-011
Revision Number	0	Drawing Number	E1.1	Sheet Order	1 OF 5