

LEGEND:

- EXISTING
- - - DEMOLITION

DEMOLITION NOTES:

- (A) DEMOLISH INCOMING UTILITY POWER SERVICE POWER TO EXISTING SWITCHGEAR SGR-M1. DEMOLISH AND REMOVE EXISTING SGR-M1. REFER TO DRAWING 1-0660M-E0006 FOR MORE DETAILS.
- (B) DEMOLISH EXISTING ELECTRIC UNIT HEATER CONTROL PANEL, DISCONNECT SWITCH AND CABLING. REFER TO DRAWING 1-0660M-E0006 FOR MORE DETAILS.
- (C) DEMOLISH EXISTING ELECTRIC UNIT HEATERS AND ASSOCIATED TEMPERATURE SWITCHES.
- (D) DEMOLISH EXISTING LOW/HIGH TEMPERATURE THERMOSTAT (TSL AND TSH) AND ASSOCIATED WIRING.
- (E) DEMOLISH EXISTING FIRE ALARM SYSTEM, DEMOLISH EXISTING FIRE ALARM PANEL FACP-M922, PULL STATION, FIRE ALARM HORN, SMOKE AND HEAT DETECTORS AND ASSOCIATED WIRING.
- (F) DEMOLISH EXISTING LIGHT FIXTURES IN MAIN ENTRANCE, CONTROL ROOM, LOCKER ROOM, TOOL ROOM AND EXTERIOR LIGHTING. REMOVE ALL MAIN FLOOR HIGH BAY LIGHTING. DISCONNECT WIRING AND ASSOCIATED LIGHT SWITCHES.
- (G) DEMOLISH EXISTING DIST. PNL AND PANEL PNL-M12.
- (H) DEMOLISH EXISTING EMERGENCY LIGHT AND CABLING.
- (I) DEMOLISH FUSED DISCONNECT SWITCH (FDS-XFMR-M10) AND CABLING.
- (J) DEMOLISH EXISTING RECEPTACLES. PROVIDE COVER PLATE TO COVER EXISTING EMBEDDED RECEPTACLE DEVICE BOXES.
- (K) DEMOLISH ALL EXISTING CEILING MAIN FLOOR LIGHTS. DEMOLISH ALL EXISTING CABLING AND CONDUIT BACK TO SOURCE PANEL PNL-M12. DEMOLISH EXISTING LIGHT SWITCHES. EXISTING CEILING LIGHTS ARE FED FROM CIRCUITS 2 AND 4. LOCATION OF LIGHTS ARE APPROXIMATE AS THEY ARE BASED ON EXISTING DRAWINGS.

SPECIFIC NOTES:


- (I) RELOCATE WELDING RECEPTACLE AND ASSOCIATED FUSED DISCONNECT SWITCH. NEW LOCATION SHOWN ON DRAWING 1-0660M-E0013

MAIN FLOOR PLAN

SCALE: 1 : 40

NOTES:

1. CONTRACTOR TO CONSULT WITH CITY IF ANY DEMOLISHED EQUIPMENT SHOULD BE TURNED TO THE CITY, OTHERWISE DISPOSE OF ALL DEMOLISHED EQUIPMENT.
2. REFER TO DRAWING 1-0660M-E0006 FOR MORE DEMOLITION DETAILS.
3. ALL DEVICES SHOWN ARE EXISTING TO REMAIN UNLESS OTHERWISE NOTED IN DEMOLITION NOTES.
4. CONDUITS ASSOCIATED WITH DEMOLISHED EQUIPMENTS TO BE REMOVED.
5. CONTRACTOR TO ENSURE ALL EXISTING RECEPTACLE TO BE REMOVED.
6. REMOVE ALL CONDUIT SYSTEMS ASSOCIATED WITH DEVICES TO BE DEMOLISHED.

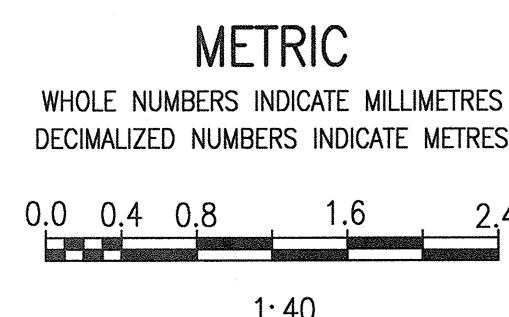


NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER AND CONSTRUCTION	2019/10/18	SB	BC

SNC-LAVALIN

148 Nature Park Way
Winnipeg, MB, Canada R3P 0X7
204-786-8080

DESIGNED BY: S. BOGHOSIAN
DRAWN BY: J. GRAGASIN
SCALE: 1:40
DATE: 2019/02/19
CONSULTANT NO.:

CHECKED BY: B. CLEVEN
APPROVED BY: D. BECKER
ISSUED FOR CONSTRUCTION BY: A. WEISS
DATE: 2019/10/18

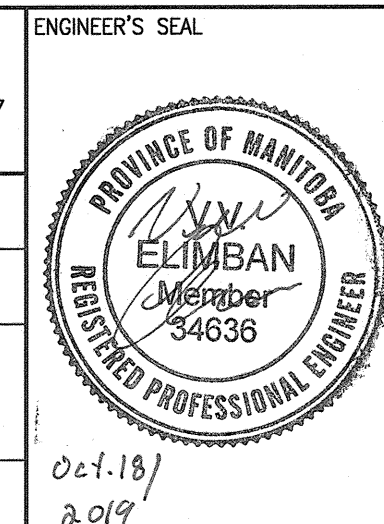

THE CITY OF WINNIPEG
Winnipeg WATER AND WASTE DEPARTMENT

TACHE BOOSTER PUMPING STATION

MAIN FLOOR EQUIPMENT & DEVICE LAYOUT
PUMP ROOM
DEMOLITION

CITY DRAWING NUMBER: 1-0660M-E0011
SHEET: 001
REV: 00
SIZE: A1