



Certificate of Authorization

Epp Siepman Engineering Inc.

No. 4035

This is a print of a document that has been electronically authenticated with technology authorized by the APEGM. The original is in electronic form.









This drawing must not be scaled. The contractor shall verify all dimensions and other data on site prior to commencement of work. Discrepancies, errors, and omissions are to be reported to Public City Architecture Inc. prior to proceeding with the Work.

Drawings and specifications as instruments of service are the property of Public City Architecture Inc. The copyright in the same being reserved. No reproduction or revision to these drawings may be made without the permission of Public City Architecture Inc. and when made, must bear their name. All prints to be returned to Public City Architecture Inc. upon request.

Project  
**ST. JAMES CIVIC CENTRE**

Drawing  
**ELECTRICAL SINGLE LINE DIAGRAM - RENO 2 OF 2**

Drawn By: JA Review By: MP  
Scale: NTS Tender No: 1176-2019  
Date: 11/06/19  
Sheet: **E5.3**

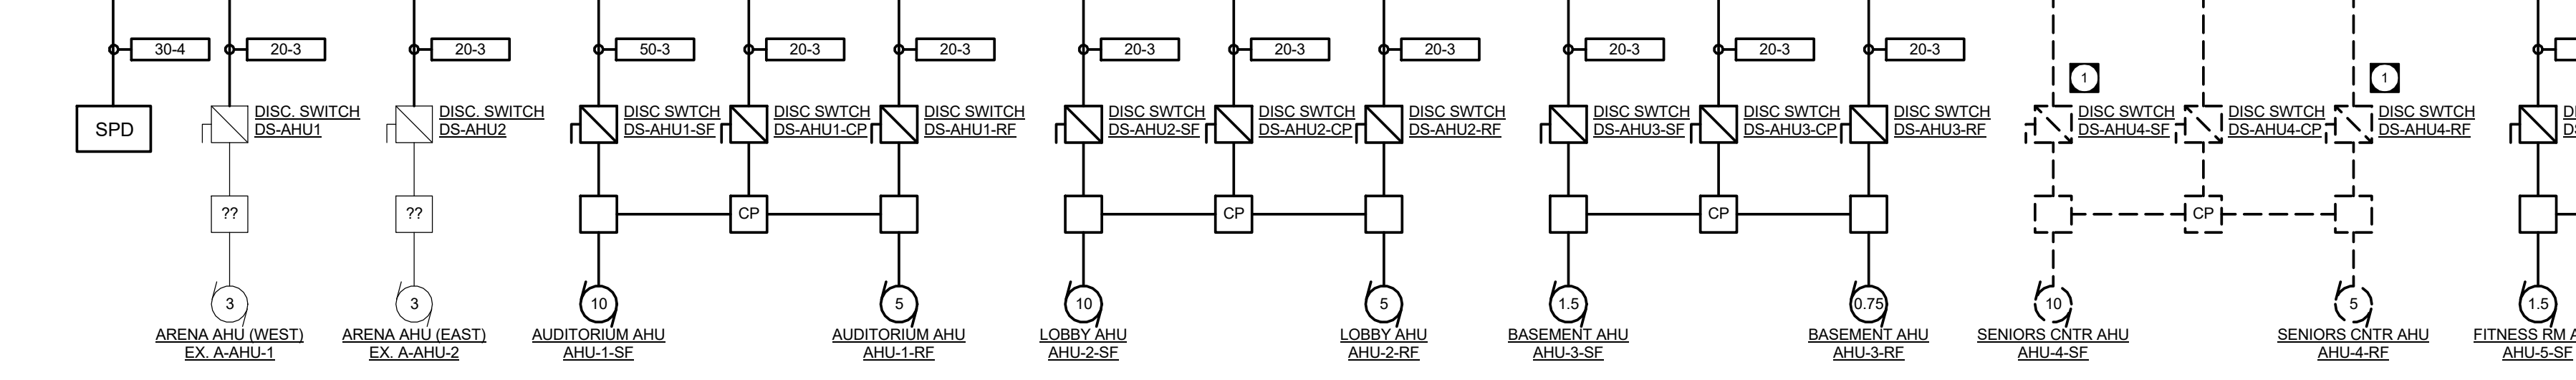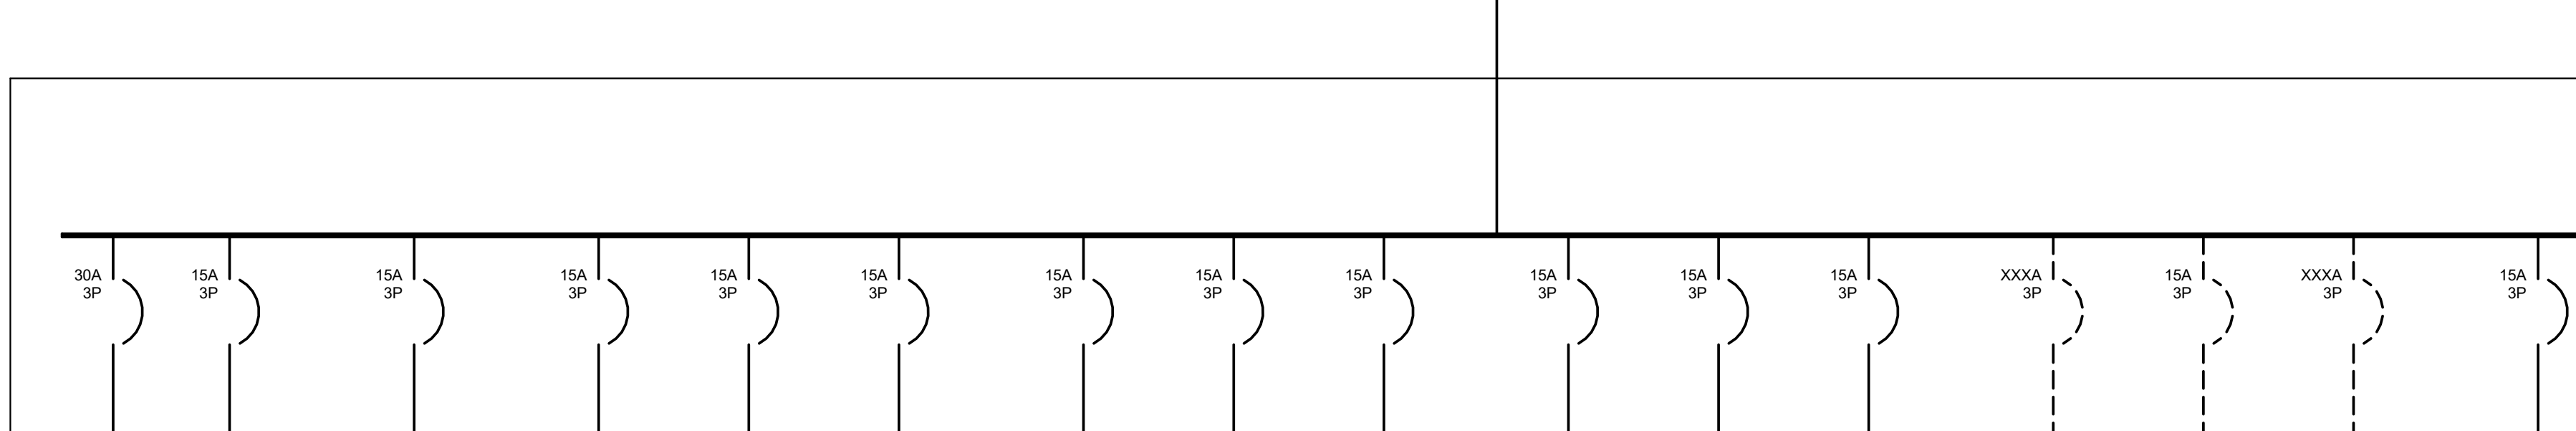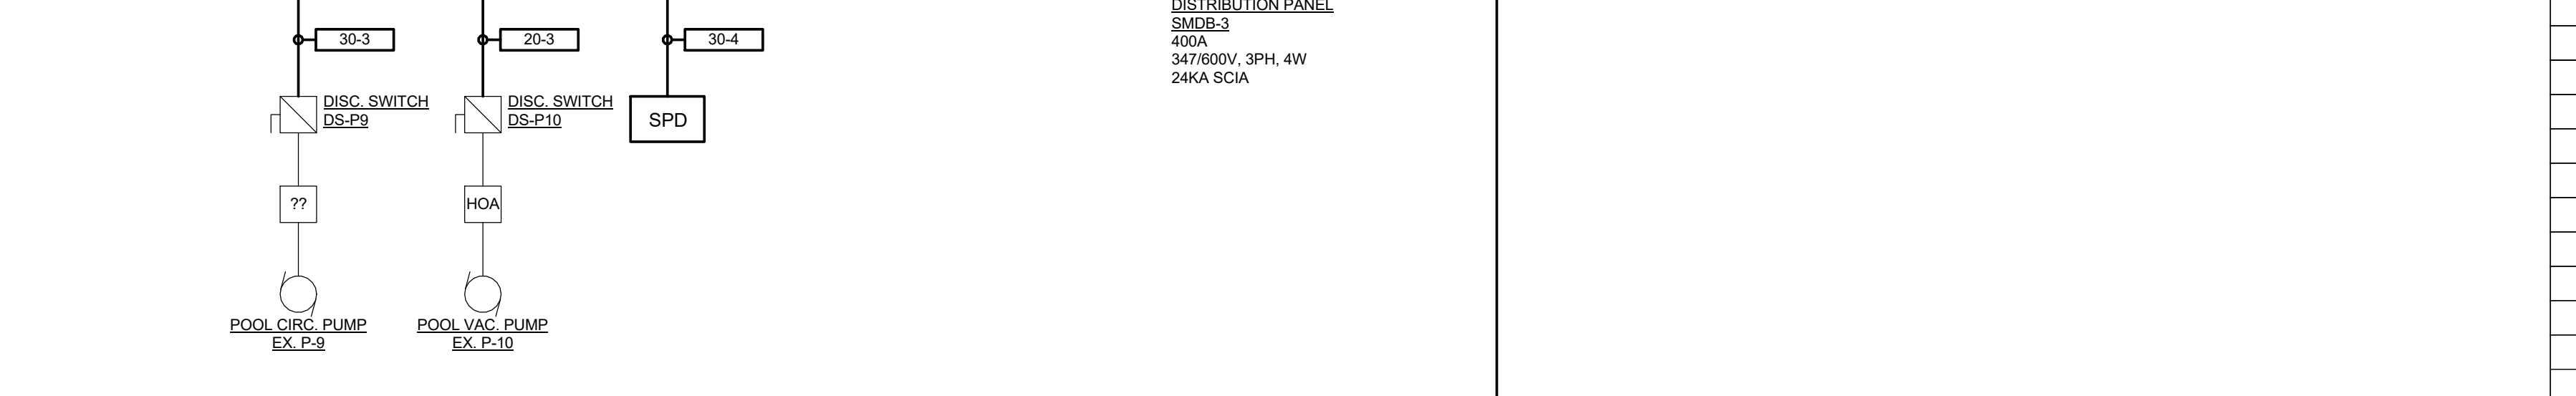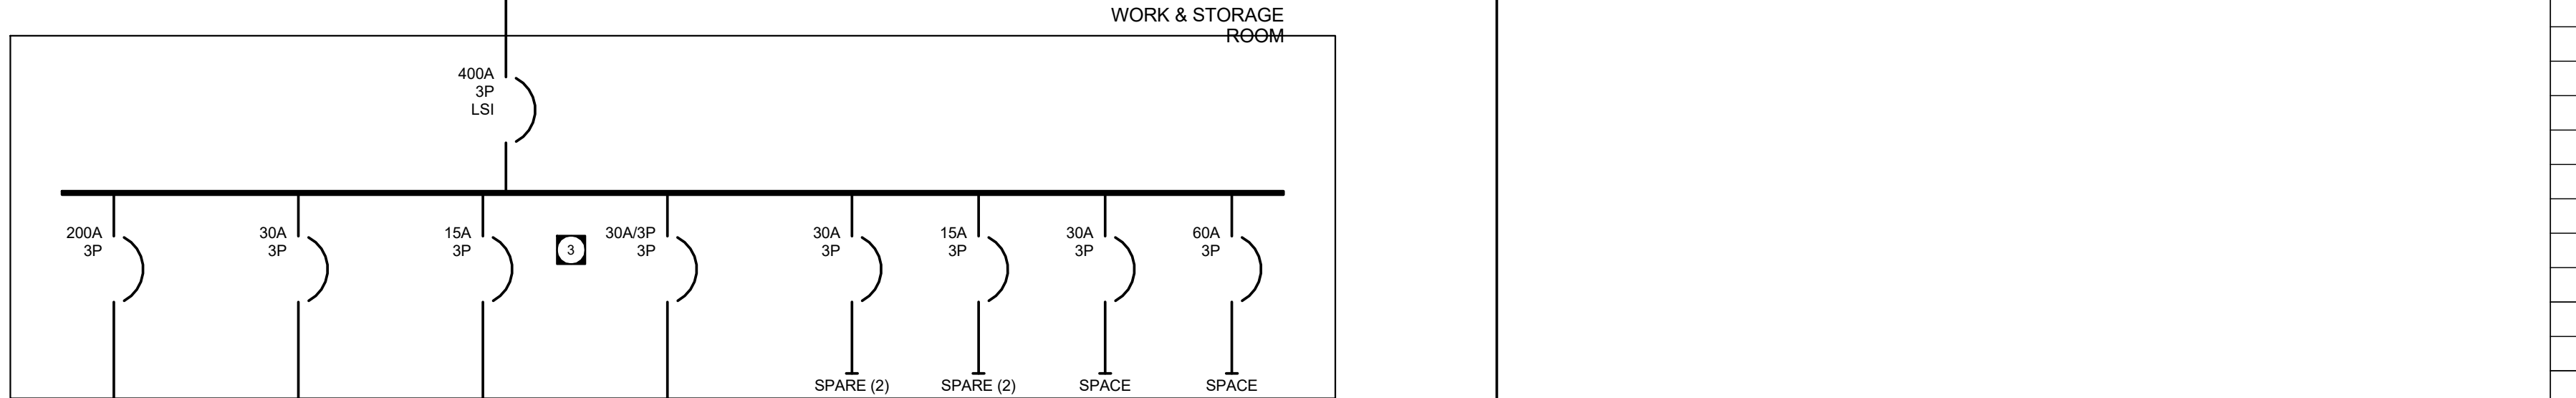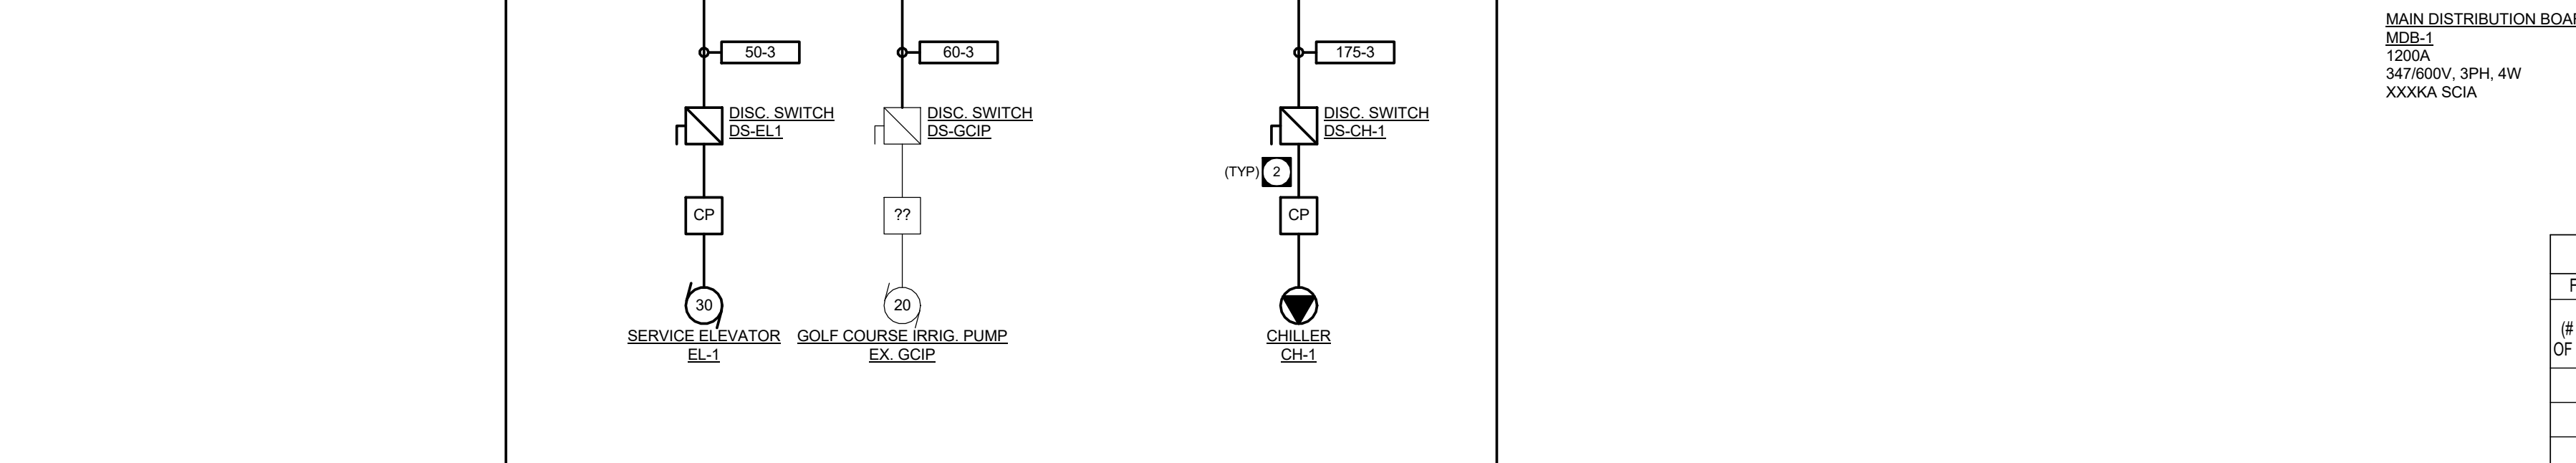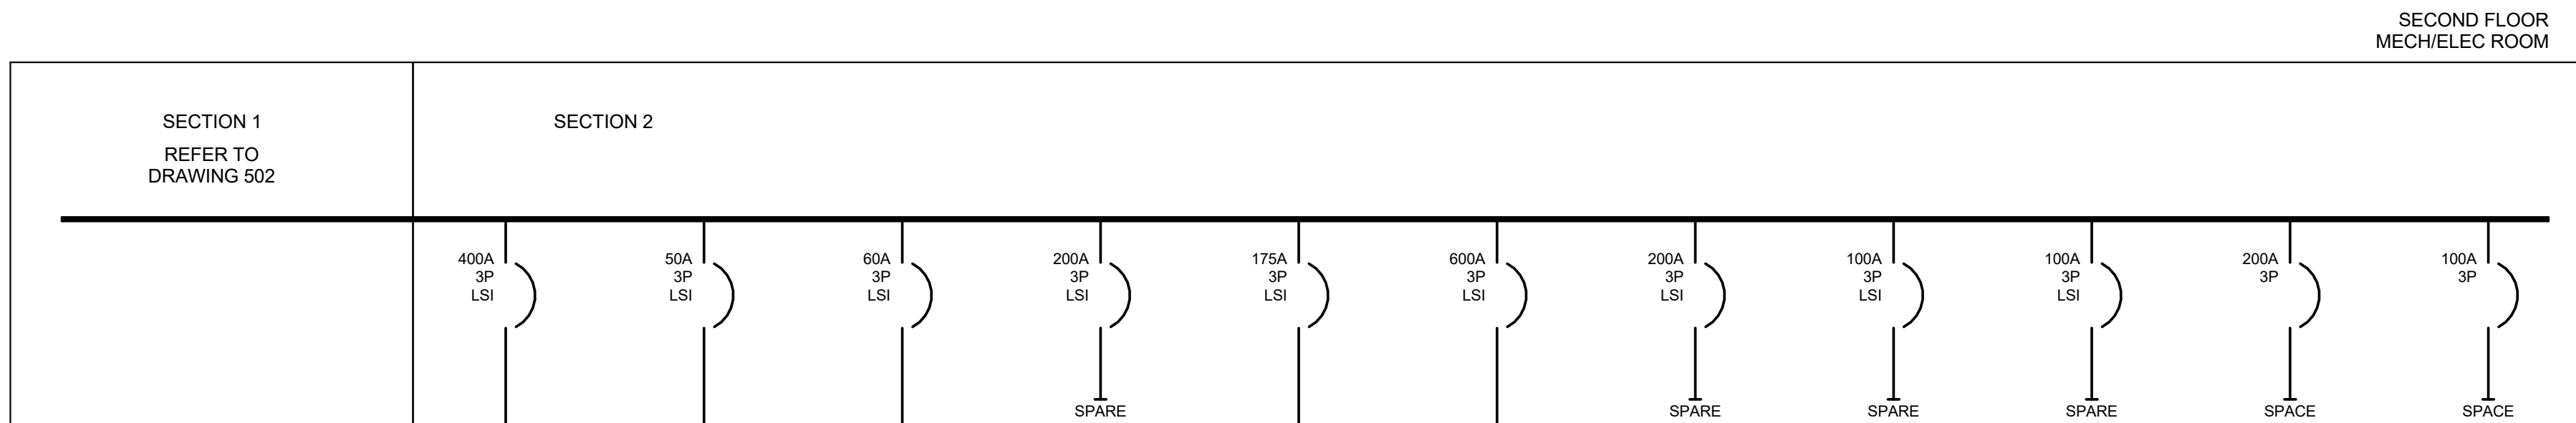

### KEY NOTES

1. FUTURE LOAD
2. REFER TO MECHANICAL EQUIPMENT SCHEDULE FOR EQUIPMENT WIRING TYPES AND REQUIREMENTS.
3. COORDINATE BREAKER SIZE WITH SURGE PROTECTION DEVICE.


### CONDUIT AND WIRE SCHEDULE - COPPER

FEEDER NAME (# DENOTES NO. OF CONDUCTORS)	WIRE SIZE PHASE & NEUTRAL	BOND (AS REQ'D)	MIN. CONDUIT SIZE (MM)			MAX LENGTH (M) @80%		CIRCUIT AMPACITY (A)
			2C	3C	4C	208V	600V	
20-#	#12	#14	21	21	21	19	55	20
30-#	#10	#12	21	21	21	21	61	30
50-#	#8	#10	21	21	21	19	55	50
60-#	#6	#8	21	27	27	24	70	65
70-#	#4	#8	27	27	35	31	91	85
80-#	#4	#8	27	27	35	27	80	85
90-#	#3	#6	27	35	35	29	86	100
100-#	#3	#6	27	35	35	26	77	100
115-#	#2	#6	27	35	35	28	81	115
125-#	#1	#6	35	35	41	31	90	130
150-#	1/0	#6	41	41	53	32	94	150
175-#	2/0	#6	41	41	53	32	93	175
200-#	3/0	#4	53	53	53	33	97	200
225-#	4/0	#4	53	53	63	34	100	230
250-#	250 MCM	#4	53	53	63	34	98	255
300-#	350 MCM	#3	63	63	78	34	99	310
400-#	600 MCM	#3	78	78	91	34	99	420
450-#	(2) 4/0	(2) #4	(2) 53	(2) 53	(2) 63	34	100	460
500-#	(2) 250 MCM	(2) #4	(2) 53	(2) 53	(2) 63	34	98	510
600-#	(2) 350 MCM	(2) #3	(2) 63	(2) 63	(2) 78	34	99	620
700-#	(2) 500 MCM	(2) #3	(2) 63	(2) 78	(2) 91	34	100	760
800-#	(2) 600 MCM	(2) #2	(2) 78	(2) 78	(2) 91	32	94	840
1000-#	(3) 500 MCM	(3) #3	(3) 63	(3) 78	(3) 91	36	105	1140
1200-#	(3) 600 MCM	(3) #2	(3) 78	(3) 78	(3) 91	32	94	1280
1600-#	(4) 600 MCM	(4) #2	(4) 78	(4) 78	(4) 91	32	94	1680
2000-#	(5) 600 MCM	(5) #2	(5) 78	(5) 78	(5) 91	32	94	2100
2500-#	(6) 600 MCM	(6) #2	(6) 78	(6) 78	(6) 91	31	94	2520

### CONDUIT AND WIRE SCHEDULE - ALUMINUM

FEEDER NAME (# DENOTES NO. OF CONDUCTORS)	WIRE SIZE PHASE & NEUTRAL	BOND (AS REQ'D)	MIN. CONDUIT SIZE (MM)			MAX LENGTH (M) @80%		CIRCUIT AMPACITY (A)
			2C	3C	4C	208V	600V	
60-#A	#4	#8	27	35	35	23	68	65
70-#A	#3	#6	27	35	35	25	73	75
90-#A	#2	#6	27	35	35	24	70	90
100-#A	#1	#6	35	41	41	27	78	100
125-#A	2/0	#6	41	53	53	31	90	135
150-#A	3/0	#4	41	53	53	31	90	155
175-#A	4/0	#4	53	53	63	32	94	180
200-#A	250 MCM	#4	53	63	78	31	91	205
250-#A	350 MCM	#3	63	78	78	31	91	250
300-#A	500 MCM	#3	78	78	91	32	94	310
400-#A	(2) 250 MCM	(2) #4	(2) 53	(2) 53	(2) 63	31	91	410
450-#A	(2) 300 MCM	(2) #4	(2) 53	(2) 63	(2) 78	32	92	460
500-#A	(2) 350 MCM	(2) #3	(2) 63	(2) 78	(2) 78	31	91	500
600-#A	(2) 500 MCM	(2) #3	(2) 78	(2) 78	(2) 91	32	94	620
700-#A	(2) 600 MCM	(2) #2	(2) 78	(2) 91	(2) 103	30	88	680
800-#A	(3) 500 MCM	(3) #3	(2) 78	(2) 78	(3) 91	36	106	930
1000-#A	(3) 600 MCM	(3) #2	(3) 78	(3) 91	(3) 103	32	93	1020
1200-#A	(4) 600 MCM	(4) #2	(4) 78	(4) 91	(4) 103	35	103	1360
1600-#A	(5) 600 MCM	(5) #2	(5) 78	(5) 91	(5) 103	33	96	1700
2000-#A	(6) 600 MCM	(6) #2	(6) 78	(6) 91	(6) 103	32	93	2040

EQ EQUIPMENT FEEDER - REFER TO ELECTRICAL EQUIPMENT SCHEDULE

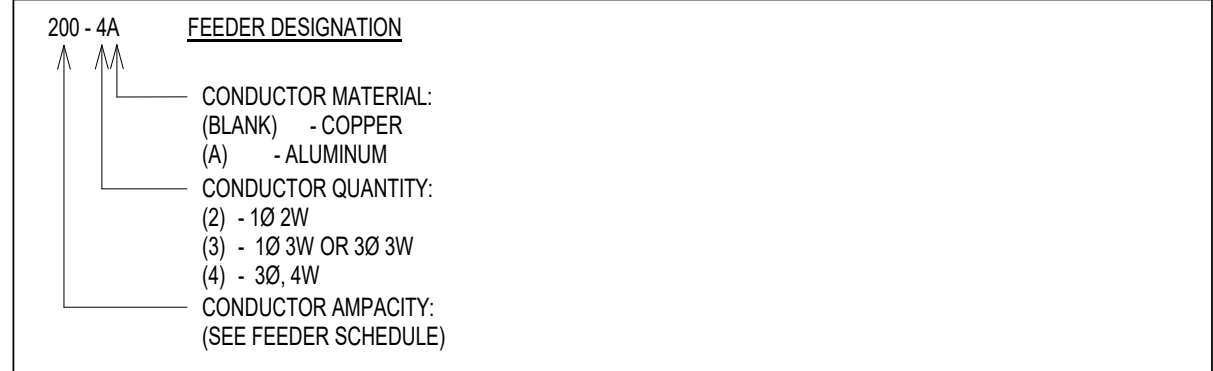

### GENERAL NOTES:

- A. THE ABOVE FEEDER SCHEDULE IS A SCHEDULE OF TYPICAL FEEDERS AND SOME SIZES MAY NOT BE UTILIZED.
- B. ALL CONDUCTOR AMPACITIES ARE BASED ON TABLE 4 OF THE CEC FOR ALUMINUM CONDUCTOR TYPE RW90.
- C. FEEDER SIZES SHOWN ON THE RISER DIAGRAM INDICATE FEEDER AMPACITIES AND DO NOT NECESSARILY CORRESPOND TO CIRCUIT BREAKER AMPACITIES. CERTAIN FEEDERS MAY BE SIZED FOR THE DERATION FACTORS REQUIRED BY CODE AND/OR ARE OVERSIZED FOR VOLTAGE DROP.
- D. WHERE MULTIPLE CONDUITS AND CONDUCTORS ARE INDICATED FOR A SINGLE FEEDER, EACH CONDUIT SHALL CONTAIN 1 PARALLEL PHASE, NEUTRAL, AND GROUND CONDUCTORS INDICATED.
- E. CONDUIT ABOVE GRADE INDOORS SHALL BE EMT. CONDUIT ABOVE GRADE OUTDOORS SHALL BE GALVANIZED IMC OR RMC. CONDUIT BELOW GRADE SHALL BE PVC WITH GALVANIZED RMC ELBOWS. CONDUIT SIZE INDICATED IS MINIMUM SIZE REGARDLESS OF CONDUIT TYPE.