



- CONSTRUCTION NOTES:**
- ① INSTALL NEW GAS DETECTION CONTROLLER.
 - ② INSTALL WIREWAY BELOW GAS DETECTION CONTROLLER WITH APPROPRIATE CONDUIT STUBS INTO GAS DETECTION CONTROLLER. MINIMUM DIMENSIONS 300 x 150.
 - ③ INSTALL NEW 20A CIRCUIT BREAKER IN 1UPS PANEL TO FEED NEW GAS DETECTION CONTROLS.
 - ④ MODIFY EXISTING GAS DETECTION PANEL.

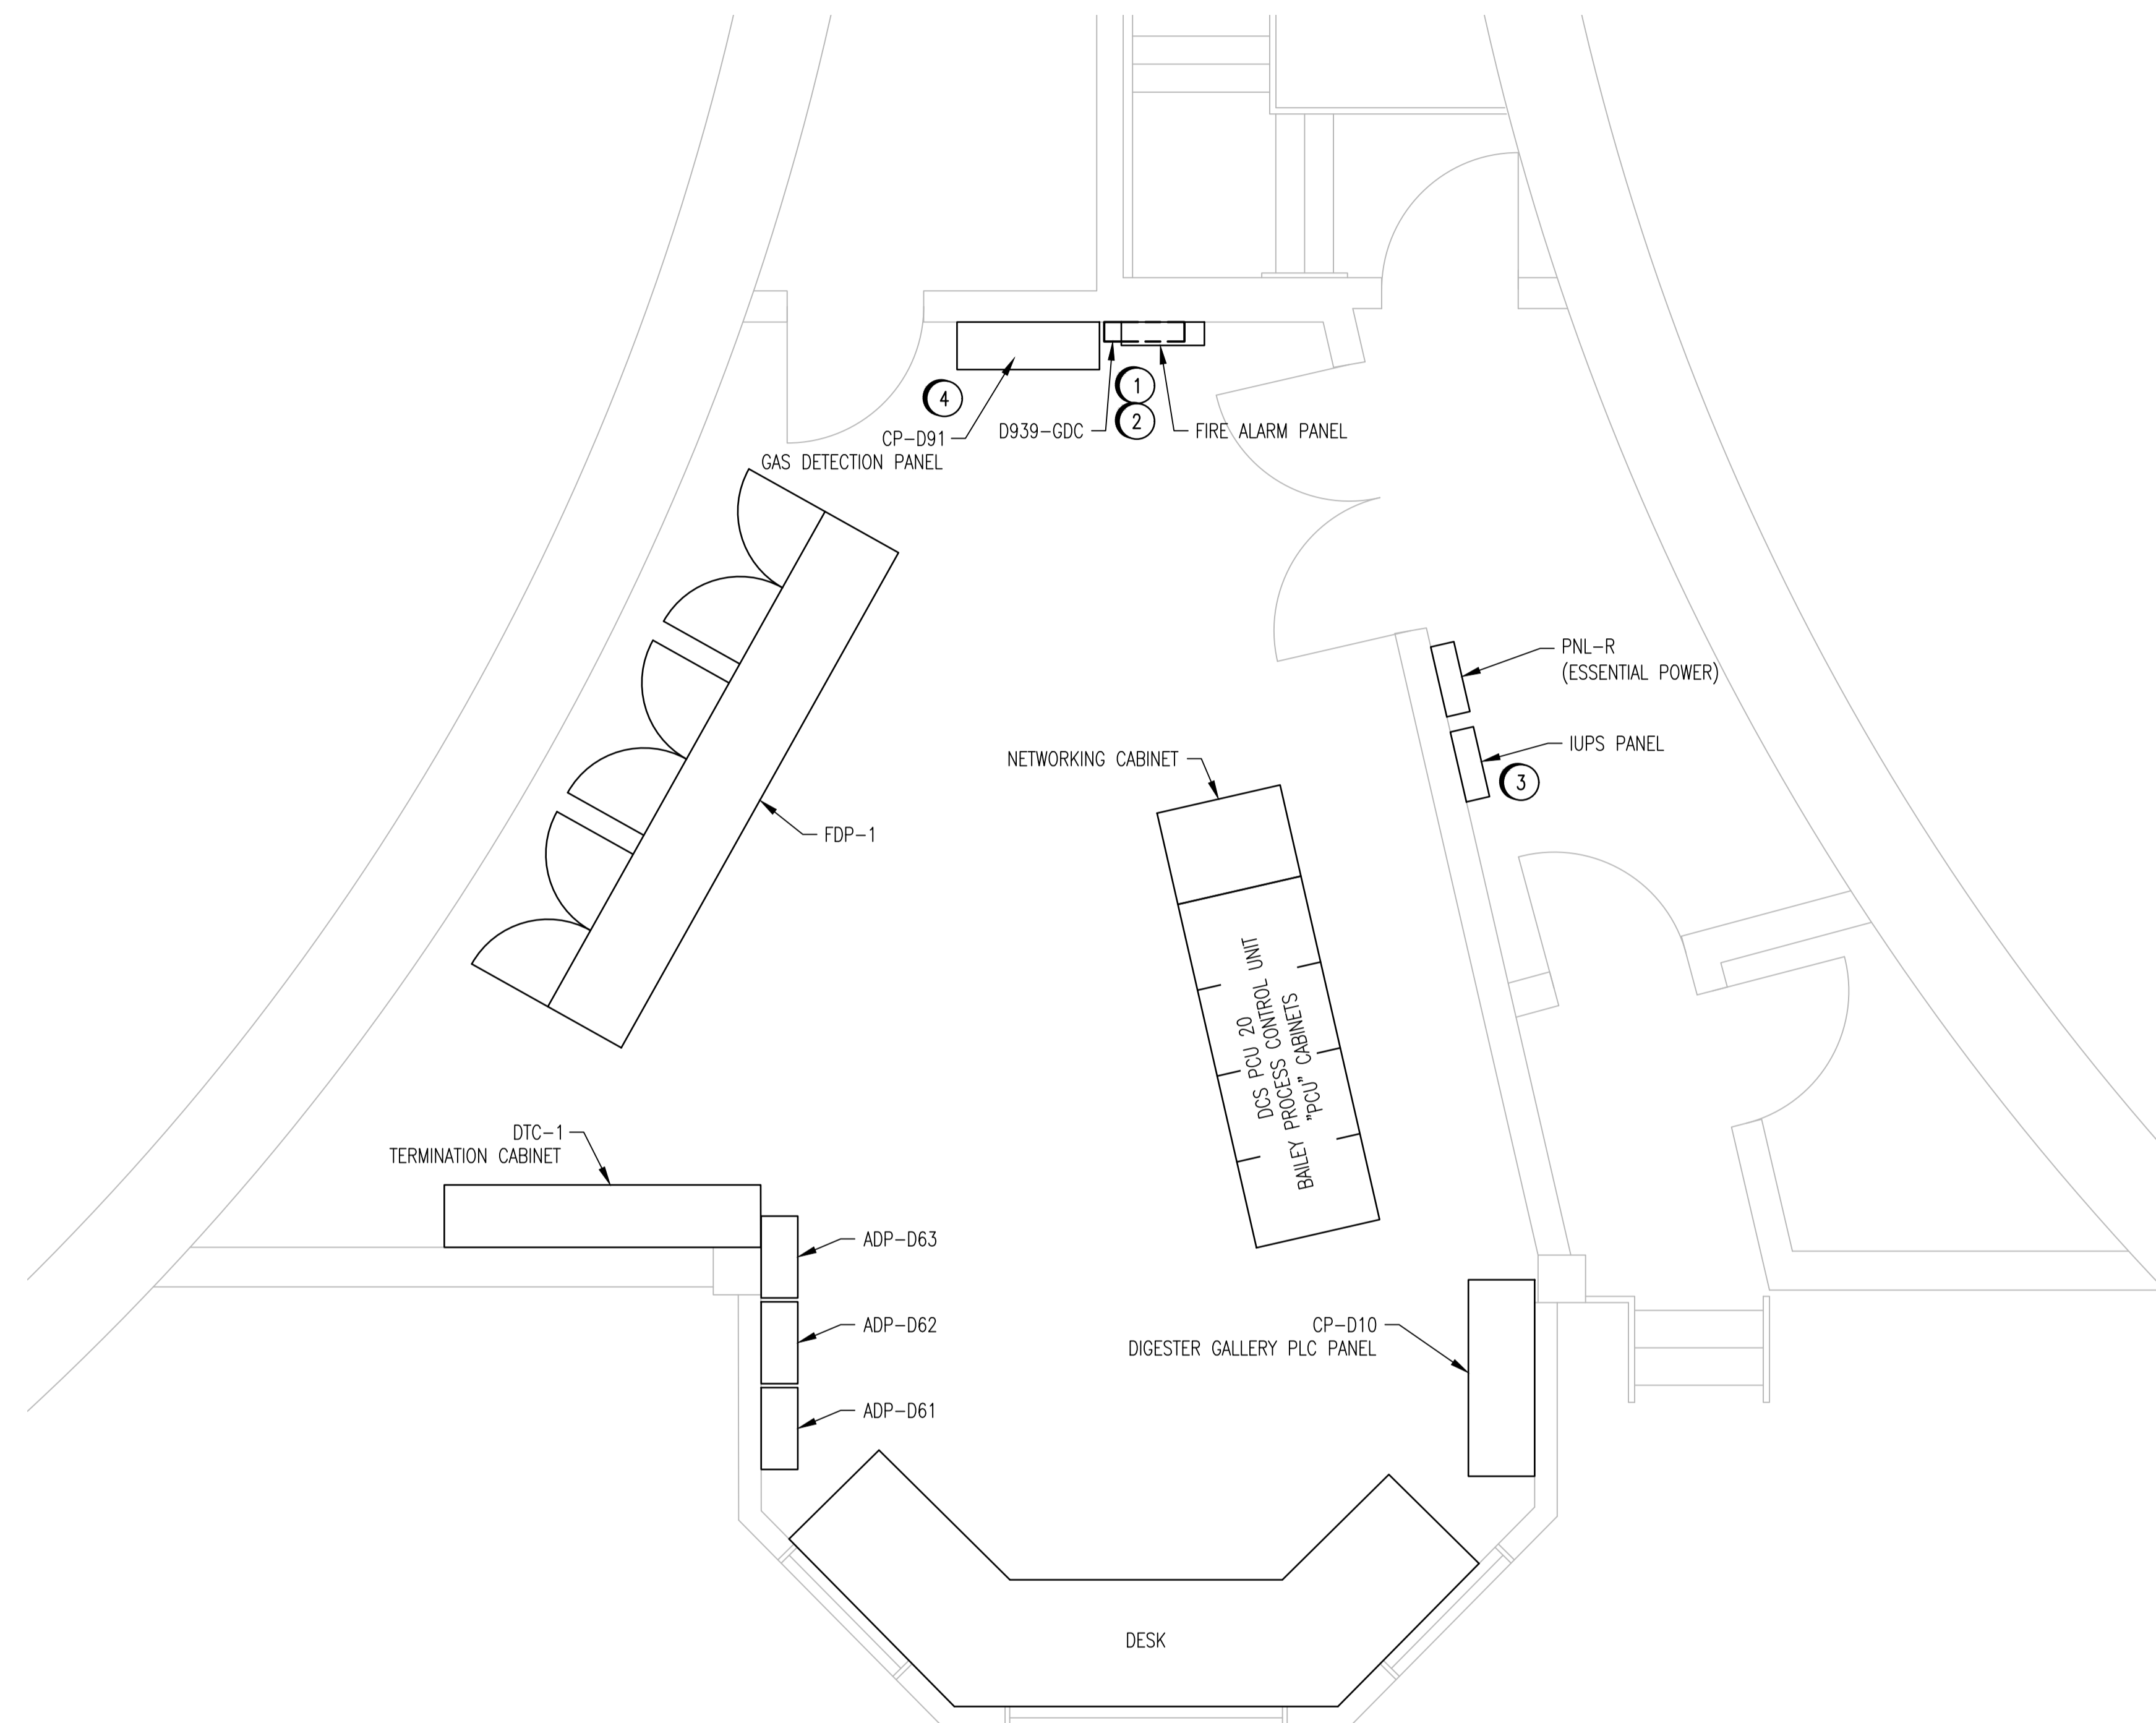

CONTROL ROOM
1:30

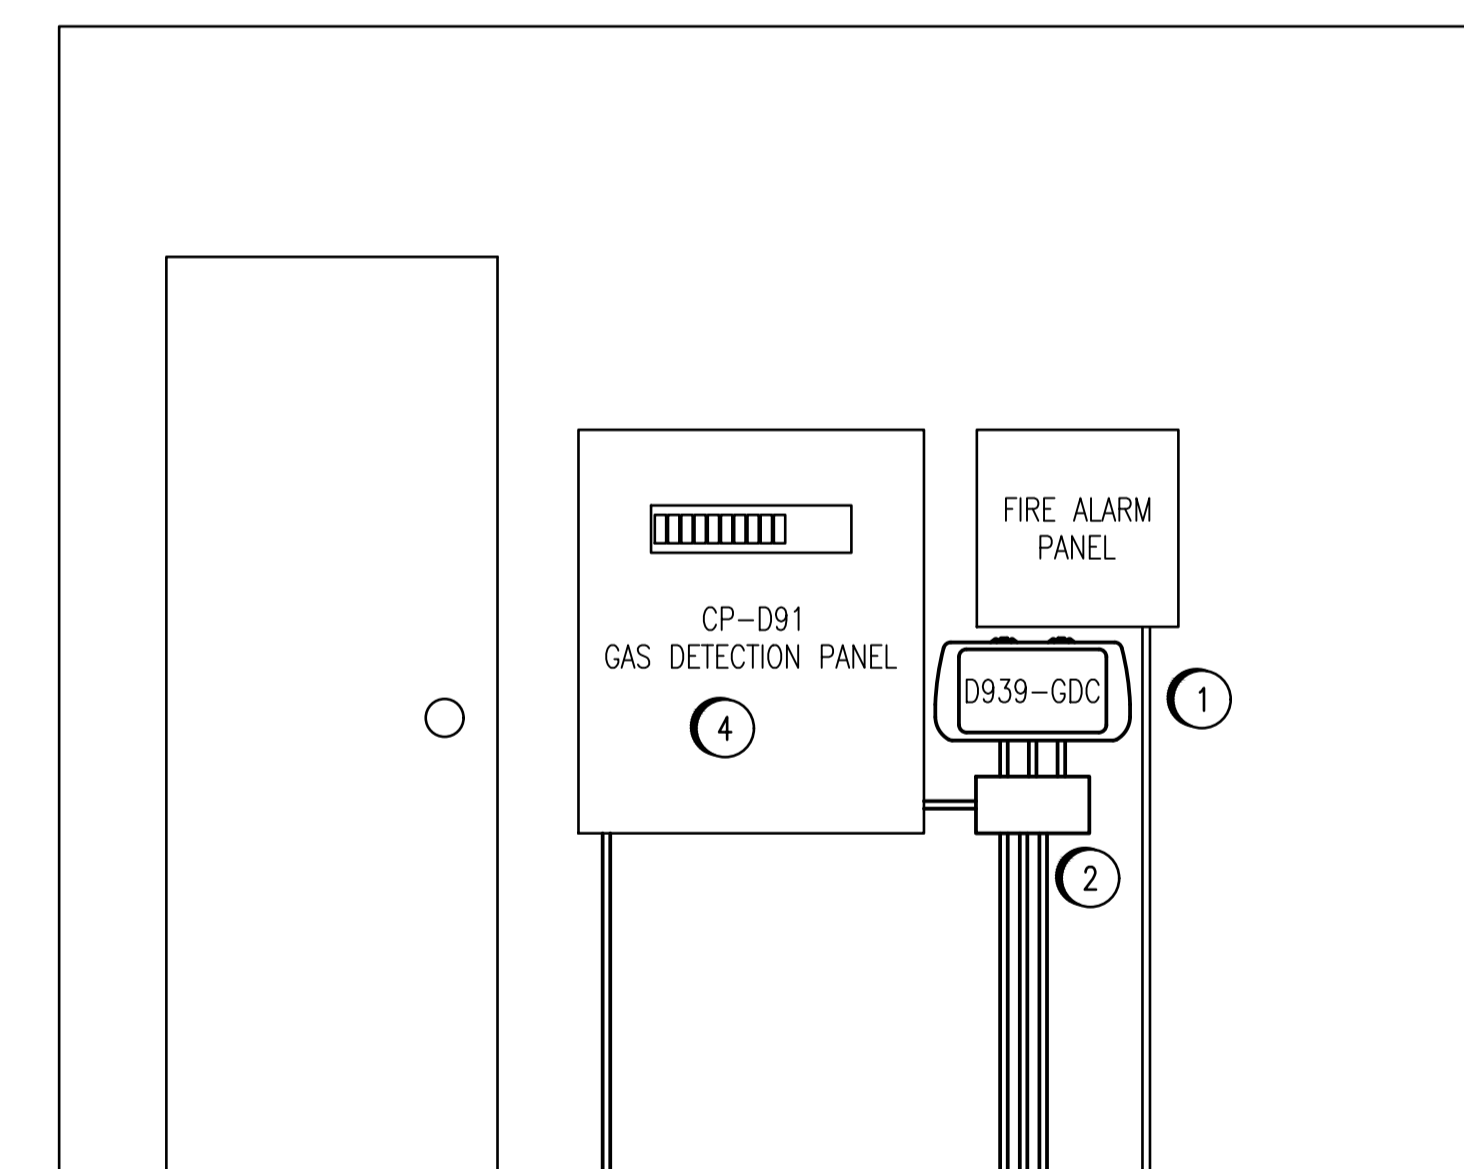

NORTH WALL ELEVATION
1:20

METRIC
WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

**ENGINEERS
GEOSCIENTISTS
MANITOBA**
Certificate of Authorization
CENGYS Ltd.
No. 6983

| | | | |
|--|-------------------------|------------|-----|
| LOCATION APPROVED UNDERGROUND STRUCTURES | | | |
| SUPV. U/G STRUCTURES COMMITTEE | DATE | | |
| NOTE: LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION. | | | |
| NO. | REVISIONS | DATE | BY |
| 00 | ISSUED FOR CONSTRUCTION | 2019-08-01 | SLF |

| | | | |
|------------|--|--|--|
| B.M. ELEV. | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |

| | |
|---------------------------------|---|
| | |
| DESIGNED BY C. REIMER | CHECKED BY C. REIMER |
| DRAWN BY S. FUNK | APPROVED BY C. REIMER |
| HOR. SCALE: AS SHOWN | RELEASED FOR CONSTRUCTION: K. SCHIMKE |
| DATE: 2019-05-30 | DATE: 2019-08-01 |

ENGINEER'S SEAL

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT
DIGESTERS
CONTROL ROOM LAYOUT
DIGESTER CONTROL ROOM

| | | |
|---------------------------------|--|----------------------|
| BID OPPORTUNITY NO. 630-2019 | CITY DRAWING NUMBER 1-1010D-A0115-001 | SHEET OF 24 OF 44 |
|---------------------------------|--|----------------------|