


B SIZE - 279mm x 432mm

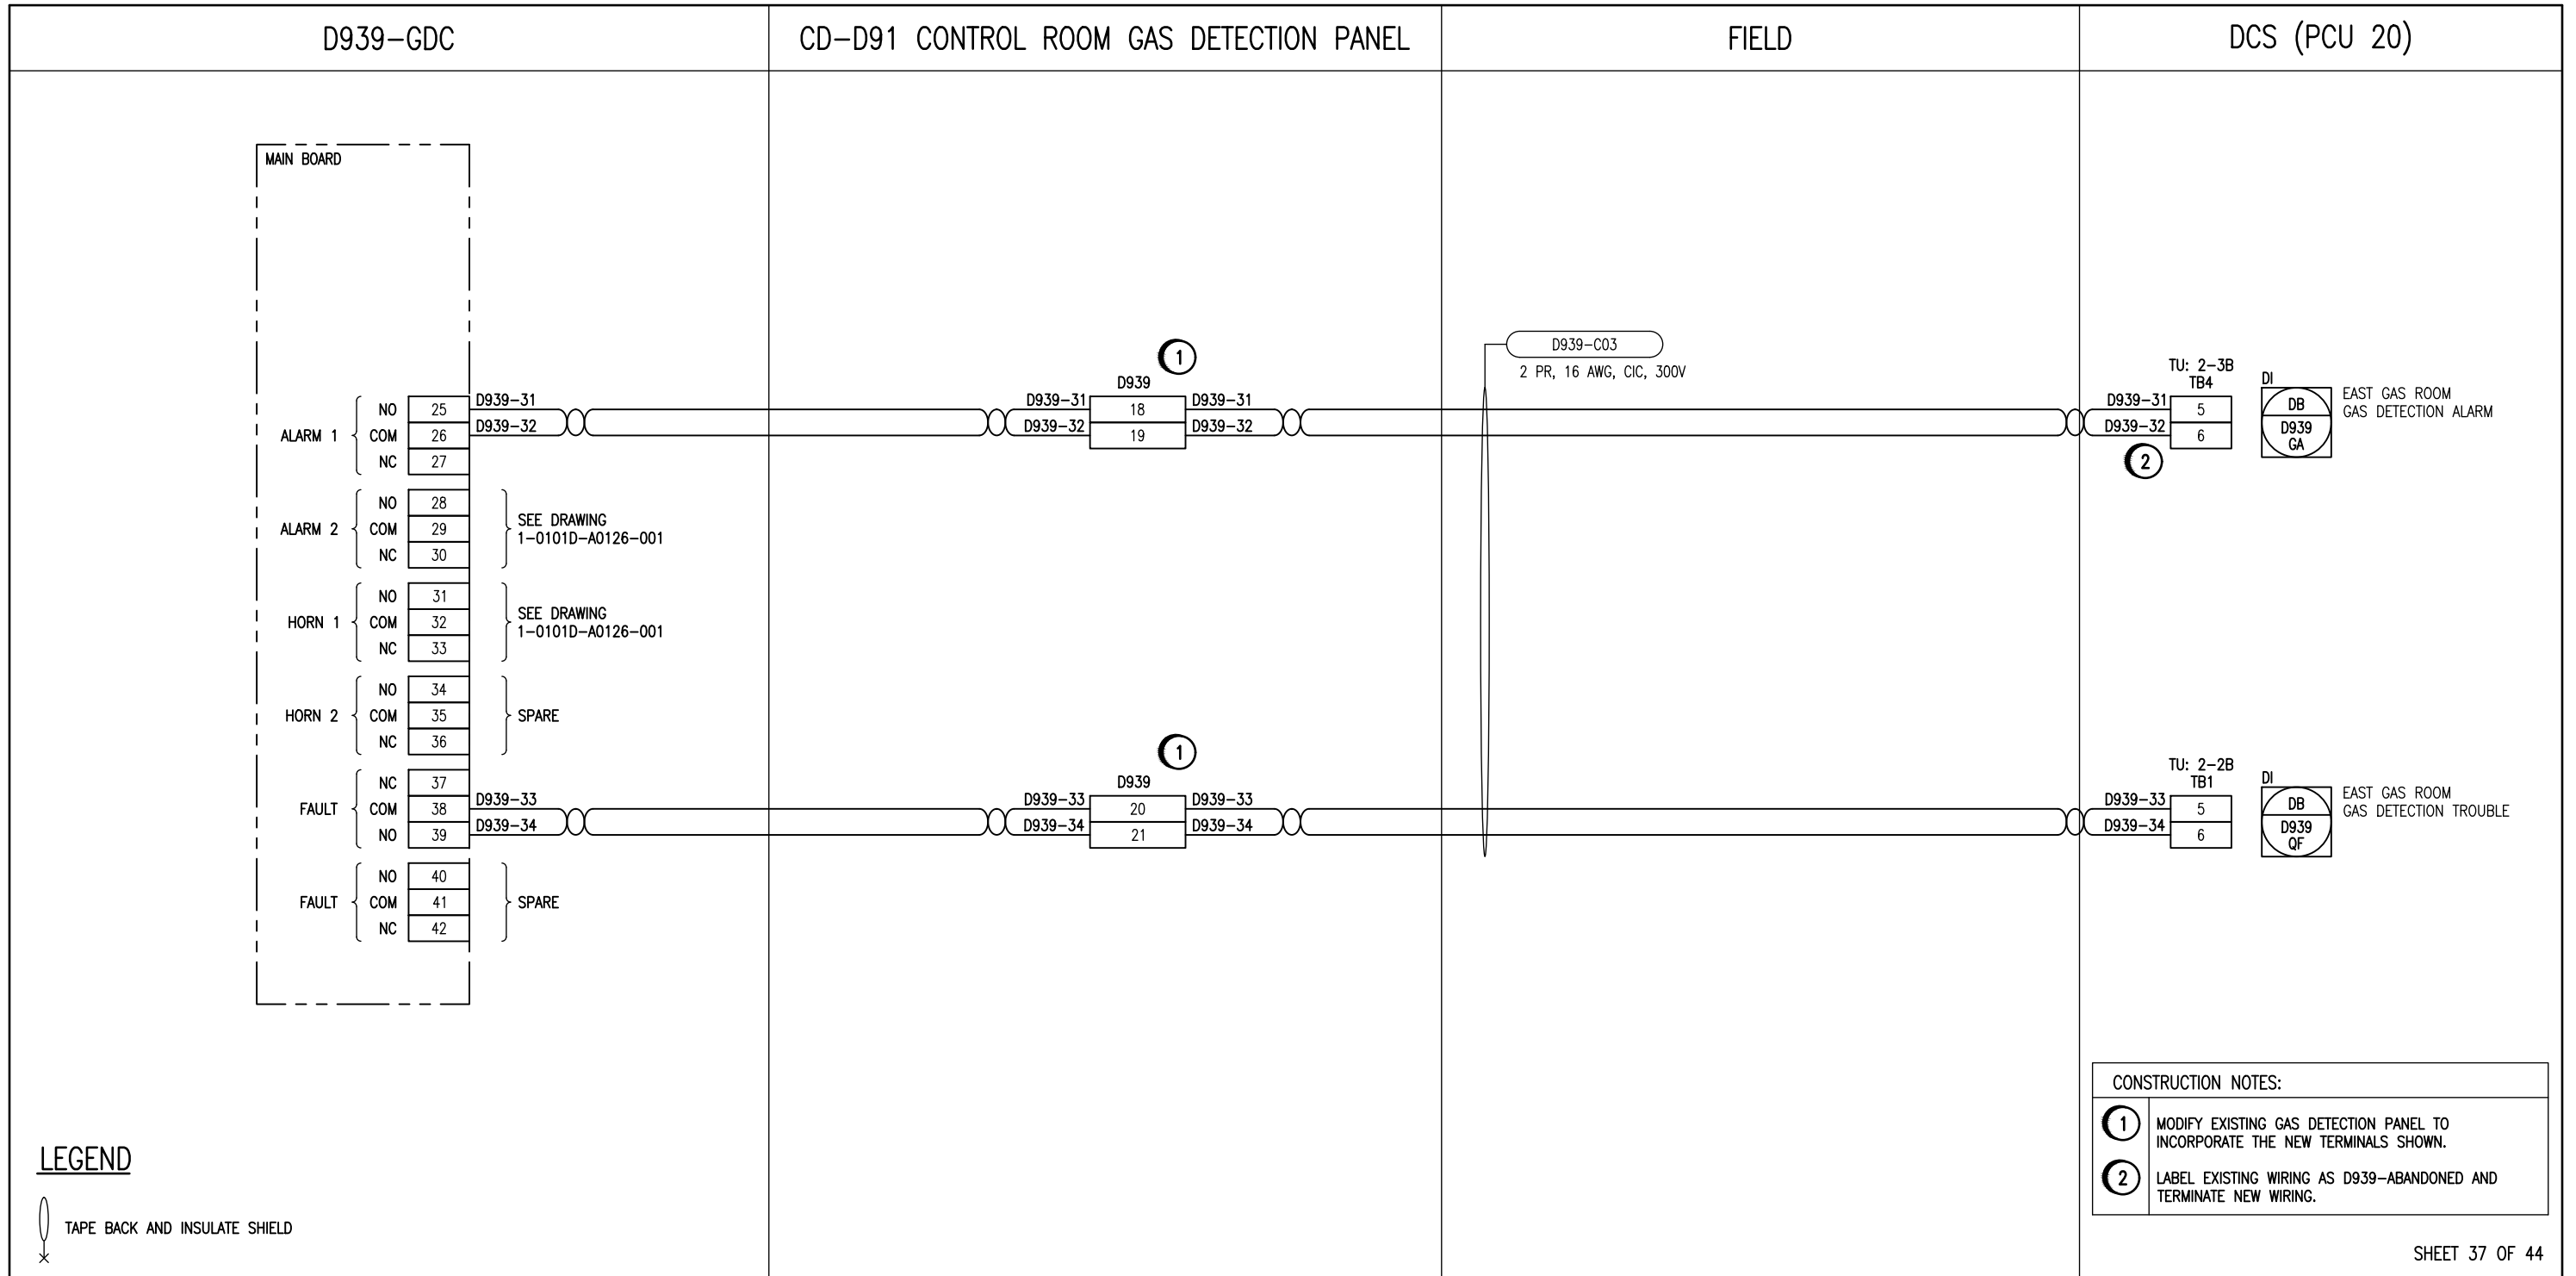

SHEET 37 OF 44

NOTES:

- GAS DETECTION CONTROLLER ALARM AND FAULT RELAYS TO BE ENERGIZED WHEN POWERED AND OPERATING UNDER NORMAL CONDITIONS.
- SEE DRAWING 1-0101D-A0115-001 FOR LOCATION.

ENGINEERS GEOSCIENTISTS MANITOBA
 Certificate of Authorization
 CENGYS Ltd.
 No. 6983

NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR CONSTRUCTION	2018-08-01	CJR	CJR

CENGYS

DESIGNED BY: C. REIMER	CHECKED BY: C. REIMER
DRAWN BY: S. FUNK	APPROVED BY: C. REIMER
SCALE: NTS	DATE: 2019-05-18
ISSUED FOR CONSTRUCTION	
BY: K. SCHIMKE	DATE: 2019-08-01
BID OPPORTUNITY NO.: 630-2019	

ENGINEER'S SEAL

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT
 DIGESTERS
 LOOP DIAGRAM
 D939-GDC
 DCS ALARMS

CITY DRAWING NUMBER 1-0101D-A0127	SHEET 001	REV. 00	SIZE B
--------------------------------------	--------------	------------	-----------