

WINNIPEG TRANSIT - GARAGE BUILDING HOIST REPLACEMENT PROGRAM 421 OSBORNE STREET, WINNIPEG, MANITOBA

DRAWING INDEX

STRUCTURAL DRAWINGS

- S0.1 DRAWING INDEX, SITE PLAN AND GENERAL NOTES
- S2.1 DEMOLITION PARTIAL FLOOR PLAN
- S2.2 NEW PARTIAL PILING PLAN, NEW PHASE 1 PILING PLAN & SCHEDULES
- S2.3 NEW PARTIAL FLOOR PLAN, NEW PHASE 1 PLAN & SCHEDULES
- S4.1 DEMOLITION DETAILS
- S4.2 NEW DETAILS
- S4.3 NEW DETAILS

MECHANICAL DRAWINGS


- MO.1 MAIN FLOOR PLAN - MECHANICAL - DEMOLITION
- M1.1 MAIN FLOOR PLAN - MECHANICAL - NEW CONSTRUCTION

ELECTRICAL DRAWINGS

- EO.1 MAIN FLOOR PLAN - ELECTRICAL - DEMOLITION
- E1.1 MAIN FLOOR PLAN - ELECTRICAL - NEW CONSTRUCTION

PRIME CONSULTANT



300-275 Carlton Street
Winnipeg, Manitoba R3C 5R6
T 204. 943. 7501
F 204. 943. 7507



**Crosier Kilgour
& Partners Ltd.**
CONSULTING STRUCTURAL ENGINEERS

MECH/ELEC CONSULTANT

770 Bradford Street
Winnipeg, Canada
T 204. 775. 0291
SMSeng.com

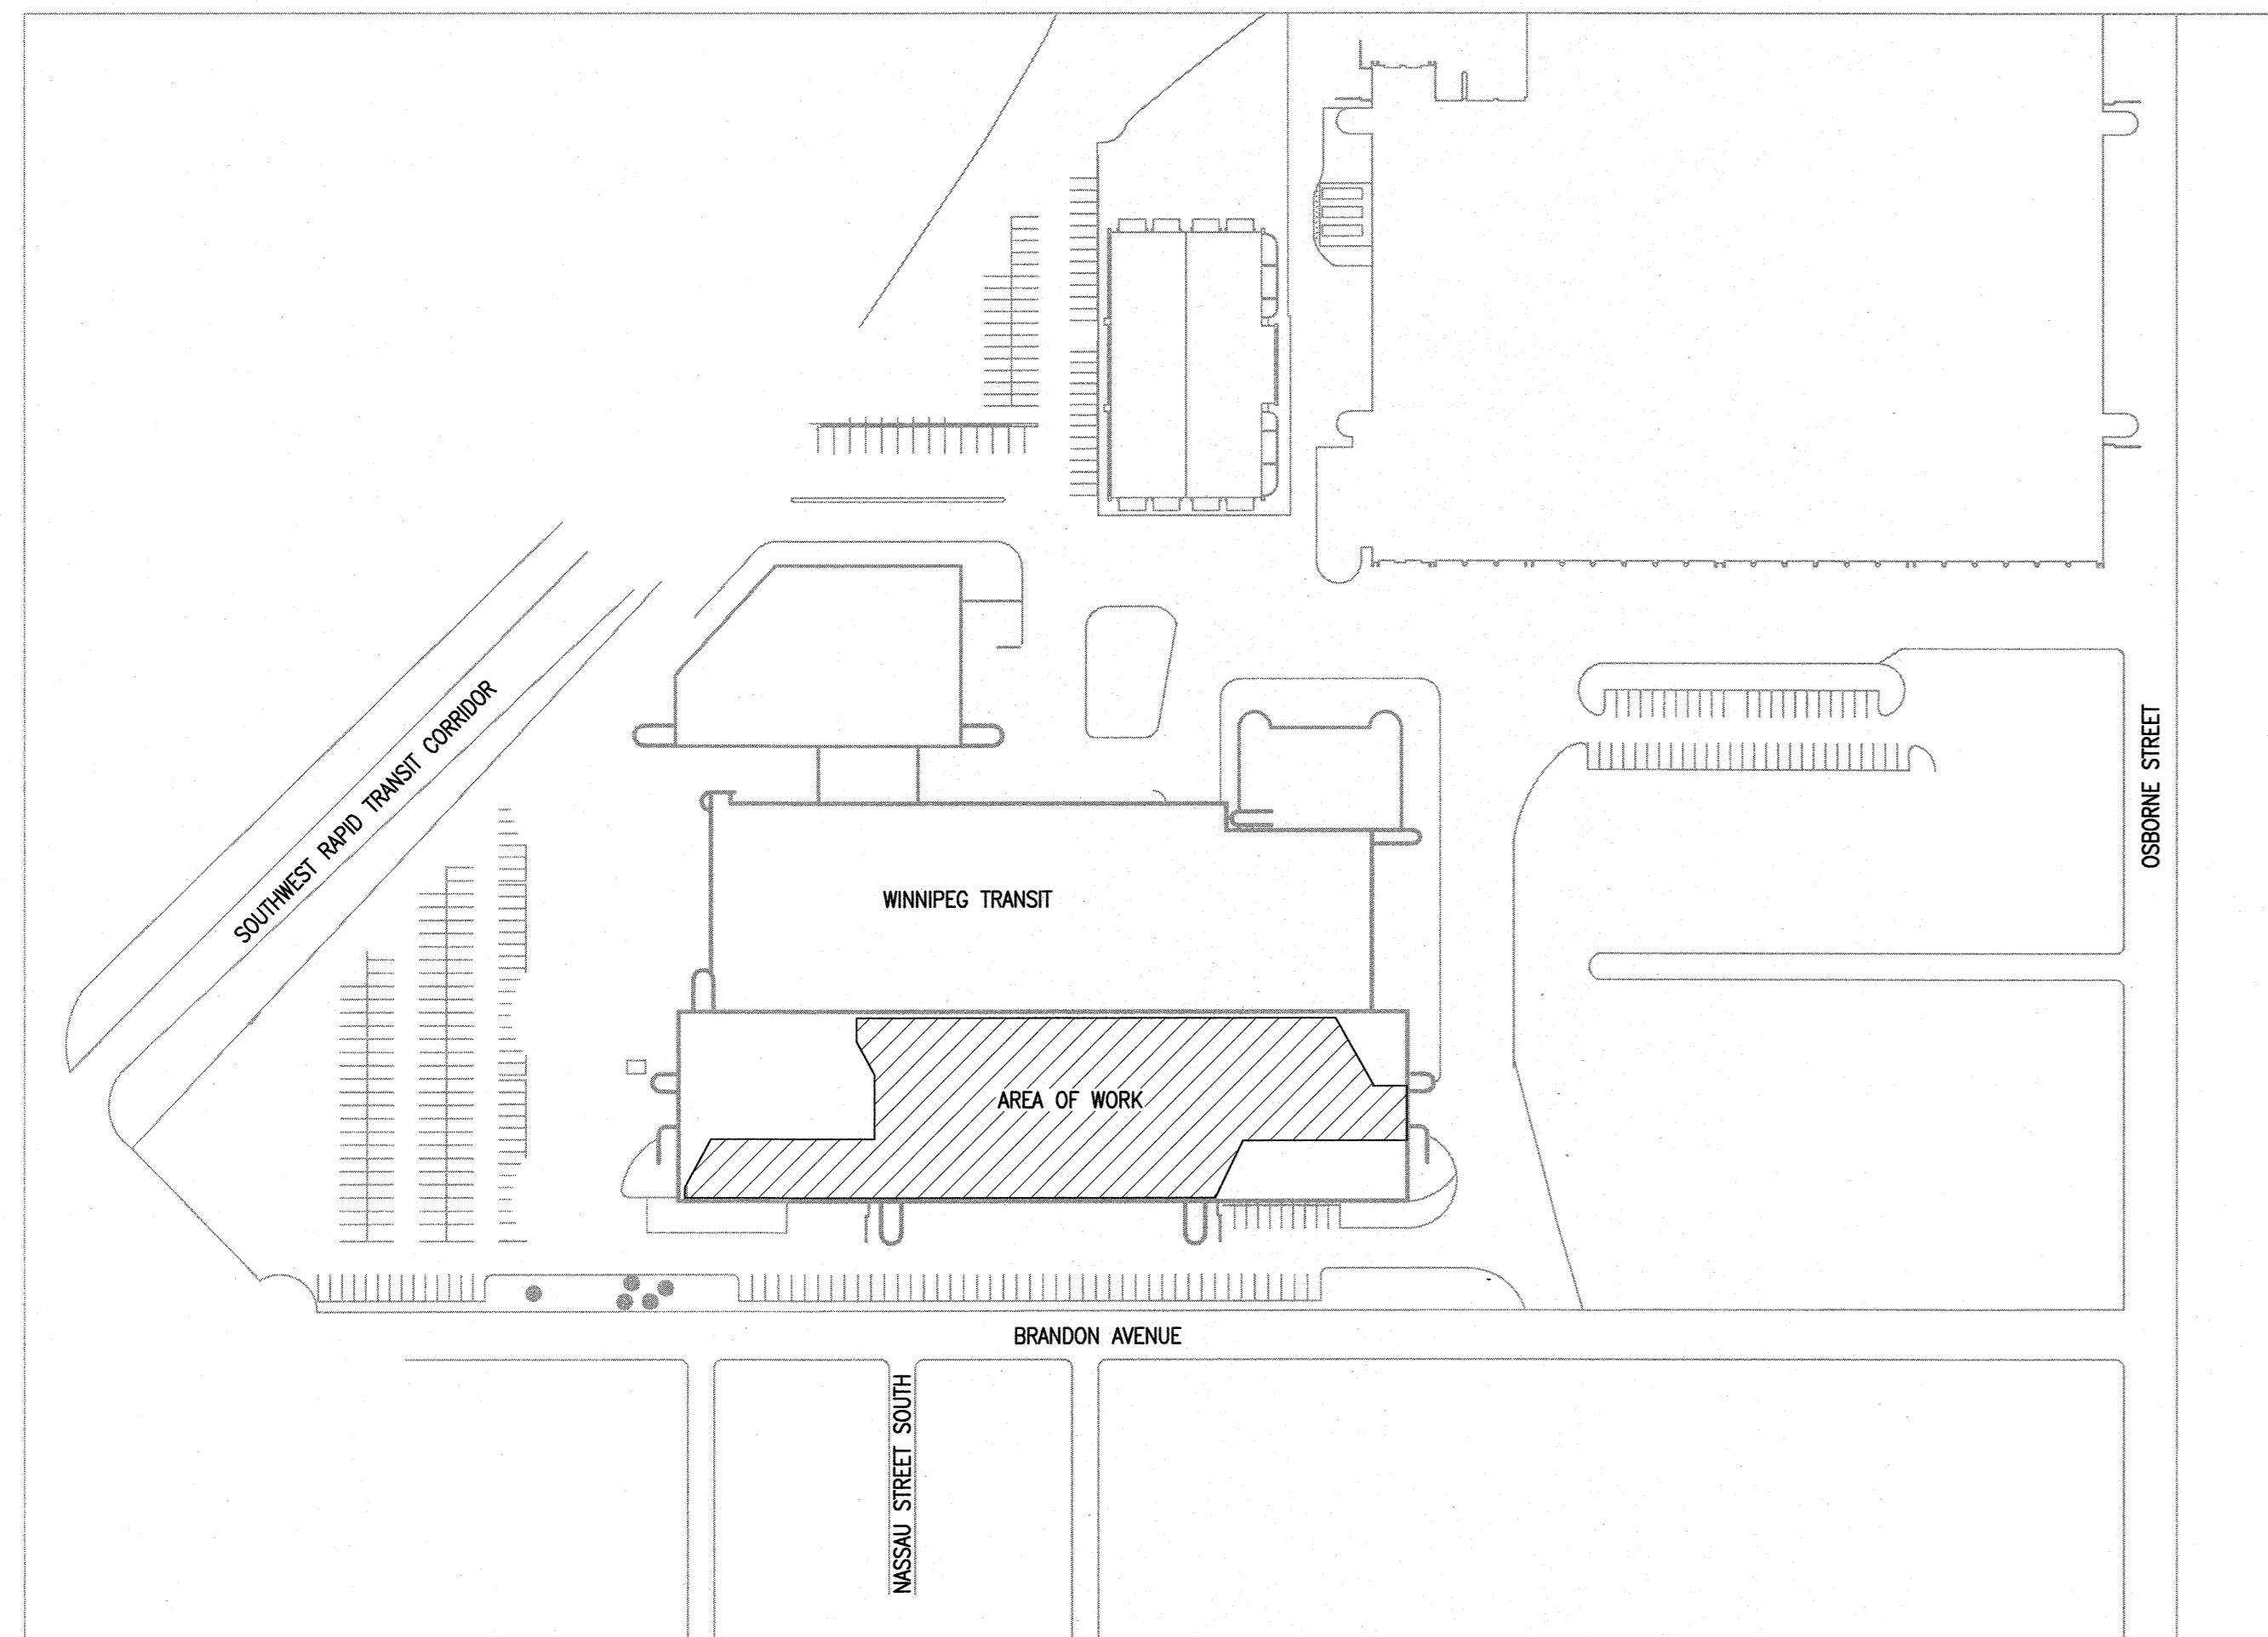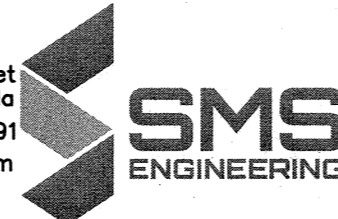

GENERAL NOTES

- STRUCTURAL DESIGN BASED ON THE MANITOBA BUILDING CODE 2011 EDITION.
 - IMPORTANCE CATEGORY: NORMAL
 - SEISMIC SITE CLASSIFICATION: NOT APPLICABLE
 - DO NOT SCALE DRAWINGS.
 - ALL DIMENSIONS ARE TO BE VERIFIED WITH THE EXISTING SITE CONDITIONS PRIOR TO CONSTRUCTION.
 - THESE STRUCTURAL DRAWINGS SHOW THE COMPLETED STRUCTURE AND DO NOT INDICATE ALL COMPONENTS NECESSARY FOR SAFETY DURING CONSTRUCTION. THE GENERAL CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR SAFETY ON AND AROUND THE JOBSITE DURING CONSTRUCTION.
 - THE EXISTING BUILDING SUPERSTRUCTURE AND FOUNDATION HAVE BEEN REVIEWED AND CAN SUPPORT ALL NEW LOADING CONDITIONS IN ACCORDANCE WITH PART 4 OF THE 2011 MANITOBA BUILDING CODE, UNLESS NOTED.

FOUNDATIONS

- A COPY OF THE GEOTECHNICAL REPORT COMMISSIONED BY THE CITY IS AVAILABLE FOR REVIEW AT THE OFFICES OF THE CONTRACT ADMINISTRATOR.
- NOTWITHSTANDING THE INFORMATION PROVIDED IN THE GEOTECHNICAL REPORT THE FOUNDATION AND GENERAL CONTRACTORS SHALL SATISFY THEMSELVES AS TO THE PREVAILING CONDITIONS AT THE SITE AS NO EXTRAS SHALL BE GRANTED SHOULD CONDITIONS DIFFER FROM THOSE INDICATED.
- ALL FRICTION PILES ARE DESIGNED BASED ON THE FOLLOWING:
 - U/S SKIN FRICTION OF 18 kPa FROM 2.4 m TO 7.6 m AND 10 kPa FROM 7.6 m TO 15 m. THIS FRICTION VALUE HAS BEEN MULTIPLIED BY A GEOTECHNICAL RESISTANCE FACTOR OF 0.40
 - S/L SKIN FRICTION OF 15 kPa FROM 2.4 m TO 7.6 m AND 8 kPa FROM 7.6 m TO 15 m.
 - EFFECTIVE LENGTH OF FRICTION PILES IS TOTAL LENGTH AS SHOWN ON PLAN MINUS 2400 mm FOR SLAB PILES AND MINUS 1000 mm FOR INTERIOR PILES BELOW GRADE BEAMS.
 - FRICTION PILE REINFORCING TO BE 6000 mm LONG UNLESS NOTED IN PLANS; 10M RINGS AT 1200 mm ON-CENTRE AND 3-10M RINGS AT 150 mm ON-CENTRE AT TOP. EXTEND VERTICAL PILE REINFORCING 450 mm INTO BEAMS OR WALLS. PILE REINFORCING TO BE 5-10M FOR 400 mm DIAMETER PILES, 6-10M FOR 450 mm, 5-15M FOR 500 mm, 5-15M FOR 550 mm, 6-15M FOR 600 mm.

CAST-IN-PLACE CONCRETE

- CONCRETE
 - ALL CONCRETE IS TO BE MANUFACTURED AND INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF CSA-A23.1-14 "CONCRETE MATERIALS AND METHODS OF CONCRETE CONSTRUCTION" AND CSA-A23.2-14 "METHOD OF TEST FOR CONCRETE".
 - PROVIDE CERTIFICATION THAT MIX PROPORTIONS SELECTED WILL PRODUCE CONCRETE OF QUALITY, YIELD AND STRENGTH AS SPECIFIED IN CONCRETE MIXES, AND WILL COMPLY WITH CSA-A23.1. CERTIFICATION LETTER TO BE SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE PROVINCE OF MANITOBA.
 - PROVIDE CERTIFICATION THAT PLANT, EQUIPMENT, AND MATERIALS TO BE USED IN CONCRETE COMPLY WITH REQUIREMENTS OF CSA-A23.1. CERTIFICATION LETTER TO BE SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE PROVINCE OF MANITOBA.
 - CONCRETE PROPERTIES SHALL BE AS FOLLOWS UNLESS NOTED OTHERWISE ON THE DRAWINGS.

PILES:	35 MPa MIN. AT 56 DAYS CLASS OF EXPOSURE: S-2 ENTRAINED AIR/CATEGORY: 2 (4% TO 7%) CEMENT TYPE: HS AGGREGATE: MAX. 20 mm CURING TYPE: TYPE 2 - ADDITIONAL SLUMP: MIN. 120 mm
STRUCTURAL SLABS, WALLS, GRADE BEAMS	35 MPa MIN. AT 28 DAYS CLASS OF EXPOSURE: C-1 ENTRAINED AIR/CATEGORY: 2 (4% TO 7%) AGGREGATE MAX. 20 mm CURING TYPE: TYPE 2 - ADDITIONAL
INTERIOR SLABS-ON-GRADE:	32 MPa MIN. AT 28 DAYS CLASS OF EXPOSURE: C-2 ENTRAINED AIR/CATEGORY: 2 (4% TO 7%) AGGREGATE MAX. 20 mm CURING TYPE: TYPE 2 - ADDITIONAL

- UNLESS INDICATED OTHERWISE THE GENERAL CONTRACTOR SHALL SPECIFY CONCRETE SLUMP APPROPRIATE WITH PLACEMENT METHODS AND SITE CONDITIONS. THE GENERAL CONTRACTOR SPECIFIED SLUMP MUST BE SHOWN ON THE CERTIFICATION LETTER AND CONCRETE DELIVERY TICKET.
- UNLESS NOTED OTHERWISE CONCRETE CURING TO CONFORM TO THE LATEST EDITION OF CSA-A23.1-14 AS FOLLOWS:
 - TYPE 2 - ADDITIONAL: 7 DAYS $\geq 10^{\circ}\text{C}$ AND FOR A TIME NECESSARY TO ATTAIN 70% OF THE SPECIFIED STRENGTH.
- AIR ENTRAINING ADMIXTURES SHALL CONFORM TO THE REQUIREMENTS OF ASTM C260/C260M-10a "STANDARD SPECIFICATION FOR AIR ENTRAINING ADMIXTURES FOR CONCRETE". SUPERPLASTICIZING ADMIXTURES SHALL CONFORM TO ASTM C494/C494M "STANDARD SPECIFICATION FOR CHEMICAL ADMIXTURES FOR CONCRETE" OR ASTM C1017/C1017M "STANDARD SPECIFICATION FOR CHEMICAL ADMIXTURES FOR USE IN PRODUCING FLOWING CONCRETE" WHEN FLOWING CONCRETE IS APPLICABLE. AIR ENTRAINING ADMIXTURES TO HAVE A DURABILITY FACTOR GREATER THAN 75, WHEN TESTED TO ASTM STANDARDS C666/C666M PROCEDURE A. SPACING FACTOR FOR ANY AIR ENTRAINING ADMIXTURE MUST BE 0.17mm OR LESS WHEN TESTED IN ACCORDANCE WITH ASTM C457 "STANDARD TEST METHOD FOR MICROSCOPICAL DETERMINATION OF PARAMETERS OF THE AIR-VOID SYSTEM IN HARDENED CONCRETE".

- REINFORCING STEEL
 - THE STRUCTURAL STEEL FABRICATOR'S ENGINEER SHALL BE RESPONSIBLE FOR LOCATING AND DESIGNING PROVISIONS FOR ALL TEMPORARY FALL PROTECTION SYSTEMS REQUIRED DURING CONSTRUCTION TO MEET MANITOBA WORKPLACE HEALTH AND SAFETY REGULATIONS.
 - STRUCTURAL STEEL TO CONFORM TO CSA-G40.21, "STRUCTURAL QUALITY STEELS" AND CSA-G40.20 "GENERAL REQUIREMENTS FOR ROLLED OR WELDED STRUCTURAL QUALITY STEEL", ASTM A572/A572M "STANDARD SPECIFICATION FOR HIGH-STRENGTH LOW-ALLOY COLUMBIUM-VANADIUM STRUCTURAL STEEL" OR ASTM A992/A992M "STANDARD SPECIFICATION FOR STRUCTURAL STEEL SHAPES".
 - ALL ROLLED OR STEEL STRUCTURAL SECTIONS SHALL BE C40.21-350W, ASTM A992 OR ASTM A572 GRADE 50. ALL HOLLOW STRUCTURAL SECTIONS TO BE G40.21-350W CLASS C OR ASTM A500-C. ALL ANGLES, CHANNELS AND PLATES SHALL BE G40.21-300W.
 - FABRICATION AND ERECTION OF STRUCTURAL STEEL SHALL BE PERFORMED IN ACCORDANCE WITH CSA S16-14, "DESIGN OF STEEL STRUCTURES".
 - ALL WELDING SHALL CONFORM TO THE LATEST EDITION OF CSA W59, "WELDED STEEL CONSTRUCTION". FABRICATORS SHALL BE PROPERLY CERTIFIED IN ACCORDANCE WITH CSA W47.1, "CERTIFICATION OF COMPANIES FOR FUSION WELDING OF STEEL STRUCTURES".
 - STRUCTURAL STEEL SUPPLIER IS TO SUBMIT ENGINEERING DRAWINGS BEARING THE SEAL OF A PROFESSIONAL ENGINEER REGISTERED IN THE PROVINCE OF MANITOBA COVERING THE DESIGN OF CONNECTIONS, TO THE PROJECT DESIGN ENGINEER FOR REVIEW PRIOR TO FABRICATION. CONNECTION DESIGN TO INCLUDE FOR ALL ADJUSTABLE CONNECTIONS REQUIRED TO SUIT FABRICATION AND ERECTION PROCEDURES AND TOLERANCES.

- ALL REINFORCING STEEL TO BE CSA-C30.18M-09 GRADE 400R DEFORMED BARS EXCEPT COLUMN TIES AND BEAM STIRRUPS WHICH SHALL BE GRADE 400W STEEL.
- ALL REINFORCING IS TO BE DETAILED IN ACCORDANCE WITH THE LATEST EDITION OF THE REINFORCING STEEL INSTITUTE OF CANADA - MANUAL OF STANDARD PRACTICE, EXCEPT OTHERWISE NOTED. ALL LAPPED SPLICES TO BE CLASS B SPLICES, UNLESS NOTED.
- WELDED STEEL WIRE MESH SHALL BE TO ASTM A185/A185M-07, 400 MPa YIELD, FLAT SHEETS ONLY.
- REINFORCING STEEL COVER IS TO CONFORM TO CAN/CSA A23.3-14 "DESIGN OF CONCRETE STRUCTURES FOR BUILDINGS" AND AS FOLLOWS:

WALLS: EXPOSURE CLASS: C-1	60 mm	OUTSIDE FACE	60 mm	INSIDE FACE.
STRUCTURAL SLABS: EXPOSURE CLASS: C-1	60 mm	TOP	60 mm	BOTTOM
GRADE BEAMS: EXPOSURE CLASS: C-1	60 mm	BOTTOM TO TIES	60 mm	SIDES AND TOP TO TIES.
PILES: EXPOSURE CLASS: S-2	75 mm	TO TIES.		
SLABS-ON-GRADE: EXPOSURE CLASS: C-2	60 mm	TOP	60 mm	BOTTOM

- IN WALLS AND GRADE BEAMS, BEND ALL TOP, INTERMEDIATE HORIZONTAL AND BOTTOM STEEL 600 mm AROUND CORNERS, OR USE EXTRA L BARS 1200 mm LONG. ALL OPENINGS IN WALLS TO HAVE 2-15M EACH SIDE AND 2-25M OVER, EXCEPT AS NOTED.
- TOP STEEL IN BEAMS TO BE LAPPED AT CENTRE SPAN, WITH CLASS B SPLICES, BOTTOM STEEL TO BE BUTTED AT SUPPORT.
- IN WALLS, TOP STEEL TO BE LAPPED AT CENTRE SPAN WITH CLASS A TENSION SPLICES, BOTTOM STEEL TO BE BUTTED AT SUPPORT, HORIZONTAL STEEL TO BE LAPPED WITH CLASS A TENSION SPLICES, VERTICAL STEEL TO BE LAPPED WITH CLASS B TENSION SPLICES, EXCEPT AS NOTED.
- IN SLABS ON GRADE, BARS TO BE LAPPED WITH CLASS A TENSION SPLICES, EXCEPT AS NOTED.
- ALL REINFORCING TO BE HELD IN PLACE, AND TIED BY THE USE OF PROPER ACCESSORIES, SUCH AS HI-CHAIRS, SPACERS, ETC. TO BE SUPPLIED BY THE REINFORCING STEEL FABRICATOR. HI-CHAIRS TO HAVE 4 LEGS AND TO BE STAPLED OR NAILED TO THE FORMWORK.
- ALL OPENINGS IN CAST-IN-PLACE CONCRETE FLATWORK TO BE TRIMMED WITH 2-15M ALL AROUND ON BOTH FACES, EXCEPT AS NOTED.
- FOR ALL STRUCTURAL SLABS A MINIMUM OF 50% OF THE BOTTOM STEEL SHALL BE CONTINUED A MINIMUM DISTANCE OF 150 mm INTO ALL SUPPORTING WALLS AND BEAMS. IF KEYS ARE USED AT JOINTS BETWEEN SLABS AND WALLS OR BEAMS, BOTTOM DOWELS EQUAL TO BOTTOM REINFORCEMENT OR 10M AT 300 mm O/C SHALL BE PROVIDED WHICHEVER IS GREATER.
- WHEN CONCRETE BEAMS ARE CAST INTO A WALL CHASE, DOWELS SIZE AND NUMBER SAME AS BEAM REINFORCING ARE TO BE PROVIDED FROM WALL, UNLESS OTHERWISE SHOWN ON PLAN. PROVIDE MINIMUM 2-10M BOTTOM INTEGRITY BARS THROUGHOUT STRUCTURES IN ACCORDANCE WITH CSA A23.3-14, CLAUSE 13.10.6.

FORMWORK

- SHEARMAT OR APPROVED CARDBOARD VOIDFORM WITH A MIN. DEPTH OF 150 mm SHALL BE USED AS THE BOTTOM FORM FOR STRUCTURAL SLABS AT GRADE, GRADE BEAMS, AND WALLS IN CONTACT WITH SOIL. SELECT AND INSTALL IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
- ACCESSORIES SUCH AS HI-CHAIRS, SPACERS, ETC. SHALL BE SUPPORTED BY PADS OF PLYWOOD OR TEMPERED HARDBOARD TO PREVENT PUNCTURING THE VOIDFORM.
- UNLESS NOTED OTHERWISE PROVIDE SLIP JOINT ALL PAVING OR CONCRETE SLABS ON GRADE AGAINST STRUCTURAL MEMBERS WITH 12 mm ASPHALT IMPREGNATED FIBREBOARD.
- ALL CONSTRUCTION JOINT KEYS ARE TO BE A MINIMUM OF 40 mm DEEP.
- ALL STRUCTURAL SLABS FRAMING INTO BEAMS AND WALLS ARE TO HAVE A MINIMUM KEY OF 40 mm.
- ALL CONCRETE BEAMS FRAMING INTO CONCRETE WALLS ARE TO BE SUPPORTED BY A CHASE OF MINIMUM 100 mm AND THE HEIGHT AND WIDTH OF THE BEAM.
- PLACE 1 TO MIL POLYETHYLENE UNDER ALL SLABS ON FILL AND OVER TOP OF VOIDFORM.
- PROVIDE 150 mm WIDE, RIBBED, PVC WATERSTOPS IN ALL HORIZONTAL AND VERTICAL CONSTRUCTION JOINTS IN ALL WALLS BELOW GRADE AND PIT WALLS.

STRUCTURAL STEEL

- THE STRUCTURAL STEEL FABRICATOR'S ENGINEER SHALL BE RESPONSIBLE FOR LOCATING AND DESIGNING PROVISIONS FOR ALL TEMPORARY FALL PROTECTION SYSTEMS REQUIRED DURING CONSTRUCTION TO MEET MANITOBA WORKPLACE HEALTH AND SAFETY REGULATIONS.
- STRUCTURAL STEEL TO CONFORM TO CSA-G40.21, "STRUCTURAL QUALITY STEELS" AND CSA-G40.20 "GENERAL REQUIREMENTS FOR ROLLED OR WELDED STRUCTURAL QUALITY STEEL", ASTM A572/A572M "STANDARD SPECIFICATION FOR HIGH-STRENGTH LOW-ALLOY COLUMBIUM-VANADIUM STRUCTURAL STEEL" OR ASTM A992/A992M "STANDARD SPECIFICATION FOR STRUCTURAL STEEL SHAPES".
- ALL ROLLED OR STEEL STRUCTURAL SECTIONS SHALL BE C40.21-350W, ASTM A992 OR ASTM A572 GRADE 50. ALL HOLLOW STRUCTURAL SECTIONS TO BE G40.21-350W CLASS C OR ASTM A500-C. ALL ANGLES, CHANNELS AND PLATES SHALL BE G40.21-300W.
- FABRICATION AND ERECTION OF STRUCTURAL STEEL SHALL BE PERFORMED IN ACCORDANCE WITH CSA S16-14, "DESIGN OF STEEL STRUCTURES".
- ALL WELDING SHALL CONFORM TO THE LATEST EDITION OF CSA W59, "WELDED STEEL CONSTRUCTION". FABRICATORS SHALL BE PROPERLY CERTIFIED IN ACCORDANCE WITH CSA W47.1, "CERTIFICATION OF COMPANIES FOR FUSION WELDING OF STEEL STRUCTURES".
- STRUCTURAL STEEL SUPPLIER IS TO SUBMIT ENGINEERING DRAWINGS BEARING THE SEAL OF A PROFESSIONAL ENGINEER REGISTERED IN THE PROVINCE OF MANITOBA COVERING THE DESIGN OF CONNECTIONS, TO THE PROJECT DESIGN ENGINEER FOR REVIEW PRIOR TO FABRICATION. CONNECTION DESIGN TO INCLUDE FOR ALL ADJUSTABLE CONNECTIONS REQUIRED TO SUIT FABRICATION AND ERECTION PROCEDURES AND TOLERANCES.

The General Contractor shall check & verify all dimensions and report any errors or omissions to the designers.

No.	Date	Issue/Revision	By
1	2019-08-30	ISSUED FOR CONSTRUCTION	IM
0	2019-08-21	ISSUED FOR BID	IM



Consultant


300-275 Carlton Street
Winnipeg, Manitoba R3C 5R6
T 204. 943. 7501
F 204. 943. 7507

**Crosier Kilgour
& Partners Ltd.**
CONSULTING STRUCTURAL ENGINEERS

Project
**WINNIPEG TRANSIT
GARAGE BUILDING**
HOIST REPLACEMENT PROGRAM
421 OSBORNE STREET
WINNIPEG, MANITOBA

Sheet Title
**DRAWING INDEX, SITE PLAN &
GENERAL NOTES**

File	2018-1170	Date	2019-08-30
Design	IM	Drawn	JSR
Revision	1	Sheet No.	S0.1



SITE PLAN
N.T.S.