


METRIC WHOLE NUMBERS INDICATE MILLIMETRES DECIMALIZED NUMBERS INDICATE METRES



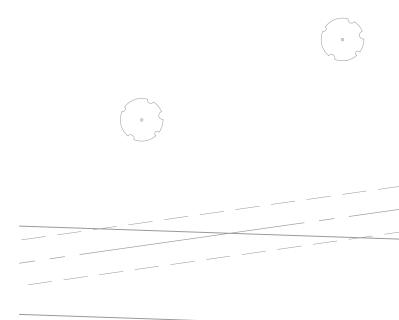

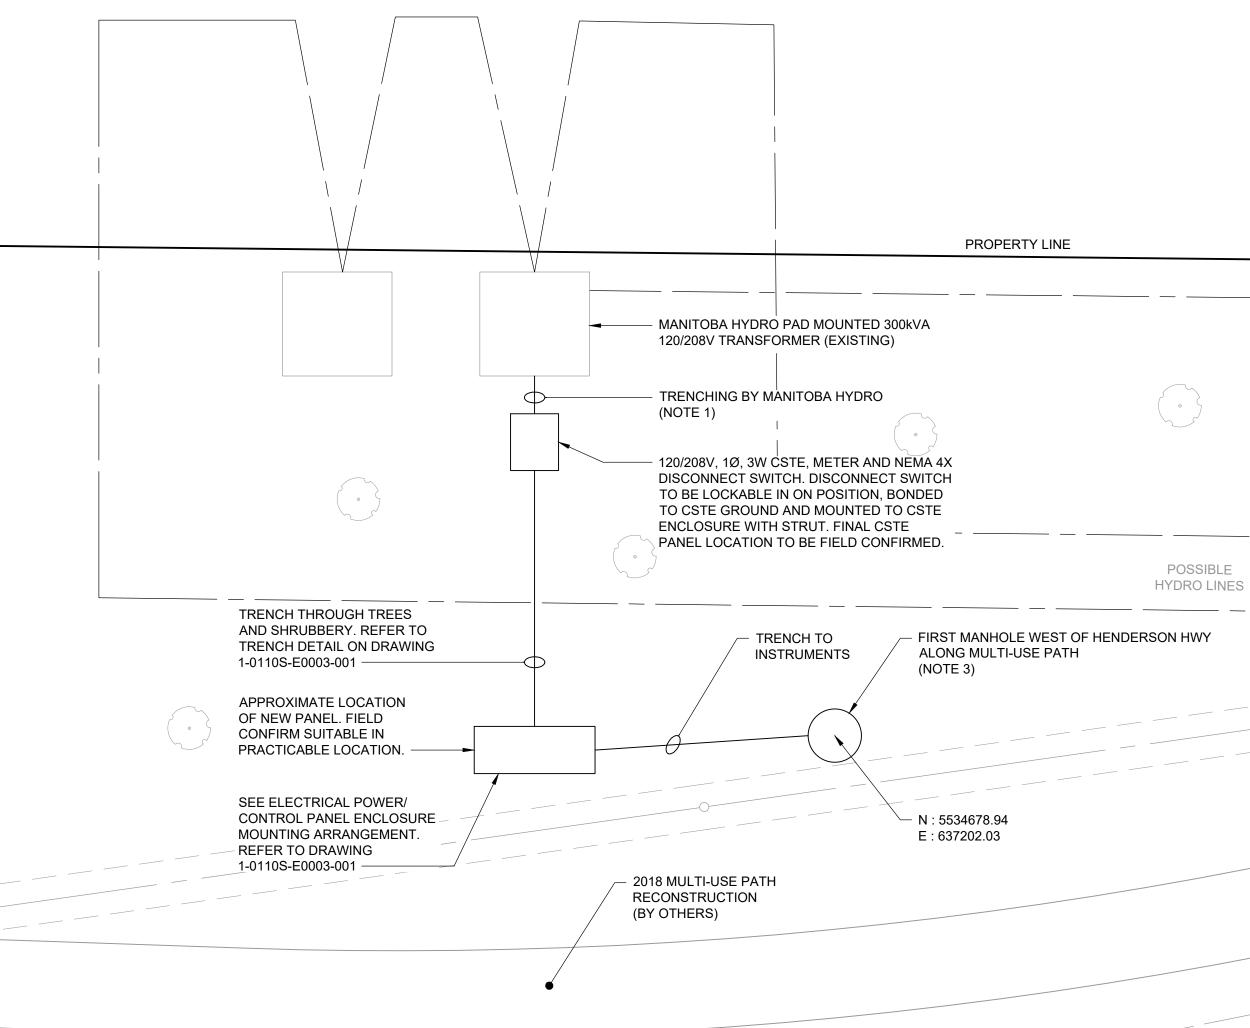


SITE PLAN EAST OF RED RIVER - ELECTRICAL Scale 1:150

NOTES:

- 1. CONTRACTOR TO COORDINATE WITH VALHALLA BUILDING OWNER, AECOM AND MANITOBA HYDRO TO SCHEDULE (APPROXIMATELY 1 HOUR) SHUTDOWN TO INSTALL TIE-INS TO CSTE AND 120/208V TRANSFORMER.
- 2. TAKE CARE WITH TRENCHING AND INSTALLING ELECTRICAL EQUIPMENT TO MINIMIZE DAMAGE TO TREES AND SHRUBBERY
- 3. CORE AND SLEEVE CABLING THROUGH CONCRETE. FILL SLEEVE WITH WATERTIGHT SEALANT. SEE SPECIFICATIONS.
- 4. SEE DIRECT BURIED TRENCH DETAIL ON DRAWING 1-0110S-E0003-001.

LOCATION APPROVED UNDERGROUND STRUCTURES					AECOM				PROFESSIONAL'S	
SUPR. U/G STRUCTURES DATE COMMITTEE									1/ 2/ mol	
NOTE: LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.					DESIGNED BY	MP/JR	CHECKED BY	SS	RU RG Mem 344	
					DRAWN BY	RC	APPROVED BY	DA	THE 2019-1	
					HOR. SCALE VERT. SCALE	1:150 N/A	RELEASED FOR CONSTRUCTION		CONSULTANT	
	0 NO.	ISSUED FOR CONSTRUCTION REVISIONS	20/11/05 YY/MM/DD		DATE		DATE	Nov. 4/20	60509089-SHT-3	

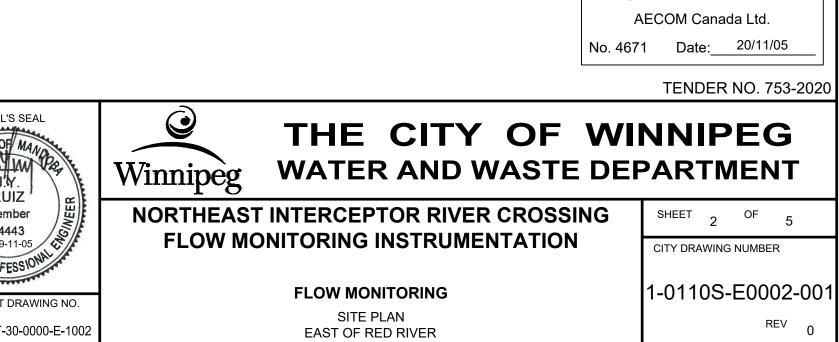

MANITOBA Certificate of Authorization
