


(EXIST) PANEL 'EP-A'		VOLTAGE		120/208V-3PH-4W		MAIN BUS		225A, MAIN BREAKER 200A-3P		C/W LOCKABLE DOOR	
NOTES:	DESCRIPTION	VA	BKR	A	B	C	BKR	VA	DESCRIPTION	NOTES:	
RTU (EAST)		6846	1	1	2	15	1620		CARD ACCESS		
		30	3	3	4	15	600		EMERGENCY BATTERY BANKS, EBB-1, EBB-2		
			5	5	6	15	600		COMBO SMOKE/CO, SMOKE, HEAT DETECTORS		
RTU (NORTH)		9438	7	7	8	20	2496		AC (DORM-EAST)		
		40	9	9	10						
			11	11	12	20	2496		AC (DORM-WEST)		
			13	13	14						
AC (OFFICE)		2834	15	15	16	15	1200		DRYER		
			17	17	18	15	960		UNIT HEATER ERMS		
UNIT HEATERS S		960	19	19	20	15	480		EXHAUST SOUTH		
UNIT HEATERS S		960	21	21	22	15	240		UNIT HEATER N		
UNIT HEATERS ERMS		960	23	23	24	10000		MUA-1 (LOCKER 125)			
UNIT HEATERS/ COMPUTERS PLUG IN COAT RM. FOR WEST SIDE DRYER		960	25	25	26	40					
CHARGER DROP CORD, CHD #2, ENGINE 101		2880	27	27	28						
CHARGER DROP CORD, CHD #3, ENGINE 105		2880	29	29	30	15	800	?			
CHARGER DROP CORD, CHD #6, AMBULANCE		600	31	31	32	15	800	?			
CHARGER DROP CORD, CHD #7, MRV		600	33	33	34	15	800		DESK PLUG		
CHARGER DROP CORD, CHD #7, MRV		1920	35	35	36	15	800	?			
CHARGER DROP CORD, CHD #6, LADDER TRUCK		600	37	37	38	15	800		UNIT HEATER N		
CHARGER DROP CORD, FIRE TRUCK		600	39	39	40	15	800		UNIT HEATER N		
CHARGER DROP CORD, FIRE TRUCK		600	41	41	42	15	800		ALARM SYSTEM		
CHARGER DROP CORD, FIRE TRUCK		720	43	43	44	15	800		UPS		
RECEPTACLE, STANDBY GENSET- APPARATUS		9984	45	45	46	15	800		CIRCUIT		
			47	47	48	20	667		EXHAUST VENTILATION SYSTEM COMPRESSOR		
PRINTOUT CIRCUIT		800	49	49	50	40	4758		EXHAUST VENTILATION SYSTEM		
HEATER- SOUTH ENTRANCE		2000	51	51	52						
			53	53	54						
FORCE FLOW ENTRANCE		480	55	55	56						
EXHAUST FANS, (F-1, F-2, F-3)		228	57	57	58						
TRANSFORMER, 24V (HYDRONIC CONTROL VALVES, THERMOSTAT)		100	59	59	60						
RECEPTACLE (NETWORK RM) LABEL WITH RED LABEL & FACEPLATE		1800	61	61	62	40	4758		EXHAUST VENTILATION SYSTEM		
RECEPTACLE (NETWORK RM) LABEL WITH RED LABEL & FACEPLATE		1900	63	63	64						
RECEPTACLE (NETWORK RM) LABEL WITH RED LABEL & FACEPLATE		1000	65	65	66						
RECEPTACLE (NETWORK RM) LABEL WITH RED LABEL & FACEPLATE		1000	67	67	68						
			69	69	70						
			71	71	72						
			73	73	74						
			75	75	76						
			77	77	78						
			79	79	80						
			81	81	82						
			83	83	84						
LOAD		54510					37870		LOAD		

(EXIST) PANEL 'EP-B'		VOLTAGE		120/208V-3PH-4W		MAIN BUS		225A, MAIN BREAKER 200A-3P		C/W LOCKABLE DOOR	
NOTES:	DESCRIPTION	VA	BKR	A	B	C	BKR	VA	DESCRIPTION	NOTES:	
LIGHTS APPARATUS WEST WALL, BEAM CHD 2		986	15	1	2	15	1200		RECEPTACLES, WATCH DESK 109		
LIGHTS BEAM CHD 3 & 4, APPARATUS		1008	15	3	4	15	1200		RECEPTACLES, WATCH DESK 109		
LIGHTS BEAM CHD 7 & 8, APPARATUS		1008	15	5	6	15	1200		RECEPTACLES, WATCH DESK 109		
LIGHTS BEAM CHD 7 & 8, APPARATUS		1008	15	7	8	20	1200		RECEPTACLES, LIEUTENANT'S OFFICE 103		
LIGHTS BEAM, LIGHTS APPARATUS EAST WALL, SGA ROOM 134		490	15	9	10	20	1200		RECEPTACLES, LIEUTENANT'S OFFICE 103, PARAMEDIC DORM 113, UTR		
OUTSIDE LIGHTS SOUTH ON DOORS, OFF NORTH & EAST, FLOOD WEST, PATIO		381	15	11	12	20	1200		RECEPTACLES, CAPTAIN OFFICE 104		
POLE LIGHTS, OUTSIDE FLOOD EAST & SOUTH		475	15	13	14	20	1200		RECEPTACLES, PLATOON CHIEF OFFICE 105		
LIGHTS, CORRIDOR 111, LIEUT. OFFICE 103, PARAMEDIC DORM 113, PARAMEDIC OFFICE 110		474	15	15	16	20	1200		RECEPTACLES, CONTROL, 108		
LIGHTS, WATCH DESK 109, ENTRANCE HALL 102, WEST 101, UTR 112, NETWORK 107		453	15	17	18	20	1200		RECEPTACLES, CONTROL, 108		
LIGHTS, CAPTAIN PLATOON CHIEF, CAPTAIN FIRE CONTROL RM		335	15	19	20	600			DRINKING FOUNTAIN, ENTRANCE HALL 102		
NIGHT LIGHTS, FRONT OFFICE AREA, CORRIDORS 117 & 127, COMMON RM 130		84	15	21	22	20	1200		RECEPTACLES, PARAMEDIC OFFICE 110		
				23	24	20	1200		RECEPTACLES, PARAMEDIC OFFICE 110		
				25	26	40	6032		DISHWASHER (NEW), KITCHEN		
AUTO DOOR OPERATOR, UTR 112		720	15	27	28						
ICE MACHINE, APPARATUS		1620	15	29	30	15	1300		RECEPTACLE, COFFEE, COMMON 130		
TOASTER CONVEYOR, COMMON 103		2300	20	31	32	15	1200		RECEPTACLE, MICROWAVE, COMMON 130		
				33	34	15	1200		RECEPTACLE, MICROWAVE, COMMON 130		
COKE MACHINE, APPARATUS		1124	15	35	36	20	1000		RECEPTACLE, COUNTER, COMMON 130		
				37	38	20	1000		RECEPTACLE, COUNTER, COMMON 130		
				39	40	20	1000		RECEPTACLE, COUNTER, COMMON 130		
				41	42	15	800		RECEPTACLES, ENTRANCE HALL 102		
				43	44	15	1200		RECEPTACLE, POPCORN, COMMON 130		
				45	46	15	800		RECEPTACLE, ISLAND EAST, KITCHEN 130		
				47	48	15	800		RECEPTACLE, ISLAND NORTH, KITCHEN 130		
				49	50	15	800		RECEPTACLE, ISLAND WEST, KITCHEN 130		
				51	52	15	800		RECEPTACLE, ISLAND SOUTH, KITCHEN 130		
				53	54	15	1200		RECEPTACLE, FRIDGE, KITCHEN 130		
				55	56	15	800		RECEPTACLE, COUNTER SOUTH, KITCHEN 130		
				57	58	15	1200		RECEPTACLE, FREEZER, STORAGE 134		
				59	60	15	1300		RECEPTACLE, ICE MACHINE, STORAGE 134		
				61	62	20	1000		RECEPTACLE, LAUNDRY 134		
				63	64	20	1000		RECEPTACLES, PATIO		
				65	66	15	1000		PLUS-REPAIR OFFICE		
				67	68	20	1200		OUTSIDE PLUG		
				69	70						
				71	72	20	600		DRINKING FOUNTAIN, LOUNGE 105		
				73	74						
				75	76						
				77	78						
				79	80						
				81	82						
				83	84						
LOAD		12665					40532		LOAD		

GENERAL NOTES:
 1. REFER TO DRAWING E1.0 & SPECIFICATIONS.
 2. BRANCH CIRCUITS SHOWN MAY NOT AS PER SITE CONDITIONS.

No.	REVISION/DESCRIPTION	BY	DATE
1	ISSUED FOR ADDENDUM 1	DTA	2022.12.15
0	ISSUED FOR CONSTRUCTION	DTA	2022.11.03

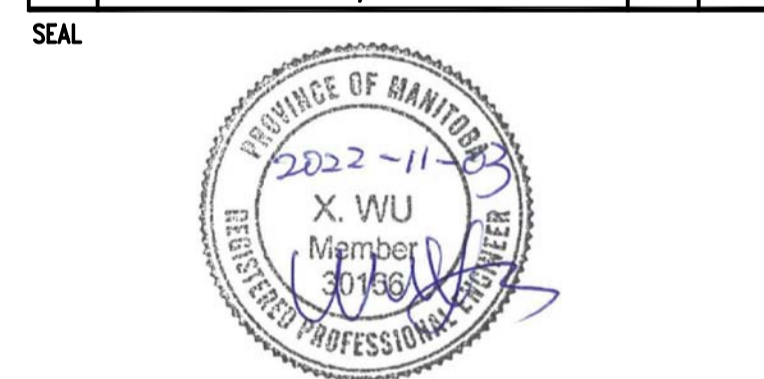

DATE	CHECKED	DESIGNED	APPROVED
2022.10.24	USER		

THE CITY OF WINNIPEG
 PLANNING, PROPERTY AND
 DEVELOPMENT DEPARTMENT
 MUNICIPAL ACCOMMODATIONS DIVISION
 3-65 GARRY STREET, R3C 4K4

PROJECT
 WINNIPEG FIRE PARAMEDIC SERVICES
 FIRE STATION #1
 ELECTRICAL SERVICE UPGRADE AND EMERGENCY GENERATOR
 65 ELLEN STREET BID OPP: 805-2022

SHEET TITLE
 ELECTRICAL
 PANEL SCHEDULES- RENOVATION

SCALE	PROJECT No:	SHEET No:
AS SHOWN	2019-150-01	E5.0-R1